


# Achieving energy neutrality in wastewater treatment plants through energy savings and enhancing renewable energy production

Mojtaba Maktabifard  · Ewa Zaborowska · Jacek Makinia

© The Author(s) 2018

**Abstract** Wastewater treatment plants (WWTPs) consume high amounts of energy which is mostly purchased from the grid. During the past years, many ongoing measures have taken place to analyze the possible solutions for both reducing the energy consumption and increasing the renewable energy production in the plants. This review contains all possible aspects which may assist to move towards energy neutrality in WWTPs. The sources of energy in wastewater were introduced and different indicators to express the energy consumption were discussed with examples of the operating WWTPs worldwide. Furthermore, the pathways for energy consumption reductions were reviewed including the operational strategies and the novel technological upgrades of the wastewater treatment processes. Then the methods of recovering the potential energy hidden in wastewater were described along with application of renewable energies in WWTPs. The available assessment methods, which may help in analyzing and comparing WWTPs in terms of energy and greenhouse gas emissions were introduced. Eventually, successful case studies on energy self-sufficiency of WWTPs were listed and the innovative projects in this area were presented.

**Keywords** Wastewater treatment plant · Energy neutrality · Energy conservative measures · Energy recovery · Renewable energy · Efficiency

## 1 Introduction

Water-energy nexus is one of the crucial elements for human sustainable development (Jiang et al. 2016; Chen and Chen 2016). These two resources are essential for global production and life (Walker et al. 2013). Wastewater treatment plants (WWTPs) are central to water-energy interactions (Xu et al. 2017) as the plants consume energy to remove pollutants and thus reduce human footprint on the natural water environment (Gu et al. 2016). On the other hand, if energy delivered to WWTPs from external grid originates from fossil fuel incineration, greenhouse gases (GHG) emission is induced while increasing the global warming potential (GWP). To tackle the problem, major economies in the world have implemented a policy on energy saving. The wastewater treatment industry, being one of the main energy consumers, has developed various technologies to improve the energy efficiency (Ho et al. 2014), but in practice, there is no single recommended scenario for the energy self-sufficiency. Energy often represents the second largest operational cost behind labour for providing wastewater services to the public (Lindtner

---

M. Maktabifard (✉) · E. Zaborowska · J. Makinia  
Faculty of Civil and Environmental Engineering, Gdansk  
University of Technology, Narutowicza Street 11/12,  
80-233 Gdańsk, Poland  
e-mail: mojtaba.maktabifard@pg.edu.pl

et al. 2008; Wojtowicz et al. 2013; Moss et al. 2013). Therefore, increasing the energy efficiency is one of the most effective ways for WWTPs to manage costs and help ensure the long-term operational sustainability (WERF 2015a).

As nutrient limits continue to ratchet downward and electricity costs creep upward, and with an increased focus on carbon footprint, climate change, and GHG emissions, all consumers are becoming more cognizant of the impacts of their activities on the social, environmental, and financial bottom lines. This triple bottom line approach also refers to the wastewater industry (Horne et al. 2013). According to a new paradigm in wastewater treatment, WWTPs should be designed considering maximization of the resource and energy recovery. This new approach emphasizes a shift towards the energy neutral or even energy positive facilities. Another challenge is decreasing the carbon footprint of WWTPs via reduction of direct and indirect GHG emissions. The direct emissions, such as  $N_2O$  and  $CH_4$  from bioreactors and sewers, are often a large portion of a WWTP carbon footprint (Lorenzo-Toja et al. 2016; Schaubroeck et al. 2015). It was found that just 1% of denitrified nitrogen emitted as  $N_2O$  would increase the carbon footprint of the WWTP by approximately 30% (de Haas and Hartly 2004). The contributions of  $N_2O$  emission in the total WWTP carbon footprint were reported as high as 78% by Daelman et al. (2013) and 60% by Rodriguez-Caballero et al. (2015). On the other hand, Aboobakar et al. (2013) reported that  $N_2O$  emission added only 13% to the carbon footprint associated with the energy requirements. Except for specific plant configurations and operational conditions, those differences can also be attributed to the assumed energy source. The share of indirect emissions mainly caused by electricity consumption, chemicals and transportation cannot be neglected when it comes to the total carbon footprint of WWTPs. Striving for sustainability in wastewater treatment, a complex and multi-criteria approach is essential, as well as expanding the system boundaries beyond the WWTP. Increasing the share of renewable energies for the off-site electricity production can also support the activities carried out within the WWTP.

In general, carbon neutrality in WWTPs is related to the term energy neutrality. Even though novel technological solutions are already available for achieving energy neutrality, their application to upgrade existing plants can be far more challenging

than building new dedicated plants (Gao et al. 2014). Bertanza et al. (2018) adopted a detailed evaluation on the actual impacts of upgrading existing WWTPs and concluded that the energy self-sufficiency was not far away to be achieved, with moderate techno-economic implications, especially when the plant would be equipped with primary sedimentation and anaerobic digestion (AD). The regular energy monitoring is essential for identifying the potential for improvement. Marner et al. (2016) strongly suggested that energy audits should be performed regularly using a systematic procedure to obtain adequate knowledge of the energy consumption profile of a WWTP.

The energy neutrality can be approached via different methods but there are two crucial factors which must explicitly be analysed. First, the effluent standards for achieving the required quality of wastewater should be maintained. Secondly, the additional capital costs for modifying the existing instruments in WWTPs should be convincing for the plant operators. Therefore, ongoing investigations seek to improve the energy balance and optimize the relationship between energy and effluent quality.

When it comes to the energy neutrality in WWTPs, it is crucial to employ all the possibilities to cover the electricity consumption. Typically, the potential energy derived from sludge in various forms is not enough for energy self-sufficiency. Therefore, the production of renewable energy in the plant from the external sources appears to be a solution which can add the clean energy to the energy balance. By applying the renewable energies, a greater opportunity appears to move towards the energy neutrality of WWTPs.

The aim of this review is to present in a systematic way, the various approaches to achieve energy neutral conditions in WWTPs. The systematic review contains identification and quantification of the energy balance components, methods for reducing energy consumption and methods for increasing energy recovery, supplemented with options for gaining the external renewable energy resources. The recent case studies were reviewed and possible scenarios to improve the energy balance in WWTPs were introduced. Finally, examples of WWTPs striving for or already achieved energy neutrality are presented.

## 2 Energy considerations in WWTPs

### 2.1 Energy distribution in WWTPs

Wastewater contains a significant amount of chemical, thermal and hydrodynamic energy. The chemical energy is the energy bounded in organic molecules (expressed as the chemical oxygen demand—COD), and in some inorganic compounds ( $\text{NH}_3$ ), which can be released by exothermic reactions. Shizas and Bagley (2004) determined the energy content of organics in municipal wastewater, using a bomb calorimetry method. Results of those experiments revealed that the organic energy in wastewater is approximately 10 times greater than the electric energy required to treat it (Horne et al. 2013; Moss et al. 2013). On the contrary, Parry (2014) challenged this argument by showing that not all the potential energy can be used for energy neutrality or even positive effect in WWTPs due to low-grade heat that has low energy quality for production. Indeed, a very efficient operation is required to achieve the power positive effect in WWTPs. Products of energy recovered from wastewater include electricity, biogas, steam and hot water which have different qualities (Parry 2014). The estimated total energy embedded in wastewater was estimated as high as  $9.7 \text{ kWh/m}^3$ , including  $2.7 \text{ kWh/m}^3$  (28%) of the extractable energy (Gude 2015a). The highest specific energy consumptions reported by WWTPs in most cases are below  $1 \text{ kWh/m}^3$  (Table 1) which is still far less than the reported potentially extractable energy content of wastewater.

Biosolids typically contain approximately 4–6 kWh/kg on a dry weight basis, which is similar to the energy content of low-grade coal (Stone et al. 2010). There are many opportunities to convert the chemical energy in solids to a useable form (heat or fuel) through biological or thermal processes (Moss et al. 2013). The share of compounds that can be utilized depends on the method of energetic or material exploitation by microorganisms in the AD process, microbial electrochemical process, microbial synthesis or microbial conversion.

Figure 1 shows the various sources of energy entering a typical (medium or large size) WWTP which consists of a primary clarifier, biological reactor and AD, along with sinks and transformations of energy in the facility. The chemical energy enters the WWTP with the raw wastewater influent. In addition

to the influent, there are other external resources also entering the WWTPs seeking the energy neutrality. These external sources of energy are primarily in the form of solar or hydro energy harvested on-site and biogas produced from the external organic wastes co-digested with sewage sludges. Energy losses include the wasted chemical energy from biological treatment, energy loss in the form of sludge and biosolids and inefficiencies of energy conversion in devices i.e. in combined heat and power (CHP) plants. Surplus energy refers to the energy produced on-site which exceeds the consumption for wastewater and sludge treatment and used in the background facilities for air conditioning, heating, lighting, etc. The energy positive WWTP can export excess energy outside the plant. In this approach, energy neutrality refers to the state of the energy independency from final energy carriers (mainly electricity) produced outside and imported to the WWTP. In order to reach the energy neutrality various measures could be undertaken, including:

1. Reducing the energy consumption in wastewater treatment processes,
2. Increasing the energy recovery from internal sources,
3. Adding sufficient external sources of renewable energy.

These measures are discussed further in the paper.

### 2.2 Energy consumption in WWTPs


A report prepared for the Electric Power Research Institute (EPRI) (Burton 1996) estimated that the energy demand for the combined water and wastewater industry would be approximately 75 billion kWh per year, or about 3% of the electricity consumed in the US at the time. After almost two decades another study in the US (Rothausen and Conway 2011) revealed that the wastewater treatment sector itself consumes approximately 21 billion kWh each year, which corresponds to the equivalent of 1.8 million typical households. Treatment and transport of wastewater currently consumes approximately 4% the total electrical power produced in the US (Xu et al. 2017). In Europe, WWTPs contribute to approximately 1% of the total electricity consumption in cities (Haslinger et al. 2016). Data from Germany and Italy show that the electricity demand for wastewater

**Table 1** Specific energy consumption and main energy consumers in WWTPs

References	Specific energy consumption (kWh/m <sup>3</sup> )	Contributions				Remarks
		Aeration (%)	Sludge treatment (%)	Pumping (%)	Other (%)	
Gans et al. (2007)	0.26	57	5	–	38	2.4 million PE advanced WWTP in China (Beijing)
Nouri et al. (2006)	0.3	77	7	11	7	WWTP in Iran (Tabriz) after upgrades
Panepinto et al. (2016)	0.3	51	29	–	20	2.7 million PE (615 km <sup>3</sup> /day) advanced WWTP in Italy (Turin)
Jonasson (2007)	0.30	70	13	4	13	Benchmarking study on modern WWTPs in Austria
Jonasson (2007)	0.32	57	13	9	21	250 k PE modern WWTP in Austria (Strass)
Mizuta and Shimada (2010)	0.32	46	31	18	5	81 km <sup>3</sup> /day conventional WWTP in Japan (Northern Kumamoto)
Gu et al. (2017)	0.37–1.6	60	12	12	16	Average MBR treatment systems located in Singapore
Wang et al. (2016)	0.43	–	–	–	–	38 km <sup>3</sup> /day WWTP US (Sheboygan)
NEWRI (2009)	0.45	–	–	–	–	990 k PE modern WWTP in Singapore (Jurong), receiving industrial (40% of influent) wastewater with higher COD
Jonasson (2007)	0.48	48	14	9	29	500 k PE conventional WWTP in Sweden (Stockholm)
Zaborowska et al. (2017)	0.48	53	–	30	17	250 k PE advanced WWTP in Poland (Slupsk)
Trojanowicz (2016)	0.67–1.11	–	–	–	–	117 k PE WWTP in Poland (Kronso)
Masłóń (2017)	0.87	–	–	–	–	400 k PE advanced WWTP in Poland (Rzeszow)
Yeshi (2015)	0.89	13	9	24	54	800 km <sup>3</sup> /day modern WWTP in Singapore (Changi), (approx. half of the energy consumption is non-process related due to considerations to meet the environmental requirements)
NEWRI (2009)	–	50	30	15	5	GWRC reported data for a typical conventional WWTP
Aymerich et al. (2015)	–	42	31	20	7	115 k PE (18 km <sup>3</sup> /day) WWTP in Spain (Girona), advanced biological removal system
Henriques and Catarino (2017)	–	53	–	12	35	Benchmarking study on 14 Portuguese WWTPs
Marner et al. (2016)	–	67	11	5	17	Estimated average energy distribution of WWTPs in Germany

treatment accounts for approximately 1% of the total consumption in the countries, whereas another study revealed that WWTPs account for approximately 0.7% of the total energy consumption in Germany (Husmann 2009). In Spain, some studies suggest that domestic and industrial water cycles account for 2–3% of the total electric energy consumption. When

considering water management and agricultural demand, the contribution could even reach 4–5% (Longo et al. 2016). It is estimated that the electricity required for wastewater treatment will increase by 20% in the next 15 years in the developed countries, leading to a significant increase in CO<sub>2</sub> emissions and resource consumption (Yan et al. 2017).

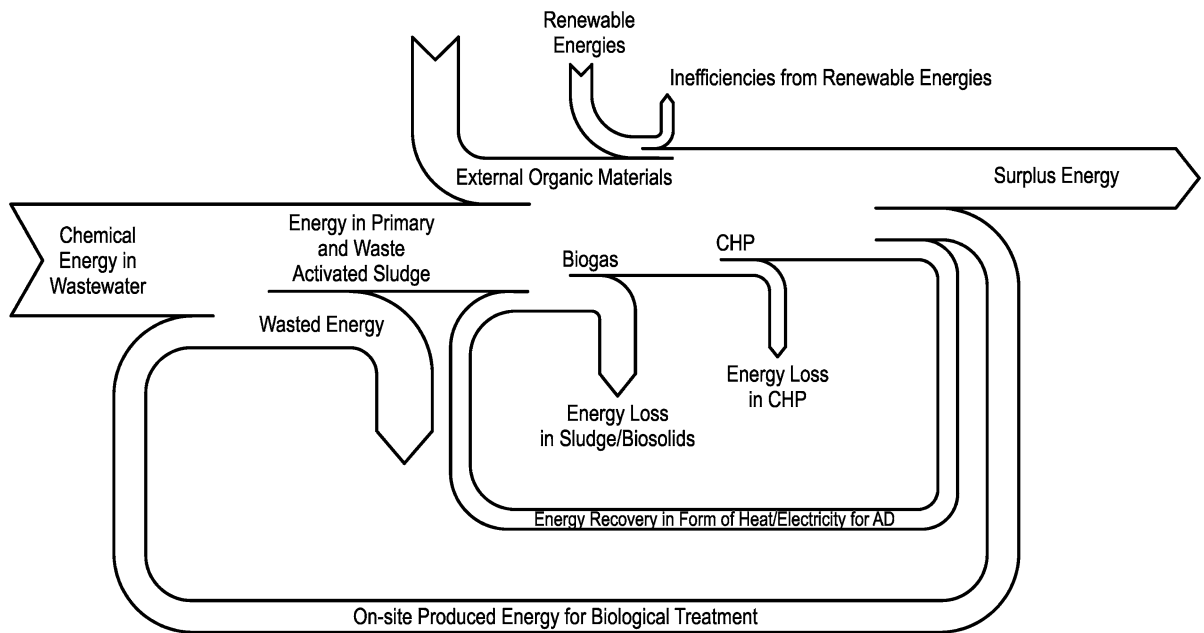

**Fig. 1** Flow chart of a typical (medium or large size) WWTP consisting of a primary clarifier, biological reactor and AD, which is showing energy sources and transformations supporting the energy neutral/positive wastewater treatment

Many factors influence the energy consumption for wastewater treatment. The energy demand depends on the plant location, plant size, type of a treatment process and aeration system employed, effluent quality requirements, age of a plant, and knowledge and skills of the operators. Although the average energy consumption per cubic meter of treated wastewater ( $\text{kWh}/\text{m}^3$ ) is in a narrow range across countries (Hernández-Sancho et al. 2011), the amount of energy needed for operations varies widely among individual WWTPs as shown in Table 1. The range of the reported data on the specific energy consumption can be as low as  $0.25 \text{ kWh}/\text{m}^3$  (Ho et al. 2014) for WWTPs using advanced biological removal systems with several energy conservative measures. The data on energy consumption could be over  $1 \text{ kWh}/\text{m}^3$  (Trojanowicz 2016; Gu et al. 2017) which is considered as a high amount according to the literature and might be caused for several factors, such as high load of industrial wastewater influent, stricter environmental limitations, complex technology, etc. The climate under which the WWTPs were operated, appeared to have a minor impact on energy consumption such that colder temperate conditions could possibly have resulted in lower energy consumption in comparison with tropical conditions. For example, the reported

overall specific consumption in Canada and Singapore was  $0.3 \text{ kWh}/\text{m}^3$  and  $0.45 \text{ kWh}/\text{m}^3$ , respectively (NEWRI 2009).

In another study in China, Li et al. (2017) investigated 22 WWTPs in Shenzhen and analysed the effect of treatment capacity and treatment technology on the energy cost per unit of wastewater treated. The results showed that the average energy consumption of the studied WWTPs was  $0.20 \pm 0.06 \text{ kWh}/\text{m}^3$ , which was significantly lower in comparison with some developed countries (Table 1). The lower specific energy consumption in WWTPs located in Shenzhen (China) might be related to 2 reasons. Firstly, most of the WWTPs under study were constructed in past 10 years and are more technologically advanced in comparison with the ones constructed 30 years ago in developed countries (Li et al. 2017). The second reason is that compared to the wastewater characteristics in European countries, COD in China's municipal wastewater is quite low (typically between 200 and  $400 \text{ mg}/\text{L}$ ) while in European countries can be from 400 to  $800 \text{ mg}/\text{L}$ ). As a consequence, less energy can be used for oxidation of organic compounds (Hao et al. 2015). Furthermore, the labour cost and electricity consumption covered about 30% and 26%, respectively, of the total economic cost in the

three typical WWTPs in Shenzhen. Thus, upgrading treatment machines and equipment and improving management level are two effective alternatives to decrease energy consumption and lower the total economic cost of the WWTPs.

Before describing the methods and technologies for decreasing the energy consumption in wastewater treatment processes, the main energy consumers in WWTPs should be identified. Table 1 shows literature data on the share of main consumers in wastewater treatment. Regardless of the WWTP size, most of the energy is consumed during biological treatment (can be up to 75% of total consumption) (Rosso et al. 2008). As shown in Table 1, more than 60% of the listed WWTPs consume more than a half of their energy just for aeration in the biological state of the plant. Therefore, the most consistent energy savings in the treatment line can be achieved there. Another important contribution may derive from the optimization of primary settling efficiency and pumping operations provided that the necessary amount of biodegradable organic compounds to protect denitrification is guaranteed. More relevant options for the energy saving may be found in the sludge processing line, primarily by the optimization of AD and installation of CHP engines (Panepinto et al. 2016). Although aeration is the most well-known energy intensive operation as it can be seen in Table 1, recirculation of the settled sludge, and aerobic sludge stabilization may also have comparably high energy consumption, but those factors are often erroneously ignored in small WWTPs (Foladori et al. 2015).

### 2.3 Energy performance evaluation

As it was indicated in the previous section, the specific energy consumption and energy distribution in WWTPs depend on many factors and assumptions. Thus, uniform procedures are postulated to facilitate a comparison between the plants, as well as to diagnose the actual performance of a specific plant and evaluate upgrades under consideration. Information on energy consumption in various processes of wastewater treatment allows to focus on modifying the stages of a WWTP which are operated less efficiently (WERF 2011; Gu et al. 2017).

Energy audit is a preliminary procedure used to evaluate energy consumption in an object and identify energy conservation measures (ECMs). Energy audits

in WWTPs reveal large differences in the energy consumption in the various stages, also depending on the indicators used in the audits. Formulating a uniform methodology to perform audits in WWTPs and identifying the most suitable key energy consumption indicators for comparison between different plants is necessary (Foladori et al. 2015). One of the aims of an energy audit is determination of an energy baseline regarding the reference consumption of individual devices and installations. Energy consumption data can be collected together with operational data, and influent and effluent characteristics, whereas major energy consuming devices, such as blowers, mixers, pumps and aeration systems must be found separately (Longo et al. 2016). Final recommendations refer to operational and process modifications leading to the energy savings.

Energy benchmarking is a powerful tool in the optimization of WWTPs, which can help reduce costs and GHG emissions. Traditionally, energy benchmarking methods focused solely on reporting electricity consumption, however, recent developments in this area have led to the inclusion of other types of energy, such as heat, chemical and mechanical consumptions, which can be expressed in kWh/m<sup>3</sup> (Belloir et al. 2015). Following one of the published benchmarking protocols, a “standard” WWTP can be defined in order to compare energy usage in the plants with different characteristics.

Eco efficiency supports WWTPs on their way towards sustainability by focusing their efforts mainly on the reduction of energy consumption, improvement of processes, and valorisation or elimination of waste flows. Henriques and Catarino (2017) noted that the removal efficiency of pollutant loads was related to the energy consumption at each studied WWTP. The sustainable value indicator, relating the removal efficiency to the cost or energy consumed, was established and used for comparison between the target plants. The results of energy audits already carried out show that despite the capacity, each WWTP has potential for energy savings. Those savings can range from 20 up to 40% and in some specific cases even more (there are examples where even 75% were attained (Panepinto et al. 2016)). The treatment efficiency of WWTPs is generally measured in terms of the removal of total suspended solids (TSS) organic matter (COD and BOD<sub>5</sub>) and nutrients (ammonia). The treatment performance can be

affected by the age of WWTPs. Castellet-Viciano et al. (2018) proved that due to the deterioration of the facilities, the efficiency of the treatment (specially for smaller WWTPs) decreases gradually. Apart from kWh/m<sup>3</sup> (most common indicator to assess the energy performance of WWTPs), three energy key performance indicators (KPIs) were defined. The second most frequent indicator reported in the literature shows the electricity consumption in relation to the population equivalent (PE) per year (kWh/PE<sub>year</sub>). Furthermore, a reference to the amount of pollutants removed from wastewater expresses the electricity

consumption related to the removed loads of BOD<sub>5</sub> (kWh/kgBOD<sub>removed</sub>) and COD (kWh/kgCOD<sub>removed</sub>). The most commonly reported KPIs are listed in Table 2.

The available data on this indicator ranges between 12 and 60 kWh/PE.year. The prospective ideal value of energy consumption changes in terms of the condition of WWTPs as well as countries regulations. For example, Marner et al. (2016) considered 16.6 kWh/PE.year as a target for Bochum-Ölbachtal WWTP in Germany.

**Table 2** Various key performance indicators (in addition to kWh/m<sup>3</sup> shown in Table 1) reported in the literature for different WWTPs

KPI	Studied facilities	Specific energy consumption	Remarks	References
kWh/PE.year	Rzeszow (Poland)	48.2	400 k PE advanced WWTP	Masłoń (2017)
	Kronso (Poland)	59.1	117 k PE advanced WWTP	Trojanowicz (2016)
	Slupsk (Poland)	16	250 k PE BNR WWTP	Zaborowska et al. (2017)
	Bochum-Ölbachtal (Germany)	23	213 k PE WWTP before modifications	Marner et al. (2016)
	Bochum-Ölbachtal (Germany)	12	213 k PE WWTP after modifications	Marner et al. (2016)
	16 Austrian WWTPs	28.4	16 Austrian WWTPs, PE > 100 k	Haslinger et al. (2016)
	7 Austrian WWTPs	33.6	7 Austrian WWTPs, 50–100 k PE	Haslinger et al. (2016)
	55 Austrian WWTPs	36.8	55 Austrian WWTPs, 20–50 k PE	Haslinger et al. (2016)
	24 Austrian WWTPs	48.2	24 Austrian WWTPs, 10–50 k PE	Haslinger et al. (2016)
	Burg (Germany)	15.3	120 k PE, Conventional WWTP	Torregrassa et al. (2018)
	Stuttgart-Mühlhausen (Germany)	41.5	1200 k PE advanced WWTP	Zettl (2015)
kWh/kg COD <sub>removed</sub>	Rzeszow (Poland)	0.49–0.68	400 k PE advanced WWTP	Masłoń (2017)
	43 WWTPs in developed countries	0.69	43 WWTPs, > 100 k PE	Longo et al. (2016)
	35 WWTPs in developed countries	0.82	35 WWTPs, 50–100 k PE	Longo et al. (2016)
	89 WWTPs in developed countries	1.02	89 WWTPs, 10–50 k PE	Longo et al. (2016)
	Changi WRP (Singapore)	1.88	800 km <sup>3</sup> /day BNR WWTP	Yeshe (2015)
	177 WWTPs in Valencia region (Spain)	1.68	400 km <sup>3</sup> /day (mean treated volume of the sample)	Hernández-Sancho et al. (2011)
	Jurong (Singapore)	0.58	990 k PE advanced WWTP	NEWRI (2009)
Beijing Gaobeidian (China)	0.75	2.4 million PE advanced WWTP	Gans et al. (2007)	
kWh/kg BOD <sub>removed</sub>	Rzeszow (Poland)	1.03–1.57	400 k PE advanced WWTP	Masłoń (2017)
	Slupsk (Poland)	0.75	250 k PE BNR WWTP	Zaborowska et al. (2017)

**Table 3** Methods supporting the decision making in the energy-related aspects of WWTPs

Method	Description	Sample applications in WWTPs (references)
Economic efficiency analysis (EEA)	EEA is based on the capital costs, operating costs and economic benefit in WWTPs. It is mainly related to energy aspects in terms of reducing operating costs by advanced control systems and increasing economic benefit by increasing energy recovery	IPPC (2003), U.S. MSWSAP (2013), Piao et al. (2016) and Guerrini et al. (2018)
Carbon footprint analysis (CFA)	CFA can measure the total GHGs released by WWTPs. Increasing aeration efficiency and reducing energy consumption by on-site energy recovery would help reduce the carbon footprint in WWTPs	Remy et al. (2013), Daelman et al. (2013), de Haas et al. (2014), Mamais et al. (2015), Bao et al. (2016) and Wang et al. (2016)
Life cycle analysis (LCA)	LCA is a standardized procedure applied for analyzing environmental aspects in WWTPs. Several studies have adopted LCA to analyse energy related aspects such as AD and biogas production	Evangelisti et al. (2014), Molinos-Senante et al. (2014), Arashiro et al. (2018) and Polruang et al. (2018)
Data envelopment analysis (DEA)	DEA is a technique that is widely applied for eco-efficiency assessment (useful when there is limited available data). The economic cost, energy consumption, pollutant removal, and global warming effect during the treatment processes are integrated to interpret the eco-efficiency of WWTPs	Hernández-Sancho et al. (2011), Sala-Garrido et al. (2011, 2012), Molinos-Senante et al. (2014), Lorenzo-Toja et al. (2015) and Guerrini et al. (2017)
Plant-wide modeling	Simulation tools allow to predict performance of WWTPs and analyse detailed information in terms of the influent and effluent quality, and energy consumption. Modelling also makes comparison of different strategies to achieve energy neutral condition much more feasible. A multi-objective performance assessment of WWTPs combining dynamic process model including GHG, detailed energy models, operational cost and LCA was also proposed	Flores-Alsina et al. (2014), Barbu et al. (2017), Mannina et al. (2016a, b), Zaborowska et al. (2017), Solon et al. (2017) and Arnell et al. (2017)

On-line measurement data, available in many WWTPs, should theoretically enable to decrease the management response time by daily benchmarking. Limited available data from WWTPs are often a challenge, therefore, Torregrossa et al. (2016) proposed a methodology to perform a daily benchmark analysis under database limitations. The methodology was applied to the energy online system (EOS) which calculated a set of KPIs for the evaluation of energy and process performances. In the EOS, the energy KPIs took the pollutant load in order to enable the comparison between different plants. The EOS did not analyse the overall energy consumption but the specific energy consumption in terms of pollutant load. This approach enables a comparison of performances for plants with different loads or a single plant under different loading conditions.

The energy audits and energy benchmarking are fundamental tools in assessing energy consumption and energy conservation potential, including implementation of new processes and technologies. It is expected that the proposed upgrades are energy and

cost efficient, while still maintaining the effluent discharge limits. As the wastewater treatment paradigm shifted towards sustainability, the environmental impact in a life cycle has become another challenge in a WWTP optimization. Thus, the advanced and complex methods supporting decision making in the energy-related aspects have been proposed for WWTPs (Table 3).

### 3 Methods for reducing energy consumption

Energy is most often among top three most expensive items in a wastewater utility's operation and management budget. Reducing the purchased energy not only benefits lowering the potential costs, but also results in decreasing the carbon footprint and increasing the sustainability of the operations (Horne et al. 2013; Moss et al. 2013). Methods of minimizing the electricity consumption can be divided into two major categories. The first one focuses on the operational modifications applied at different sections of a WWTP, whereas the



second method incorporates the innovative processes for wastewater treatment with less energy demand compared to the traditional technologies.

### 3.1 Energy conservative measures via operational strategies

The ECMs via operational strategies include upgrades related to mechanical devices and aeration systems as the significant components of a WWTP energy balance. The advanced improvements have been recognized and recommended for implementation in both existing and designed plants.

#### 3.1.1 Mechanical devices

Pumping operations can be a significant energy consumer at WWTPs, being in many cases are the second one after aeration (Saghafi et al. 2016). Upgrading motors is a conventional ECM that has been practiced at WWTPs. (WEF 2009) estimates that electric motors can make up 90% of the electric energy consumption of mechanical devices in a WWTP. Since the pumping life cycle costs are dominated by the energy costs in comparison with the construction phase, it is always worth of paying close attention to pumps and renew or service them whenever an energy audit reveals increased operating costs (Jenkins and Wanner 2014).

The variable speed operation is often the most energy-efficient flow control method for pumping systems, as the pump performance can be adjusted to meet the process demand instead of adjusting additional hydraulic losses (Ahonen et al. 2014). Variable frequency drives (VFDs) offer a rapid return on investment with the payback time ranging from 6 months to 5 years (NYSERDA 2010). USDOE (2005) reported numerous successful applications of the VFDs with energy savings ranging from 70,000 kWh/year for smaller WWTPs up to 2,800,000 kWh/year for larger WWTPs. Since the technology is already well-established, the recent trend is to make the devices more communicative to walk towards entirely smart managed processes (Philipon 2015). However, if the VFDs are not selected and applied correctly, they can waste energy. Operating below 75% of the full load, the VFDs can have very low efficiencies. In general, such drives may not be effective when a large static head must be overcome or where the flow rates are approximately constant (WEF 2009).

Mechanical surface aerators vigorously agitate the wastewater, transferring oxygen from the air by increasing the water-atmosphere interface. Agitators can contribute to about 5–20% of the total energy consumption of a WWTP, which depends on the design capacity. Reduction in the power density and decrease in the daily operation time are the major methods to reduce agitator energy consumption (Füreder et al. 2017).

In terms of the energy consumption for aerating Boncescu and Robescu (2017) performed an experimental research on different type of aerations including mechanical surface aerators. Aeration of 416 m<sup>3</sup> water volume surface aerators consumed 25 kW with 2.3% oxygenation efficiency while fine bubble aerators consumed 8.2 kW with 23% oxygenation efficiency. These results confirmed that mechanical aerators have lower energy efficiency, thus the mechanical aerators should undergo ECM methodologies to increase their efficiency. Füreder et al. (2017) claimed that under favourable conditions with respect to the tank volume, tank geometry, aeration and agitator position, mixing energy can be reduced below 24 Wh/(m<sup>3</sup>day).

Radial-flow low-speed mechanical aeration systems can provide higher aeration efficiency than high-speed machines (WEF and ASCE 2010). As the influent load to the plant decreases in the evening, the dissolved oxygen (DO) concentration increases consequently, cycling aerators off during night-time hours can be effective in reducing aeration energy (EPA 2010). A new development in mechanical aerators is the use of multiple impellers. Single impeller mechanical aerators are limited in their turn down due to the need to keep the contents of the bioreactor from settling. A dual impeller aerator (Eimco 2018) includes a lower impeller near the bottom of the bioreactor to augment the surface impeller. This provides the additional mixing energy near the floor of the bioreactor, permitting greater power turndown when a VFD is used and associated energy savings. The ECMs of mechanical devices are summarized in Table 4.

#### 3.1.2 Advanced aeration control systems

Automated control of the aeration process is an important ECM that can save considerable amounts of energy by quickly adjusting to dynamic conditions



**Table 4** Energy conservative measures of mechanical devices

Operation	ECM	Remarks
Motors/pumping	Proper sizing VFD	If VFDs are not operated well it can cause energy waste Fast payback time
Mechanical surface aerators	Low-speed On/off mode Multiple impellers	Lower efficiency comparing to fine bubble systems

within the reactor. The amount of oxygen required to maintain biological processes within the aeration basin is proportional to the influent organic and ammonia loadings. The oxygen demand for aeration, therefore, follows the same diurnal pattern, dipping in the middle of the night and peaking in the morning and evening. The ratio of the peak to minimum oxygen demand can typically be 2:1 (Cantwell 2009). It is postulated that reduction in the DO set points can provide significant energy savings due to a lower amount of energy required for aeration and this can also result in reduced GHG emissions (Mamais et al. 2015). On the other hand, over reduction of the DO set points may also lead to higher N<sub>2</sub>O yields which may override any energy-related GHG savings. Reconfiguration, replacement and application of the optimal DO control strategies for existing aeration systems in the facility and model-based DO optimization in WWTPs can result in the increased energy efficiency and savings and improved stability of the system (Pittoors et al. 2014).

A properly operating DO and aeration control system can save from 25 to 40% of the energy used by manually controlled systems. The DO control is commonly used to provide aeration savings by modulating airflow based on the oxygen demand and is a prerequisite for more advanced control strategies (Åmand et al. 2013). The recent availability of reliable ammonia, nitrate, and nitrite sensors has led to more advanced aeration control strategies including ammonia-based aeration control (ABAC) and Ammonia vs. Nitrate (AVN) control (Klaus 2016).

Intermittent aeration saves energy by reducing the number of hours when an aeration system is turned on. The cycle length can be controlled along with the DO concentration. For example the implementation of intermittent aeration in a pilot-scale system based on the modified Ludzack-Ettinger (MLE) process configuration significantly improved TN and TP removal


and additionally saved aeration energy by 10% in comparison with the continuous aeration mode (Liu and Wang 2017).

**Ammonia-based aeration control system** The most common aeration systems are controlled based on the DO measurements. However, keeping the DO levels constant as the ammonium concentration approaches zero could result in unnecessary aeration. This condition can be alleviated with the use of ABAC, which can reduce both aeration costs and peaks in the effluent ammonia concentration (Sadowski 2015).

There are two types of the ABAC structures, including feed-back and feed-forward (Fig. 2). The first approach is simpler and comprises the direct control of aeration based on the feed-back from the ammonium measurement in the aerobic zone. In a case study, a WWTP (250,000 PE, receiving 95,000 m<sup>3</sup>/day wastewater) used online ammonium ion selective electrode (ISE) measurement to ensure nitrification is complete. Blowers cycled on and off to maintain the ammonium-nitrogen concentration between the set points of 0.7 mg N/L and 1.0 mg N/L. The blowers were “off” 25% of the time with this strategy enabling anoxic conditions for denitrification and saving about \$20,000 per month in the energy costs (Higgins 2016). Feed-back control is based on the measured output of the process and therefore a possible criticism is that an error must exist before a control action can be taken.

The feed-forward aeration control is based on the upstream ammonium concentration and measurement of the disturbance (Smith 2013). It has greater complexity but offers the potential to achieve better effluent quality at a reduced energy cost (Rieger et al. 2014). Another case study on a WWTP located in Illinois (US) with the design average flow rate of 34,000 m<sup>3</sup>/day, showed that the airflow closely followed the upstream ammonium concentration and the

**Fig. 2** ABAC feed-back type system scheme (based on Higgins 2016)

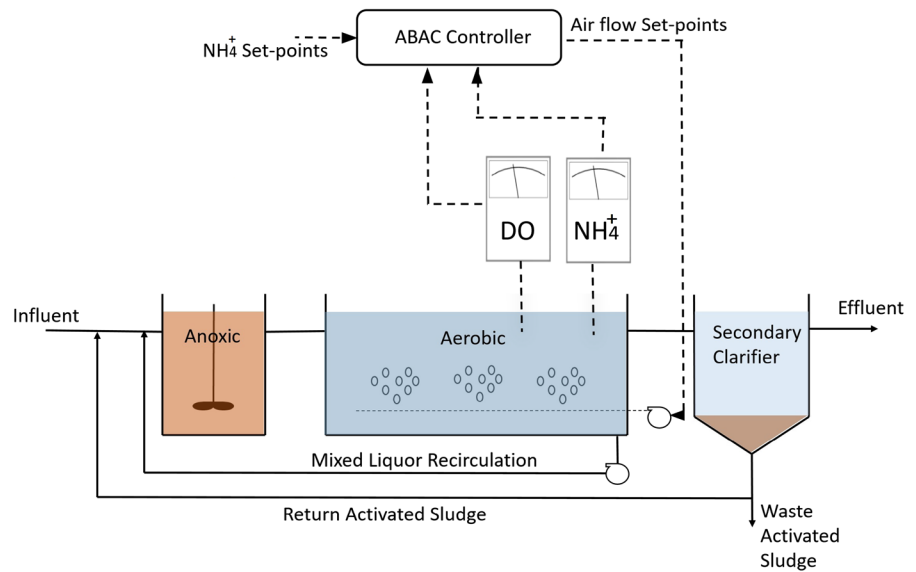


DO concentration was maintained near 2.0 mgN/L for the majority of the time. This strategy achieved the lowest unit airflow demand, 11% lower than with the DO feed-back control (Poole 2012). On the other hand, Rieger (2012) noted that the benefit of feed-forward aeration control did not, in most cases, provide a substantial benefit over feed-back control and thus the additional cost and complexity were not justified. The advantage of feed-forward control is that the system reacts faster to a disturbance eliminating short-term effluent peaks and allowing a smoother control. In practice, however, predictions are only as

good as the model on which they are based. Therefore, the feed-back from an effluent ammonium sensor is also recommended to correct errors in the model.

**Ammonia versus nitrate control system** An intermittent aeration strategy termed ammonia versus nitrate (AVN) control (Fig. 3) has originally been developed to achieve nitrite shunt through nitrite oxidizing bacteria (NOB) suppression (Sadowski 2015). However, AVN control has the potential to be expanded beyond nitrite shunt and provide more efficient nitrogen removal than ABAC. By setting the

**Fig. 3** AVN control scheme (based on Regmi et al. 2015)

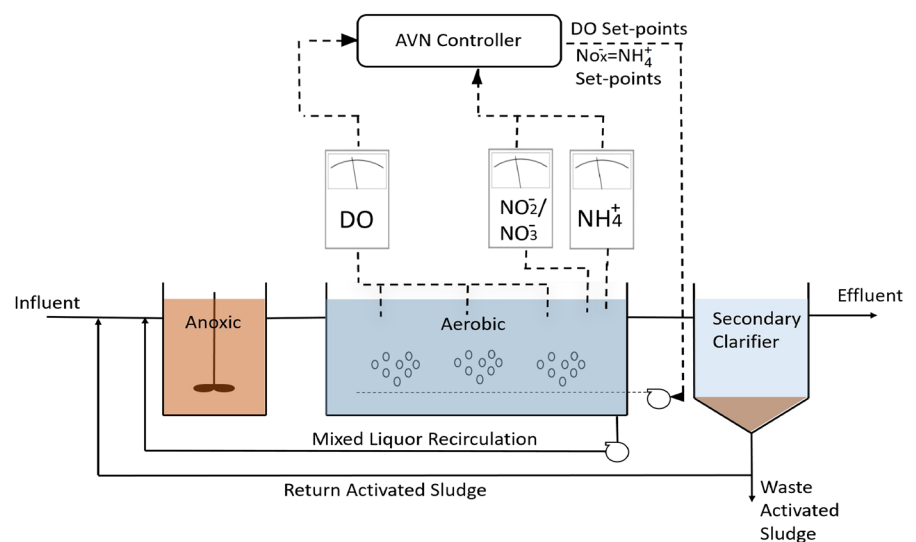

effluent ammonia and  $\text{NO}_x$  ( $\text{NO}_3 + \text{NO}_2$ ) concentrations equal, or by specifying a ratio of  $\text{NH}_4\text{-N}/\text{NO}_x\text{-N}$  based on the actual need to comply with an effluent ammonia limit, AVN control oxidize only the amount of ammonia that can be denitrified utilizing the influent organic carbon. With this approach, COD utilization efficiency is maximized without the need of addition of supplemental carbon. This can be achieved with either continuous or intermittent aeration. For many existing WWTPs, intermittent aeration may be difficult to implement due to limitations of the existing aeration equipment (Regmi et al. 2014). A model-based evaluation revealed that the AVN aeration control method has a relatively better efficiency of nitrogen removal (17.5%) in comparison with ABAC. Furthermore, AVN control allows to consume 8.6% less oxygen compared to ABAC (WERF 2015b).

**Bioprocess intelligent optimization system** The bioprocess intelligent optimization system (BIOS) is a comprehensive feed-forward optimization that performs simulation calculations based upon online measurements of temperature, ammonia, nitrate, and influent wastewater flow rate, integrating these process measurements with laboratory analytical results for mixed liquor suspended solids (MLSS) as inputs to the algorithm (Fig. 4). The BIOS simulation provides a continuous output of the DO set points for the biological treatment process based on the load entering the bioreactor (Olsson 2012). The BIOS control

has the potential to minimize aeration energy consumption (Ho et al. 2014). Table 5 summarises various aeration control strategies which help reduce the energy consumption in WWTPs.


### 3.2 Energy savings via technological upgrades and processes (new pathways of nitrogen removal)

Transforming ammonia to nitrogen gas is an energy consuming process primarily because of high oxygen demand for nitrification. The alternative deammonification (termed also partial nitrification/anammox) process can achieve lower energy consumption. Partial nitrification/anammox is among the most innovative developments in WWTPs in terms of energy saving. The process can be compared with the conventional nitrogen removal in Fig. 5 (Soliman and Eldyasti 2016).

#### 3.2.1 Nitrite shunt


The conventional biological nitrogen removal processes, such as nitrification–denitrification, require high amounts of oxygen (nitrification) and organic carbon (denitrification). To overcome the challenges and reduce the energy required for nitrogen removal, shortcut biological nitrogen removal (SBNR), called nitrite shunt, has been developed. In this process, the ammonia oxidation step stops at the nitrite stage,

**Fig. 4** BIOS system scheme (Biochemtech 2018)

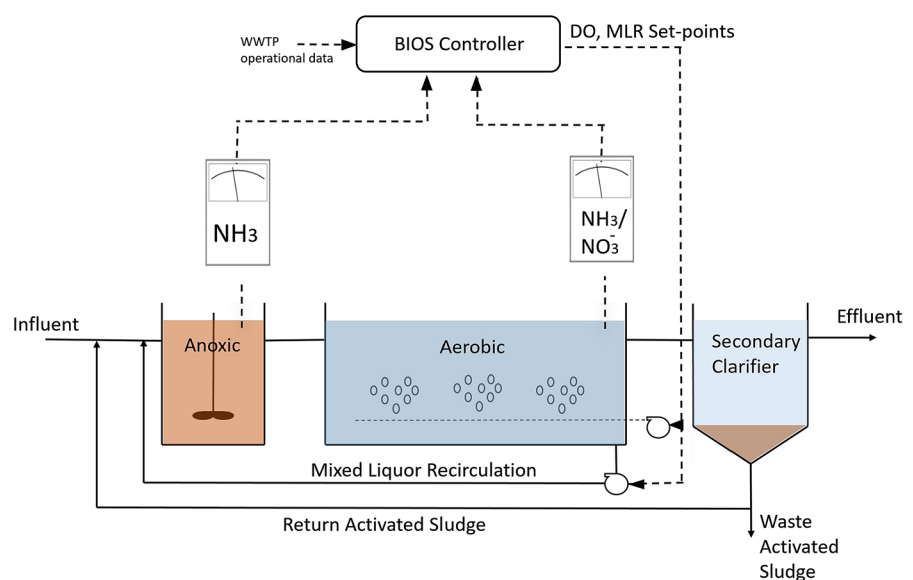

**Table 5** Summary of different aeration control strategies

Control approach	Benefits and sample applications	References
Air distribution control by a set value of DO	Possible energy savings 20–40% in comparison with manually controlled systems	Åmand et al. (2013)
Intermittent aeration (cycle length controlled by DO)	Energy savings 10–15% in comparison with a conventional MLE system, improved TN/TP removal efficiency (pilot scale)	Liu and Wang (2017) and Sanchez et al. (2018)
ABAC	Feed-back or feed-forward aeration optimization based on $\text{NH}_4\text{-N}$ concentration on-line measurements (in the bioreactor outlet and inlet, respectively), reduced aeration costs and peaks in the effluent $\text{NH}_4\text{-N}$ concentration	Rieger et al. (2014) and Sadowski (2015)
AVN	$\text{NH}_4\text{-N}/\text{NO}_x\text{-N}$ control in the bioreactor effluent	Regmi et al. (2014) and Sadowski (2015)
BIOS	Feed-forward aeration optimization based on on-line measurements of the influent temperature, flowrate, $\text{NH}_4\text{-N}$ , $\text{NO}_3\text{-N}$ , and MLSS	Olsson (2012) and Ho et al. (2014)

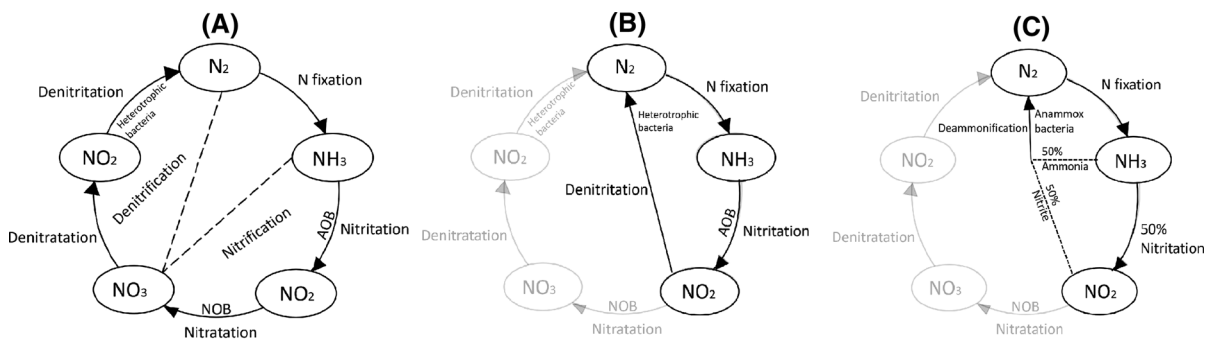

**Fig. 5** Comparison between **a** conventional nitrogen removal, **b** nitrite shunt and **c** deammonification in the nitrogen cycle (based on Soliman and Eldyasti 2016)

which is known as partial nitrification, then nitrite is reduced to nitrogen gas. Based on the fact that nitrite is an intermediate compound in both nitrification and denitrification, SBNR relies on the direct conversion of nitrite produced in the first step of nitrification to nitrogen gas instead of oxidizing nitrite to nitrate (Soliman and Eldyasti 2016). The nitrite shunt processes are operated to shunt the formation of nitrate by out-selecting nitrite oxidizing bacteria (NOB) (Miller et al. 2015). Several effective strategies for NOB suppression have been proposed, including especially tightly controlled operational DO concentrations, but also residual ammonia, transient anoxia, and controlled COD input, and short aerobic SRT (Gao et al. 2014; Cao et al. 2017; Feng et al. 2017).

SBNR implies the reduction of oxygen consumption during the aerobic phase by 25% as a result of skipping oxidation of nitrite to nitrate and consequently reduces the total energy required by 60%.

Additionally, SBNR eliminates the use of electron donor (organic carbon) by 40%; resulting from skipping reduction of nitrate to nitrite; which makes it suitable for wastewater with low carbon to nitrogen ratio (such as sludge digester liquors). SBNR also results in a significant decrease in the sludge production in the nitrification denitrification processes by 35% and 55%, respectively. Coupled with nitrite-shunt and anammox it may be possible to approach energy neutral operation while meeting stringent nitrogen limits (Miller et al. 2015).

### 3.2.2 Anammox and deammonification

Ammonia-rich wastewater can be treated with the very economic autotrophic deammonification process, which requires no organic carbon source and less than half of the aeration energy compared to the conventional nitrification–denitrification (Siegrist et al. 2008). If organic carbon rich constituents are

redirected to digester for biogas production, then insufficient organic carbon is remaining to remove nitrogen via conventional nitrification/denitrification, therefore partial nitritation/anammox process is encouraged for nitrogen removal (Seuntjens et al. 2018).

Anaerobic ammonium oxidation (anammox) is an autotrophic process for ammonium removal which was discovered in the mid-1990s and has widely been studied since then for its potential engineering application (Lackner et al. 2014). The anammox process requires less energy but anammox bacteria grow very slow (Kartal et al. 2010). The maximum growth rates of anammox bacteria (at 20 °C) were reported in the range of 0.019–0.08 and 0.13–0.14/day, respectively, for slow growing and fast growing species (Lu et al. 2018). For comparison, nitrifying bacteria (both AOB and NOB) have the maximum growth rates significantly higher (even > 2/day) (Cao et al. 2017).

Deammonification is a two-step process and the first step is the conversion of half ammonium to nitrite. The second step is the anammox process in which the remaining ammonium is oxidized to nitrogen gas by the produced nitrite. Both processes are autotrophic and can be performed in one-step sequencing batch reactors (SBR) system (Jenkins and Wanner 2014). More than 50% of all partial nitritation/anammox (PN/A) installations are SBRs, 88% of all plants being operated as single-stage systems, and 75% for side-stream treatment of municipal wastewater (Lackner et al. 2014).

Deammonification by ammonia oxidizing bacteria combined with anammox (Fig. 5c) provides up to 70–90% nitrogen removal with 65% reduction in aeration energy and 100% reduction in supplemental carbon compared to traditional nitrification–denitrification (Fig. 5a) (Gude 2015b). Jonasson (2007) reported that the total energy consumption of the Strass WWTP (Austria) was reduced by 12% after switching the previous nitrification/denitrification process with deammonification. The other benefit was that deammonification process did not require excess carbon which in the previous conventional denitrification led to higher volumes of excess sludge. Moreover, due to the enhanced recovery of readily digestible primary sludge, the methane content in biogas increased from 59 to 62%. Kartal et al. (2010) compared conventional wastewater treatment and optimized treatment with anammox in a full-scale

mainstream line based on energy consumption and production. By applying anammox in the mainstream line, the overall energy consumption was 17 kWh/PE.year while in the conventional treatment 30 kWh/PE.year was consumed (44% reduction in energy consumption by using the anammox technology). The optimized treatment with anammox also increased electric energy production from biogas by 12 kWh/PE.year (from 14 to 26 kWh/PE.year) which made the plant net energy positive (+9 kWh/PE.year).

## 4 Methods for increasing energy recovery

There are several types of technologies to recover energy throughout WWTPs. The recovered energy can be classified under three categories, including chemical, thermal and hydro energy.

### 4.1 Recovery of chemical energy

The calorific energy of wastewater is the energy content stored mainly in the various organic chemicals. In experimental studies, the energy content in untreated wastewater was estimated as 10–15 MJ/kg COD (~ 2.8–4.2 kWh/kg COD) (Shizas and Bagley 2004; Heidrich et al. 2011) and as low as  $5.9 \pm 3.4$  MJ/kg COD (~  $1.6 \pm 0.9$  kWh/kg COD) (Korth et al. 2017) for the oven-dried samples. Based on the assumption of 12–15 MJ/kg COD, Tchobanoglous (2009) estimated the average calorific energy of about 1.5 kWh/m<sup>3</sup> for wastewater with COD in the range of 250 mg COD/L to more than 1000 mg COD/L (which is common for domestic wastewater). Chemical energy from organic matter is converted into biomass energy during biochemical treatment (Zylstra and Kukor 2005). The recovery of chemical energy involves transformation of wastewater constituents into gaseous, liquid or solid fuels.

#### 4.1.1 Anaerobic digestion

Biogas generated from sewage sludges in the mesophilic AD process is composed primarily of methane (60–67%) and carbon dioxide (30–40%), with small concentrations of nitrogen, hydrogen sulfide, and other constituents. The methane portion of the biogas is a valuable fuel and, with conditioning, can replace natural gas for many energy needs (Moss et al. 2013;

Tyagi and Lo 2013; Bachmann 2015). By stoichiometry, the COD equivalent of methane can be determined as  $0.35 \text{ m}^3 \text{ CH}_4/\text{kg COD}$  at standard conditions ( $0 \text{ }^\circ\text{C}$ ), while the theoretical conversion factor at  $35 \text{ }^\circ\text{C}$  is  $0.4 \text{ m}^3 \text{ CH}_4/\text{kg COD}$ .

AD is more common in plants larger than  $22,000 \text{ m}^3/\text{day}$  (Qi 2013) since in larger WWTPs it is more beneficial for plants operators to consider AD unit due to larger amounts of available sludge for digestion. Although AD is a mature technology (Moss et al. 2013; Gao et al. 2014) financial incentives in many European countries have led to a surge in AD installations to produce heat and electricity from biogas. Whiting and Azapagic (2014) studied the life cycle environmental impacts of a system producing biogas from agricultural wastes by AD and co-generating heat and electricity in a CHP plant. The results suggested that this can lead to significant reductions in most impacts compared to fossil-fuel alternatives, including the GWP which can be reduced by up to 50%.

An upgraded version of conventional AD is an anaerobic membrane bioreactor (AnMBR). In this technology, the reactor volume is considerably smaller which reduces the land footprint of conventional AD (Gao et al. 2014). Kanai et al. (2010) reported 65–80% reduction of the volume by using AnMBR bioreactor. Data given in the literature indicate that the available

electrical energy produced in AnMBR systems ranges from  $0.15$  to  $0.3 \text{ kWh/m}^3$  as the wastewater strength increases from  $240$  to  $1140 \text{ mgCOD/L}$  (Martin et al. 2011). This amount is sufficient to recover a significant proportion of total energy consumption, and even offset the energy demand in some cases.

Table 6 shows the amount of biogas production (expressed in energy units) in various countries depending on the type of energy production as well as the share of WWTPs (sewage sludge) in the total net biogas production. On a country scale, a share of biogas production only from sewage sludge ranges from 7 to 49%, indicating that other biogas sources dominate in the overall balance. In Europe, Germany is a leading biogas producer ( $3050 \text{ GWh/year}$  in WWTPs).

Biogas production through AD is limited to a conversion of the readily biodegradable portion of the solids contained in the sewage sludge. To overcome this limitation, and thus maximize biogas production, pretreatment processes and co-digestion have become rapidly growing practices in recent years (Moss et al. 2013).

#### 4.1.2 Biogas utilization

The heating value of methane is approximately  $10 \text{ kWh/m}^3$  (at  $25 \text{ }^\circ\text{C}$ ). If the methane content of the

**Table 6** Biogas production in various countries (Bachmann 2015)

Type of energy utilized	Country	Total biogas production (including co-digestion of other wastes)	Biogas production only from sewage sludge in WWTPs	
			GWh/year	% of total production
Energy generated as gross gas production	Denmark	1280	250	21
	Norway	500	164	33
	South Korea	2578	969	38
	Sweden	1686	672	40
	Switzerland	1129	550	49
	Netherlands	3631	711	20
Energy generated as electricity, heat, fuel or flared	Finland	567	126	22
	Germany	41,550	3050	7
Electricity generation only	Austria	570	n.d.	n.d.
	Brazil	613	42	7
	France	1273	97	8
	United Kingdom	6637	761	11

biogas is assumed 65% by volume, consequently the heating value of the biogas produced in WWTPs can be estimated at 6.5 kWh/m<sup>3</sup>. The most readily adaptable approach to reduce external energy requirements with existing treatment plants is to make the full use of CH<sub>4</sub> produced from conventional AD through cogeneration in CHP systems (McCarty et al. 2011; Lee et al. 2017). The USEPA (Bastian et al. 2011) estimated that if 544 WWTPs in the US employing AD, adapted CHP, the energy reduction would be equivalent to removing the emissions of approximately 430,000 cars.

The CHP systems are a justified choice if heat consumers are located in the vicinity of the plant. However, this requirement cannot be met in most of the cases. As a result, the excess heat energy must be vented to the atmosphere, which lowers the overall energy production efficiency and requires additional electrical power. The biogas upgrading to the quality of natural gas avoids this energy loss. The upgraded biogas in the form of natural gas substitute can be injected into the existing natural gas grids or used as a vehicle fuel using the natural gas infrastructure. The upgraded biogas can be distributed with a low cost to consumers, who can utilize it with a higher efficiency (Makaruk et al. 2010).

Beil et al. (2009) reported that at the time there were about 80 biogas upgrading plants in operation in Europe. They delivered the power of 200 MW (heating value related) which corresponded roughly to 170 million standard m<sup>3</sup> of natural gas substitute. The total capacity of the biogas processing plants still seems to be relatively small in comparison to CHP plants.

The market of the biogas upgrading technologies is still poorly developed. The majority of those

technologies derive from other gas separation technologies, mainly from the natural gas treatment (Makaruk et al. 2010). Furthermore, the membrane gas separation is a process that scales down very well. As reported by Baker and Lokhandwala (2008), the membrane gas separation is advantageous from the economic point of view if the gas volume flow is relatively low and the inlet CO<sub>2</sub> content is relatively high. These parameters fit very well to a typical biogas upgrading task (Beil et al. 2009), and the CO<sub>2</sub> content usually exceeds 30%. The gas permeation technology is a well-developed membrane separation process based on the sorption–diffusion mechanism using dense membranes (Cerveira et al. 2018). If the upgraded biogas is to be supplied to the gas grid under pressure, the gas permeation technology should gain advantage over upgrading technologies that operate at the atmospheric pressure since it uses the compression for both upgrading and grid injection.

#### 4.1.3 Chemically enhanced primary treatment (CEPT)

Primary sludge from wastewater treatment is rich in organic compounds that can be resource for energy recovery (Lin et al. 2018). Chemically enhanced primary treatment (CEPT) enhances the primary settling and allows faster coagulation of particles in wastewater. This helps the formed larger conglomerates settle faster and make the removal process more efficient (Grigg 2005). Primary sludge tanks removal efficiencies vary in the range of 40–60 and 25–40% for TSS and COD, respectively. By adding chemicals these efficiencies can be enhanced to about 80–90% for TSS and from 50 to 70% for COD removal

**Table 7** Comparison of removal rates and sludge production

Treatment type	TSS removed (%)	COD removed (%)	P removed (%)	Total sludge production	Remarks
Primary	60	35	20	×	Olive (2002)
Primary +Biological	85	85	30	1.90×	Olive (2002)
CEPT	80	57	85	1.45×	Langworthy (2008)
CEPT using ferric (III) sulfate and anionic flocculent	79	56	47	–	Zaborowska et al. (2017)
CEPT using fresh alum	82.8	82.5	92.7	n.d.	Ayoub et al. (2017)
CEPT using recovered alum	84.5	85.5	95.8	n.d.	Ayoub et al. (2017)
MEPT	94.1	98.2	n.d.	0.6×	Clear Water Bay (2013)



(Jenkins and Wanner 2014). Table 7 provides the removal rates and sludge production for various treatment types with and without chemical usage. One of the advantages of CEPT is the primary clarifier can be designed in a smaller size (even up to 50%) while treating the same amount of wastewater which translates to capital cost savings (Bourke 2000). Another benefit is decreasing energy consumption for the subsequent organic removal by approximately 50% due to the reduction in aeration needs (McCarty et al. 2011). Furthermore, more COD can be directed to AD for increased biogas production (Gori et al. 2013; Remy et al. 2014; Kooijman et al. 2017).

Lin et al. (2017) developed a new  $\text{FeCl}_3$ -based CEPT for improved nutrient removal and energy recovery. By using CEPT, approximately 27% of the organic carbon in the influent wastewater could be recovered via sludge fermentation, mainly in the form of volatile fatty acids. For comparison, in the case of conventional primary sedimentation, the organic recovery ratio is under 10% (Lin et al. 2017).

A straightforward way to increase sludge production in WWTPs is CEPT with iron and aluminum coagulants but the overall energy recovery potential of CEPT may be unsatisfactory if the wastewater has a large fraction of dissolved organics. It should be noted, however, that some commonly used chemicals in CEPT have been reported to inhibit biogas production during AD (Meerburg et al. 2016). For example, aluminium inhibits the specific methanogenic activity (SMA) of methanogenic and acetogenic bacteria resulting in a 50–72% decrease in their activities (Cabirol et al. 2003). Al-based coagulants are characterized by rather low biodegradability due to the agglomeration of solid matters by the coagulant. Lin et al. (2018) studied on alkali pre-treatments by three chemicals, including  $\text{NaHCO}_3$ ,  $\text{Na}_2\text{CO}_3$  and  $\text{NaOH}$ . The chemicals were applied to disintegrate Al-based sludge sedimentation (Al-sludge). The alkali pre-treatment significantly reduced the Al-sludge particle size (25% by average) and the yield of volatile fatty acids (VFAs) of the Al-sludge pre-treated by  $\text{Na}_2\text{CO}_3$  was improved by 4 times compared to the un-treated sludge.

Ayoub et al. (2017) proposed utilization of the recovered alum from water treatment sludge as a coagulant and performed a comparative analysis with fresh alum. Table 7 shows the reported effects of CEPT treatment according to various methods found in different references in the literature. When

comparing the recovered alum and fresh alum as coagulants, although a slight difference is observed but recovered alum is significantly better than the fresh alum in terms of the environmental impact.

#### 4.1.4 Sludge pre-treatment

Degradation of the organic sludge fraction by the conventional AD is limited by the hydrolysis step. Degrees of volatile solids degradation higher than 50% are rarely achieved. This limitation results from the difficulty to access and degrade bacterial cells of the waste activated sludge (WAS) (Spinosa et al. 2011; Tyagi and Lo 2013; Ho et al. 2014). This deficiency can be overcome by applying the physical, chemical, thermal or mechanical pre-treatment step.

Pre-treatment processes break the bacterial cells and release the cell contents, making them available to the anaerobic bacteria for conversion to biogas. This increases the volatile solids reduction achieved in AD and consequently increases the biogas production by 20–50% depending on the technology used (Moss et al. 2013).

**Thermal hydrolysis process** Thermal hydrolysis involves injecting steam at high temperature and pressure to rupture bacterial cells and improve the conversion of organic matter to biogas in the AD process. It is considered as a well-established technology for sludge pre-treatment but simultaneously a very complex process which has not commonly been adopted in practice (Moss et al. 2013). Based on the thermal hydrolysis process (THP) experience in Europe, biogas production can possibly be increased by 20–30% (Moss et al. 2013).

Additionally, the THP decreases the sludge retention time (5–7 days less than in the conventional digestion) and reduces the final volume of dewatered sludge by 40% (Menco 2012). Dewaterability tests carried out after THP process showed an increase in the dewaterability reducing the water content to 50–60% (Wang et al. 2010).

The first full-scale application of THP in north America in DC Water's Blue Plains Advanced WWTP (1,400,000  $\text{m}^3/\text{day}$ ) showed the biogas from the digestion process downstream of thermal hydrolysis would produce 10 MW net energy, meeting nearly half of the total power demand of the plant (Willis et al. 2012).

The pre-treatment by high pressure thermal hydrolysis (HPTH) was shown to aid WAS fermentation. Compared to fermentation of raw WAS, the pre-treatment enabled 2–5 times increase in the VFA yield and 4–6 times increase in the VFA production rate (Morgan-Sagastume et al. 2011).

A key factor regarding thermal hydrolysis pre-treatment is minimizing of the energy requirement needed to reach the reaction temperature. Sludge composition highly influences the net energy (i.e. energy generated minus energy required for steam production). The ratio of primary sludge to WAS highly affects the energy benefit. For example, in the case of less than 10% primary sludge, the net energy was reported negative (Barber 2016). The energy balance improves with increasing quantities of biodegradable primary sludge. In general, depending on the factors, such as sludge composition and thermal hydrolysis reaction temperature, the net energy benefit of this technology over conventional AD was found modest. To achieve the highest net energy, actions such as: reducing thermal hydrolysis temperature and using the optimal proportion of sludge composition (30% primary sludge, 70% activated sludge) must be undertaken. The optimal net energy was reported by Barber (2016) as high as 160 kWh/tDS<sub>hydrolyssed</sub>.

**Chemical pre-treatment** Free nitrous acid (FNA) is a low cost and renewable chemical that can be produced on-site from the AD liquor by nitritation. Pre-treatment of full-scale WAS with FNA (1.8 mg N/L concentration) can enhance the biodegradability of WAS and increase the methane production by 16% (Wei et al. 2018). Similar to FNA, free ammonia (FA) pre-treatment also enhances the methane production from WAS. The highest improvement in biochemical methane potential (22%) was achieved at 420–680 mg N/L FA concentrations (Wei et al. 2017). To improve the biochemical methane potentials to higher rates, Liu et al. (2018) suggested combination of FA and heat pre-treatments (150 mg N/L of FA concentration and 70 °C temperature). As a consequence, the biochemical methane potential was improved by approximately 25%.

**Ultrasound and microwave disintegration** Ultrasound causes disintegration of the sludge floc structure and release of exoenzymes even with small energy inputs. This also creates more interfaces between the solid and liquid phase and therefore facilitates the

enzymatic attack of the active microorganisms (Jordan 2018). The use of ultrasound for wastewater treatment has been shown to be technically feasible by numerous reports in the literature over the years (Mahamuni and Adewuyi 2010). There are several full-scale installations of the technology in Europe (Moss et al. 2013). Two sonication tests in the US plants showed inconsistent results (8% vs. 50% increase in the biogas production) (Gary et al. 2007).

The possibility to couple ozonation with ultrasonic cavitation, can give many simultaneous advantages, since ozone is a powerful oxidizing agent (Tyagi and Lo 2011). Xu et al. (2010) reported that soluble COD was increased from 83 to 2483 mg/L after 60 min of ozone treatment followed by 60 min ultrasound treatment (energy input 0.26 W/mL), and the soluble COD concentration increased up to 3040 mg/L after 60 min ultrasound/ozone treatment.

Microwave irradiation is associated with electromagnetic radiation in the frequency range of 300 MHz–300 GHz. Due to high water content, sewage sludge absorbs the microwave irradiation. In principle, microwave is focused on directing heat rapidly, which lowers the energy losses while transmitting energy (traditional heating). A uniform microwave field generates energy through the realignment of dipoles with oscillating electric fields to generate heat both internally and at the surface of the treated material (Tyagi and Lo 2011).

Most of the research on disintegration methods of WAS is focused on technological effects of sludge pre-treatment. Therefore, Skorkowski et al. (2018) analyzed the specific effectiveness of ultrasound disintegration (g SCOD/Wh). The indicators of efficiency showed 4.08 mg O<sub>2</sub>/Wh for the energy density applied as high as 80 Wh/L, which is relatively low in comparison with other disintegration methods. Therefore, Skorkowski et al. (2018) suggested the hybrid sludge pre-treatments, such as pre-mixing and sonication combined to achieve higher energy efficiencies (5.83 times higher pre-treatment efficiency was reported).

**Hydrodynamic disintegration** The appearance of vapor cavities inside an initially homogeneous liquid medium, occurs in very different situations. Cavitation can be defined as the breakdown of a liquid medium under very low pressures (Dular et al. 2016). Extreme pressures and temperatures from cavitation collapses

to disintegrate smaller organic molecules, which are hard to be disintegrated using conventional biological methods (Suslick et al. 2011). Also new applications of hydrodynamic cavitation are beginning to emerge in other fields such as enhancing biogas production from WAS (Dular et al. 2016).

Żubrowska-Sudoł et al. (2017) showed that with the increase in energy consumed in disintegration, the increased amounts of organic compounds were released from the sludge. It was also documented that the introduction of WAS disintegration prior to the fermentation tank, resulted in 33.9% increase in the biogas production (Moss et al. 2013). The increased amount of biogas produced corresponded to the chemical energy in the amount of approximately 5200 kWh/day. Considering the average efficiency of the engine for converting chemical to electrical energy is about 40% then 2080 kWh/day of energy is produced. On the other hand, the energy consumed for disintegration in the studied WWTP was significantly lower (480 kWh/day). This rough estimation showed a positive net balance which makes this sludge pre-treatment a promising technology to be adopted in WWTPs.

#### 4.1.5 Bioelectrochemical systems


Bio-electrochemical systems (BESs), such as microbial fuel cells (MFCs) and microbial electrolysis cell (MECs) (Fig. 6), are generally regarded as a promising future technology for the production of energy

from organic material present in wastewater. BESs are aimed at bio-energy generation in the form of methane and bio-hydrogen while treating wastewater in an anodic chamber. The potential of BES to produce intermittent chemicals and high-value derivatives has immensely been explored since last decade by adopting modified reaction kinetics (Jadhav et al. 2017). The MFC is capable of converting the chemical energy of dissolved organic materials directly into electrical energy, while MEC is capable of generating a product (e.g. hydrogen) from dissolved organic materials and that drives the reactions with an electrical energy input.

Bioelectrochemical wastewater treatment is based on the use of electrochemically active microorganisms (Rabaey et al. 2007). In the MEC, electrochemically active bacteria oxidize organic matter and generate  $\text{CO}_2$ , electrons and protons. The bacteria transfer the electrons to the anode and the protons are released to the solution. The electrons then travel through a wire to the cathode and combine with the free protons in solution. MECs require relatively low energy input (0.2–0.8 V) compared to the typical water electrolysis (1.23–1.8 V) (Kadier et al. 2016). MFCs use an active microorganism as a biocatalyst in an anaerobic anode compartment for production of bioelectricity (Rahimnejad et al. 2015).

The current densities that can be generated with laboratory BES now approach levels that come close to the requirements for practical applications. Results of lab-scale experiments showed the removal rates as high as around 7 kg COD/m<sup>3</sup> reactor volume/day of

**Fig. 6** Schematic representation of BESs  
a MFC, b MEC

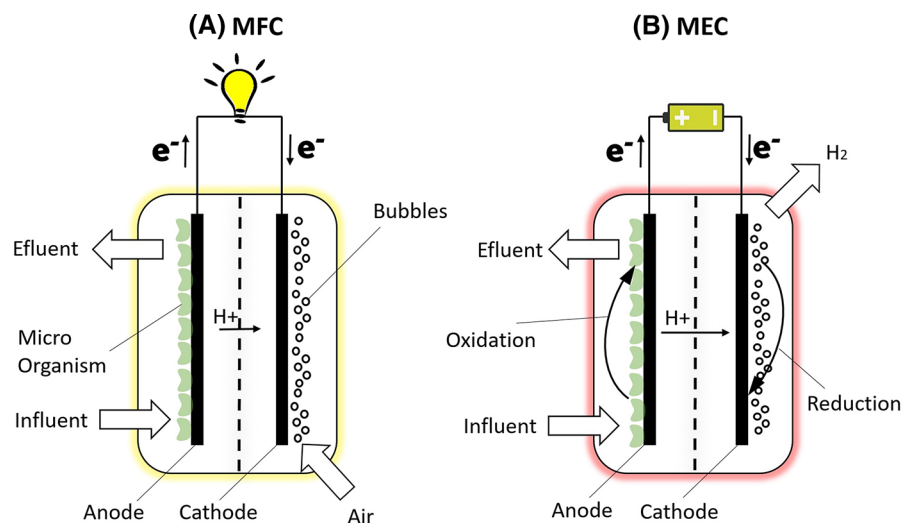


wastewater which is in the same range as conventional activated sludge systems (Rozendal et al. 2008). However, when it comes to working with industrial wastewater or natural environments, the implementation of BES is more challenging (Santoro et al. 2017). A further challenge is related to the low energy produced by MFCs (experimentally observed open circuit voltage is only around 0.7 – 0.8 V), which is currently orders of magnitude lower compared to chemical fuel cells (Wang et al. 2015).

Laboratory tests conducted for wastewater treatment by MEC through a broad range of mesophilic and psychrophilic temperatures (5–23 °C) using synthetic wastewater showed a COD removal efficiency of 90–97%. An electricity consumption of 0.6 kWh/kg of COD removed was observed. The low energy consumption coupled with enhanced methane production (at the same reactor in different phase of performance) led to a net positive energy balance in the bioelectrochemical treatment system which would be mostly suitable for small and remote communities due to reduced capital costs (Tartakovsky et al. 2017).

#### 4.1.6 Coupled aerobic-anoxic nitrous decomposition oxidation process

The direct energy recovery from waste nitrogen has recently proven feasible using the coupled aerobic-anoxic nitrous decomposition (CANDO) process (Scherson et al. 2013). The chemical energy of nitrogen compounds can be estimated to approximately 0.3 kWh/m<sup>3</sup> of wastewater (Horstmeyer et al. 2017). This energy can be recovered from nitrogenous oxygen demand (NOD) bound in reactive forms of nitrogen if the nitrogen can be removed from wastewater and processed to generate heat or electricity. Ammonia and nitrous oxide are two N species found in wastewater that meet these criteria (WERF 2011). The CANDO process consists of three steps: first, ammonium oxidation to nitrite; second is reduction of nitrite to N<sub>2</sub>O; and eventually, N<sub>2</sub>O conversion to N<sub>2</sub> with energy generation (Scherson et al. 2014; Gao et al. 2017). The CANDO process converts reactive N to N<sub>2</sub>O, then captures the gas and recovers energy from it by using it as a co-oxidant in CH<sub>4</sub> combustion or decomposing N<sub>2</sub>O over a metal oxide catalyst. The end product would be N<sub>2</sub>. The amount of released energy from 1 mol of ammonia in the

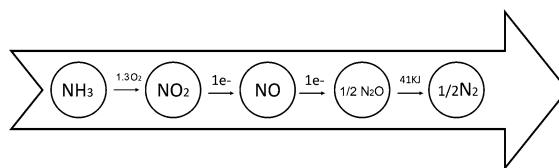

**Fig. 7** CANDO process scheme (Gao et al. 2014)

CANDO process is 41 kJ (2.4 kJ/g NH<sub>3</sub>) (Fig. 7) (Gao et al. 2014).

CANDO's first application in real wastewater feed streams was reported by Weißbach et al. (2018) to investigate the performance and dynamics of nitrogen removal and N<sub>2</sub>O production. A 93% conversion of ammonium to nitrite could be maintained for adapted seed sludge in the first step of nitrification (nitritation). The nitrous denitritation stage, inoculated with conventional activated sludge, achieved a conversion of 70% of nitrite to nitrous oxide.

#### 4.1.7 Micro algae system

Microalgae can grow in wastewater and can play the dual role of bioremediation of wastewater treatment and generation of biomass for biodiesel production (Kliggerman and Bouwer 2015; Raheem et al. 2018). One of the possibilities of obtaining renewable energy from microalgae is biogas production using AD (Sialve et al. 2009; Santos-Ballardo et al. 2016). Integrated approaches to wastewater treatment with algal cultivation systems are viable alternatives for sustainable energy recovery from wastewater (Gude 2015a).

Microalgae cultures offer a solution to tertiary and quaternary treatments due to their ability to use inorganic nitrogen and phosphorus for their growth; and capacity to remove heavy metals, and some toxic organic compounds (Abdel-Raouf et al. 2012). The integration of microalgae-based biofuel and by-product production during wastewater treatment has major advantages for both industries (Christenson and Sims 2011). Methane can be generated from digestion of either algal biomass or the algae residue that is a by-product of lipid extraction for biodiesel production (Zamalloa et al. 2011). It has even been suggested that methane production from microalgae without lipid extraction is energetically more favorable than a system whereby the lipids are extracted prior to digestion, if the algal lipid content is less than

40% (Sialve et al. 2009). The methane yield from digestion of algae is typically much lower than the theoretical potential. High pressure thermal hydrolysis (HPTH) is shown to enhance methane yield during algae digestion by approximately 80% (13 L CH<sub>4</sub>/g VS). (Keymer et al. 2013).

Algal biofuels are still not commercially viable at the current fossil fuel prices. However, a niche opportunity may exist where algae are grown as a by-product of high rate algal ponds (HRAPs) operated for wastewater treatment (Park et al. 2011). Results of the study of Arashiro et al. (2018) to assess the HRAPs where micro algae is valorised for energy recovery, showed the annual average of 0.54 kWh/m<sup>3</sup> of wastewater, electricity production from biogas cogeneration. Another way of energy recovery is the microalgae-MFC. It was reported that algae acted as an electron acceptor and were able to grow using CO<sub>2</sub> generated at the cathode (Raheem et al. 2018). An algae biofilm MFC was established by Yang et al. (2018) to facilitate the nutrient removal and bioenergy generation. It was proved that the algae biofilm MFC system was able to handle wastewater in the continuous flow trials and the total net energy of 0.094 kWh/m<sup>3</sup> of wastewater was obtained in the process.

Microalgae treatment has an advantage over the partial nitrification/anammox treatments with respect to aeration energy, but not with the land requirements. The results from a case study in Thailand showed 0.15 and 0.18 kWh/m<sup>3</sup> total specific energy consumption for microalgae and partial nitrification/anammox configurations respectively. Also, microalgae treatment is not applicable in climates with the limited light availability, low temperature and low irradiance in the winter period. However, microalgae treatment may still be applicable in regions with a tropical climate (Khiewwijit et al. 2018).

Methane production by the AD of seaweed is restricted by the slow degradation caused by the influence of the rigid algal cell wall. Zou et al. (2018) presented the novel method based on rumen fluid pre-treatment. Rumen fluid improved fermentation and degradation of the microalgae biomass. The biochemical methane potential tests were performed to investigate the biogas production increase. After the suggested pre-treatment the biochemical methane potential increased by more than 30% for various scenarios.

#### 4.2 Recovery of thermal energy

In WWTPs, thermal energy is controlled by the temperature of the influent wastewater. Heat can be recovered via various technologies (Moss et al. 2013). It can be harvested using a heat pump. For every 10 K temperature difference in wastewater, the thermal energy available would be 41.9 MJ/m<sup>3</sup> (Gude 2015b). Another research by Hao et al. (2015) claimed that water source heat pumps could supply a net electrical equivalency of 0.26 kWh when 1 m<sup>3</sup> of the effluent is cooled down by 1 K. The US Department of Energy (DOE) estimated that about 235 billion kWh of thermal energy in the form of waste hot water is discarded into sewer systems (Tomlinson 2005). Thermal energy from wastewater can provide heating and cooling to districts where there is enough demand for thermal energy. Compared with other traditional sources for heat pumps (e.g., groundwater, geothermal heat, or outdoor air), wastewater (grey water) exhibits a relatively high temperature because it originates from warm sources, such as dishwashers, showers, and industrial plants. The wastewater heat can be further used for applications such as low-temperature sludge drying (Chae and Kang 2013). The Austrian implementation of the European Directive 2012/27/EU on energy efficiency explicitly names heat recovery from wastewater as a measure to reduce final energy consumption and in few countries such as Switzerland and Germany, this energy source is already included in energy policy making (Neugebauer et al. 2015).

Wastewater heat recovery via heat exchangers and heat pumps constitutes an environmentally friendly, approved and economically competitive, but often underestimated technology. For instance, in Austria, this methodology might reduce up to 17% of the Austrian (GWP) of room heating (Culha et al. 2015). The main sewer in all larger towns supply sufficient waste water as source of energy, which can also be used by the retrofit of sewer heat exchangers as a heat source for large size heat pumps. The usage is especially economical, with more than 10,000 PE sized WWTPs. The sewer should have more than 0.8 meters in diameter and the heat users have to be located in the surrounding area. A maximum distance of 200 meters is given for small heat capacities, whereas the heat pump or the users can be located up to 2 km away from the sewer with higher capacities (OCHSNER 2012). One of the applications is reported



in Canada (Gude 2015b), the heat-pump system was applied in an energy centre integrated with a municipal wastewater pumping station. The heat-pump system provided 3.5 MW energy output which was higher than 2.7 MW as initially planned.

### 4.3 Recovery of hydro energy

Hydropower generation in wastewater infrastructure is relatively new, with the earliest examples in research and in practice dating back only a few decades (Power et al. 2014). In comparison with chemical energy, recovery of hydro energy in WWTPs is less established with less literature available on this topic.

The effluent flow rate and the head pressure are two essential parameters in designing a hydropower plant. In WWTPs, the flow rate is affected seasonally by several factors and there are substantial variations in the flow rate. For example, in the Kiheung Respia WWTP (Korea), a low-head small hydro power plant at the discharge outfall generated a very small amount of energy (a contribution of < 1% to the energy demand of WWTPs). Nevertheless, the incorporation of a hydro power plant in WWTPs could still be attractive because it can be operated all year round (Chae and Kang 2013). A study done in the UK by Power et al. (2014) showed the potential for improvements in the sustainability of the sector through energy recovery using hydropower turbines at the outlets of WWTPs. Flow rates and head data in outlets were collected from over 100 plants in Ireland and the UK. An evaluation method was developed to determine the potential power outputs and payback periods of hydropower energy recovery schemes at the plants. The Kaplan turbine was found to have the greatest potential power output but the pump-as-turbine had the lowest cost per kilowatt. The electricity pricing was found to have the major impact on the economic viability of hydropower energy recovery (Power et al. 2014). Hydraulic energy recovery from effluent drops was undertaken at The Vienna WWTP, Austria. The treated wastewater is discharged in the amounts of 560,000 m<sup>3</sup>/day into Danube River with the elevation drop to Danube River from the plant outfall of 5 m. The electricity requirements for the plant operation were 480 kWh/year. The vertical axis turbine produced 1.5 Million kWh/year, used on site (2.6% of the WWTP demand) (Gude 2015b). In the case of Clark County WWTP, which treats about 680,000 m<sup>3</sup>/day,

approximately 120 m effluent drop is available but the discharge point is 22 km far away. A 16 MW hydroelectric generating station produced over 85 Million kWh/year. The required pumping energy was approximately 4 Million kWh, and the remaining energy was supplied to a grid in the vicinity of the discharge point. The net present value (NPV) of this system was \$0.06/kWh (Karafa et al. 2007).

Potential barriers for hydropower generation at the inlets and outlets of WWTPs include a lack of excess head, flow rate variations, turbine failure due to blockages or damage from particulates present in wastewater particularly in raw sewage at the plant inlets (McNabola et al. 2014). Gaius-obaseki (2010) suggested that it would not be economically viable to install a hydropower turbine unless the plant had a high flow rate or qualify for governmental incentives.

## 5 External sources of renewable energy

### 5.1 Solar energy

Photovoltaic (PV) panels provided only 0.1% of the total global electricity generation in 2010, however, it is projected to provide 5% of the global electricity consumption in 2030, rising to 11% in 2050. It was projected that by PV panels application, 2.3 Gigatonnes of CO<sub>2</sub> emissions will be avoided (Frankl and Nowak 2010).

Simulation results showed that a 96 kW PV system in the rooftop spaces could yield up to 150.7 MWh of electrical energy in a WWTP in south Korea. To maximize the energy production, the PV array needed to face the equator where the azimuth angle was 0. A hybrid type of PV system installed in the pre-existing building could produce 2% of the total energy demand. The economic analysis revealed that the tested technology was viable, with a payback time less than 7.4 years (Chae and Kang 2013). In another theoretical study, Xu et al. (2017) found that almost 80% of electricity consumption of a WWTP located in China could be produced only by PV using monocrystalline cells. If the WWTP adopted PV of nearly 9000 m<sup>2</sup>, it would be possible to supply most of the energy demand although the cost and land footprint should not be ignored. A report by Harper (2017) described a novel application of solar farm on the surface of an overflow pond at the East Lismore

WWTP (Australia). This solar farm can produce 180,000 kWh of electricity per year which covers 12% of the total energy consumption of the plant. The main benefit of this project is the reduced land footprint. Furthermore, the cooling properties of water help increase the performance of the PV panels. The shade over the pond also prevents unwanted algal growth.

Another application of the solar energy in WWTPs comprises drying the sludge. The average electrical energy intensity in WWTPs in India is much lower (0.14 kWh/m<sup>3</sup>) in comparison with the UK (0.46 kWh/m<sup>3</sup>), due to solar heat is used in India for sludge drying (Singh et al. 2016). Another report by Colas (2017) explained a pilot system consisting of two parabolic solar concentrators used for sludge drying in Arizona (US). The collectors were able to generate heat power of 98 kW and dry sludge up to 90–97% solid content. That system is capable of producing 2 tons of sludge per day.

## 5.2 Organic waste co-digestion

The perspective of turning organic wastes into biogas has certainly increased the interest around this technology and required several studies aimed at developing methods that could improve both performance and efficiency of this process (Esposito et al. 2012). Due to the increased biogas yields, co-digestion of bio-wastes together with municipal wastewater can considerably reduce electricity purchase by WWTPs. Some successful examples from WWTPs have been reported in Denmark, Germany and Switzerland (Braun and Wellinger 2009). The examples are shown in Table 6.

In the US, food waste is the second largest category of municipal solid waste sent to landfills (over 30 million tons of food waste per year). With regard to energy independence, capturing the energy from food waste has become more important (Ho et al. 2014). The process of co-digestion can be performed by adding small amount of co-substrates which will not affect significantly the designed hydraulic retention time (HRT) (Maragkaki et al. 2018). The typical co-substrate addition rates in sludge digesters are between 5 and 20%. Addition of flotation sludge, fat trap-contents, food leftovers, proteinacious wastes etc. increases the biogas productivity considerably (i.e. by 40–200%). Nevertheless, if co-digestion is to be

implemented into the existing WWTPs, depending on the bio-waste concentration and rheology, additional pre-treatment and post-treatment equipment may be required (Braun and Wellinger 2009). Koch et al. (2015) recommended co-digestion of raw sludge with food waste up to a ratio of 35% (based on the content of volatile solids). Co-digestion can result in both higher methane yield (due to a higher methane yield of food waste compared to raw sewage sludge), and in a higher methane production rate.

Recently, Mattioli et al. (2017) analyzed the effect of co-digestion of municipal solid waste and mixed sludge in Rovereto WWTP (Italy) (95,000 PE). It was shown that by treating 10,000 kg/day of organic waste, biogas generation increased from 1321 to 2723 m<sup>3</sup>/day which consequently doubled the power generation (from 3.9 to 7.8 MWh/day) and resulted in 85% recovery of the WWTP total energy demand. Food waste is more readily biodegradable than municipal wastewater solids (Gray and Suto 2008). Consequently, AD of food waste can be achieved at a shorter HRT (i.e. 5 or 10 days) in comparison with sewage sludge (min. 20 days in). In other words, the feed rate of food waste to ADs can be 2–3 times higher in comparison with sewage sludge. More importantly, food waste has higher specific energy content than sewage sludge. Food waste digestion results in a nearly 3 times higher biogas production rate in comparison with sludge digestion. Table 8 shows approximate organic waste biogas production yields. The results of about 175 biochemical methane potential assays indicate that substrates rich in lipids yield the highest methane potential (Labatut et al. 2011) followed by carbohydrates and proteins. On the other hand, high protein contents in co-digestion substrates may increase sulfure content in biogas and lead to engine corrosion. A potential contribution of adding food waste for self-sufficiency of WWTPs was investigated by Koch et al. (2016). The biogas production doubled with the addition of only 1000 m<sup>3</sup> of food waste, while the amount of thickened raw sludge treated remained roughly the same at the level of 9000 m<sup>3</sup>. A comparison of 176 German WWTPs revealed that 44% of them achieved energy neutrality with a strong correlation to the fact that co-substrates were used.

Whiting and Azapagic (2014) studied the life cycle environmental impacts of a system producing biogas from agricultural wastes by AD and co-generating

**Table 8** Biogas yield of different co-digestive materials (Braun and Wellinger 2009; Weiland 2010)

Material	Approximate biogas yield (m <sup>3</sup> /ton organic solids)
Proteinacious wastes, bacterial cells and fungal mycelium	1000–1300
Plant oil, oil seed, fat, bleaching earth	1000
Sludge from gelatin and starch production	700–900
Wheat grain	700–750
Flotation sludge, animal fat, stomach and gut content, blood	550–1000
Maize	560–650
Residues from animal feed production, expired feed	500–650
Market waste	500–600
Waste from pulp and paper industry	400–800
Yeast- and sludge from breweries, wine making, distilleries	400–800
Food industry waste dough, confectionary waste, whey	400–600
Bio-waste from source separated collection	400–500
Straw, stems, sugar beet toppings, fibrous material	375
Animal manures	200–500
Waste activated sludge	250–350

heat and electricity in a CHP plant. The results suggested that this can lead to significant reductions in most impacts compared to fossil-fuel alternatives, including the GWP which can be reduced by up to 50%.

Application of solar energy and organic waste co-digestion revealed the possibility of on-site electricity production, which in some WWTPs might cover partial or even all the energy consumption. In this review, according to the definition of energy neutral WWTPs provided in sub-chapter 2.1, renewable energy converted on-site and co-digestion help become independent from the external grid. However, an impact of these actions on the carbon footprint cannot be neglected.

## 6 Examples of case studies and projects on energy neutral/positive WWTPs

Currently, only a small subset of wastewater treatment facilities is operating in a manner that allows them to be considered totally or nearly energy neutral (Horne et al. 2013). Case studies which applied modifications to improve the energy balance are presented in Table 9.

### 6.1 Case studies on energy neutrality of WWTPs

Wang et al. (2016) compared the electricity intensity and associated carbon emissions of WWTPs in four countries, including the US, Germany, China, and South Africa. It was emphasized that 100% energy self-sufficient WWTPs are feasible by a combination of increased energy efficiency and energy harvesting from the wastewater. Using these measures, few WWTPs operated in the US and Germany have already achieved almost 100% (or higher) electricity self-sufficiency.

In Austria, two advanced municipal BNR WWTPs are energy self-sufficient. At those plants, the total consumption of electric energy is smaller than the energy production by CHP generation using biogas from anaerobic sludge digestion. By additional measures, such as co-digestion of organic waste, the use of thermal energy of wastewater for space heating, as well as wastewater and waste options using alternative processes, municipal WWTPs can even become “energy positive” (Nowak et al. 2015). Table 9 shows the case studies on energy neutrality of WWTPs. The specific energy consumption represents a state before and after potential or executed implementation of upgrades, respectively. In some case studies, such as the one from (WERF 2015a) report, the percentage of the electricity consumption produced on site is much higher than the reported percentage of energy



**Table 9** Case studies on improving the energy balance in WWTPs

WWTP	Basic information	Total specific energy consumption		Energy efficiency remarks	Key actions towards energy neutrality	References
		Before	After			
Bochum-Ölbachtal (Germany)	213,000 PE WWTP, three stage step feed process with pre-denitrification process	23 kWh/PE	12 kWh/PE	97% energy neutral	Optimizing mixing process, reducing RAS pumping energy consumption	Mamer et al. (2016)
Stuttgart-Mühlhausen (Germany)	1,200,000 P.E Modernized WWTP, 2 groups of tanks southern part includes 9 aeration tanks and 5 secondary clarifier, northern part consists 10 aeration tanks and 7 secondary clarifiers	58.5 MWh/day	43 MWh/day	26% reduction in energy consumption	Changeover to air distribution control system (ADC)	Zettl (2015)
Slupsk (Poland)	200,000 PE Biological Nutrient Removal (BNR), with Bardenpho process configuration	16 kWh/PE	13 kWh/PE	73% energy neutral (potentially energy positive after upgrading)	CEPT and deammonification in the side stream treatment line proposed, CHP engines	Zaborowska et al. (2017)
Changi (Singapore)	800,000 m <sup>3</sup> /day, 4 identical activated sludge process treatment trains with COD and nitrogen removal, 5 ADs		0.89 kWh/m <sup>3</sup> (0.43 kWh/m <sup>3</sup> is non-process related)	17% energy neutral	Aeration energy consumption is 0.13 kWh/m <sup>3</sup> which is relatively low due to on-line DO control sensors and high efficiency of blowers	Yeshi (2015)
Valley Creek (US)	386,000 m <sup>3</sup> /day, 2 stage aeration basins with AD	24.500 MWh/year	18,500 MWh/year	24% reduction in energy consumption	Split the primary effluent 50% to the first stage aeration basin and 50% to second, improve AD mixing, stop use of side stream treatment	Horne et al. (2013)
Strass (Austria)	90,000–200,000 PE depending on the season, 2 stages activated sludge process		0.32 kWh/m <sup>3</sup>	109% energy neutral	CHP arrangement with 38% efficiency, implementation of deammonification reduced 12% and does not require supplementary carbon, upgrading equipment, large efforts performed on RAS pumping systems	Jonasson (2007)
Philadelphia (US)	950,000 m <sup>3</sup> /day modern water, wastewater department with biosolids recycling centre	139.7 MWh/day electricity purchased	5.3 MWh/day electricity purchased	54% energy neutral	After increase in energy prices they decided to increase electricity production (co-generation by CHP engines) from 50% to all 100% of produced biogas	WERF (2015a)
Los Angeles (US)	2,318,500 m <sup>3</sup> /day, the district contains 11 modern WRRFs	383.2 MWh/day electricity purchased	23 MWh/day electricity purchased	51% energy neutral	Performed a series of energy conservative measures in last decade including VFDs and new high-speed centrifuges	WERF (2015a)

Table 9 continued

WWTP	Basic information	Total specific energy consumption		Energy efficiency remarks	Key actions towards energy neutrality	References
		Before	After			
Melbourne, (Australia)	Two regional WWTPs, with 3 modernized lagoons for N-removal, 600,000 m <sup>3</sup> /day capacity	203.3 MWh/day electricity purchased	48.7MWh/day electricity purchased	76% energy neutral	They built new power stations from biogas using a third party for electricity generation	WERF (2015a)
Kansas, (US)	Operating 7 WRRFs with biological nutrient removal system and biosolids production, 66,000 m <sup>3</sup> /day capacity	42 MWh/day electricity purchased	24.3 MWh/day electricity purchased	21% energy neutral	Used additional ADs and cogeneration units	WERF (2015a)
Turin Metropolitan Water Society (Italy)	2.7 million PE size, including primary, secondary and tertiary treatments (biological N removal and chemical P removal)		24.7 kWh/PE	42% energy neutral	Series of energy conservative measures performed, most saving achieved from sludge heating and dewatering by biogas as fuel for CHP engines	Panepinto et al. (2016)
Tabriz (Iran)	1.5 m <sup>3</sup> /s size, Domestic WWTP with COD removal system		0.3 kWh/m <sup>3</sup>	60% energy neutral	Matching aeration capacity with actual requirements	Nouri et al. (2006)

neutrality of the WWTP. This is due to heat consumption of the WWTPs which is provided externally. For example Philadelphia WWTP in the US is 54% energy neutral while 96% of their electricity consumption is produced on site (WERF 2015a).

## 6.2 On-going projects on energy neutral WWTPs

Ongoing projects brightens the innovative and recent paths in this research topic. Some innovative energy related projects in WWTPs are presented in Table 10.

A project called POWERSTEP uses concepts and technologies that have been tested in laboratories and pilot scale plants (Table 10). Another on-going project, called Enerwater and the objectives are to impulse dialogue towards the creation of a specific European legislation following the example of recently approved EU directives, to establish a way forward to achieve EU energy reductions objectives for 2020, ensuring effluent water quality, environmental protection and compliance with the Water Framework Directive (FWD) (Enerwater).

The R3water project aims to demonstrate new technologies and solutions for increased resource efficiency in existing WWTPs, including innovative monitoring, advanced control strategies and management measures. Furthermore, the project facilitates the market uptake for the demonstrated solutions for the European and global market by demonstrating solutions in different geographical context and reaching relevant stakeholders (R3water).

## 7 Conclusions

Several different steps may be taken to achieve the complete energy neutrality in WWTPs. The first major step would be reducing the current energy consumption of WWTPs which ranges between 0.25 to over 1 kWh/m<sup>3</sup>. The most promising reviewed operational measures to reduce the energy consumption comprised aeration control strategies since aeration holds the biggest share of the total energy consumption in WWTPs (in most cases > 50%). Novel control systems, such as AVN and ABAC, proved the possibility of significant reduction of energy for aeration reduction by keeping the blowers off more than 25% of the time while maintaining the same wastewater effluent standards. Furthermore, technological upgrades

**Table 10** Innovative on-going projects on energy neutrality in WWTPs

Project	Main objectives	Link
POWERSTEP (Full scale demonstration of energy positive sewage treatment plant concepts towards market penetration)	POWERSTEPS full-scale commercial references with a reliable assessment of process efficiencies under realistic conditions remain at stake. POWERSTEP aims to demonstrate their viability to ensure a successful market deployment of the new technology	<a href="http://www.powerstep.eu">www.powerstep.eu</a>
Enerwater	The main objective of ENERWATER project is to develop, validate and disseminate an innovative standard methodology for continuously assessing, labelling and improving the overall energy performance of WWTPs	<a href="http://www.enerwater.eu/">http://www.enerwater.eu/</a>
R3Water (reuse of water, recovery of valuables and resource efficiency in WWTPs)	The main objective of the project was to demonstrate solutions that support the transition from a WWTP to a production unit of different valuables. Demonstrate new technologies and solutions for increased resource efficiency in existing WWTP performance thanks to innovative monitoring, advanced control strategies and management measures. Demonstrate innovative wastewater technologies that enable reuse of water, recovery of valuables such as nutrients	<a href="http://r3water.eu/">http://r3water.eu/</a>
SMART-Plant (Scale-up of low-carbon footprint material Recovery Techniques)	The project will prove the feasibility of circular management of urban wastewater and environmental sustainability of the systems and co-benefits of scaling-up water solutions through LCA and LCC approaches	<a href="https://www.smart-plant.eu">https://www.smart-plant.eu</a>

including the new pathways of nitrogen removal were able to reduce the required aeration energy by more than 60%. The second step towards energy neutrality of WWTPs would be increasing the on-site energy production. The high amount of potential chemical energy in raw wastewater (approximately 1–4 kWh/kg COD) can be recovered most efficiently by applying AD and biomethane production coupled with CHP engines. Sludge pre-treatment methods would boost up the energy production by increasing the VFA yield (2–5 times higher). In most practical cases, the aforementioned steps would not yet be enough to achieve 100% energy neutrality. The remaining electricity demand could be recovered mainly by organic waste co-digestion and on-site renewable energy production. Application of organic waste co-digestion revealed the possibility of increasing the biogas production as high as 200%, although the negative carbon footprint of this action is argued. An option to increase the energy efficiency is to upgrade biogas to the form of natural gas substitute injected into the existing natural gas grids or used as a vehicle fuel using the natural gas infrastructure. So far, the market of the biogas upgrading technologies is still poorly developed. On the other hand, clean energies, such as

solar panels, are progressing but still the energy recovered by them is relatively low in comparison with the total energy demand of WWTPs. Bio-electrochemical systems (MFC, MEC) are generally regarded as a promising future technology for energy production from organic material present in wastewater. Reviewing successful WWTPs in terms of energy self-sufficiency proved the point that the existing inefficient WWTPs should take a series of actions reviewed in this paper. The priorities of the actions should be analysed separately for each case study depending on several parameters, such as the operational cost and the environmental impact. The advanced and complex analysis procedures, techniques and simulation tools (plant-wide models) can support decision-making to meet the paradigm of sustainable wastewater treatment. These tools have been developed and widely applied worldwide, however the lack of data, poor knowledge of newly developed processes, uncertainty in prediction GHG emissions and over parameterization are still a challenge.

**Acknowledgements** The authors acknowledge the support provided by InterPhD2 program funded by European union (Project No. POWR.03.02.00-IP.08-00-DOK/16).

**Open Access** This article is distributed under the terms of the Creative Commons Attribution 4.0 International License (<http://creativecommons.org/licenses/by/4.0/>), which permits unrestricted use, distribution, and reproduction in any medium, provided you give appropriate credit to the original author(s) and the source, provide a link to the Creative Commons license, and indicate if changes were made.

## References

- Abdel-Raouf N, Al-Homaidan AA, Ibraheem IBM (2012) Microalgae and wastewater treatment. *Saudi J Biol Sci* 19:257–275. <https://doi.org/10.1016/j.sjbs.2012.04.005>
- Aboobakar A, Cartmell E, Stephenson T et al (2013) Nitrous oxide emissions and dissolved oxygen profiling in a full-scale nitrifying activated sludge treatment plant. *Water Res* 47:524–535. <https://doi.org/10.1016/j.watres.2012.10.004>
- Ahonen T, Tamminen J, Viholainen J, Koponen J (2014) Energy efficiency optimizing speed control method for reservoir pumping applications. *Energy Eff* 8:117–128. <https://doi.org/10.1007/s12053-014-9282-6>
- Åmand L, Olsson G, Carlsson B (2013) Aeration control—a review. *Water Sci Technol* 67:2374–2398. <https://doi.org/10.2166/wst.2013.139>
- Arashiro LT, Montero N, Ferrer I et al (2018) Life cycle assessment of high rate algal ponds for wastewater treatment and resource recovery. *Sci Total Environ* 622–623:1118–1130. <https://doi.org/10.1016/J.SCITOTENV.2017.12.051>
- Arnell M, Rahmberg M, Oliveira F, Jeppsson U (2017) Multi-objective performance assessment of wastewater treatment plants combining plant-wide process models and life cycle assessment. *J Water Clim Change* 8:715–729. <https://doi.org/10.2166/wcc.2017.179>
- Aymerich I, Rieger L, Sobhani R et al (2015) The difference between energy consumption and energy cost: modelling energy tariff structures for water resource recovery facilities. *Water Res* 81:113–123. <https://doi.org/10.1016/j.watres.2015.04.033>
- Ayoub M, Afify H, Abdelfattah A (2017) Chemically enhanced primary treatment of sewage using the recovered alum from water treatment sludge in a model of hydraulic clariflocculator. *J Water Process Eng* 19:133–138. <https://doi.org/10.1016/J.JWPE.2017.07.014>
- Bachmann N (2015) Sustainable biogas production in municipal wastewater treatment plants. *IEA Bioenergy* 20:4–5
- Baker RW, Lokhandwala K (2008) Natural gas processing with membranes: an overview. *Ind Eng Chem Res* 47:2109–2121. <https://doi.org/10.1021/ie071083w>
- Bao Z, Sun S, Sun D (2016) Assessment of greenhouse gas emission from A/O and SBR wastewater treatment plants in Beijing, China. *Int Biodeterior Biodegrad* 108:108–114. <https://doi.org/10.1016/J.IBIOD.2015.11.028>
- Barber WPF (2016) Thermal hydrolysis for sewage treatment: a critical review. *Water Res* 104:53–71. <https://doi.org/10.1016/j.watres.2016.07.069>
- Barbu M, Vilanova R, Meneses M, Santin I (2017) Global evaluation of wastewater treatment plants control strategies including CO<sub>2</sub> emissions. *IFAC Pap OnLine* 50:12956–12961. <https://doi.org/10.1016/J.IFACOL.2017.08.1800>
- Bastian R, Cuttica J, Fillmore L et al (2011) Opportunities for combined heat and power at wastewater treatment facilities: market analysis and lessons from the field combined heat and power partnership. In: US EPA, CHP Partnersh. doi: 430R11018
- Beil M, Hoffstede U, Klaas U (2009) Biogasaufbereitung in Deutschland und Europa—ein Blick über den Tellerrand. *Energie, Wasser*
- Belloir C, Stanford C, Soares A (2015) Energy benchmarking in wastewater treatment plants: The importance of site operation and layout. *Environ Technol (United Kingdom)*. <https://doi.org/10.1080/09593330.2014.951403>
- Bertanza G, Canato M, Laera G (2018) Towards energy self-sufficiency and integral material recovery in waste water treatment plants: assessment of upgrading options. *J Clean Prod* 170:1206–1218. <https://doi.org/10.1016/j.jclepro.2017.09.228>
- Biochemtech (2018) No title. [http://www.biochemtech.com/\\_img/BIOSFig1.jpg](http://www.biochemtech.com/_img/BIOSFig1.jpg)
- Boncescu C, Robescu LD (2017) Experimental researches on aeration equipment used in biological wastewater treatment. In: 17th international multidisciplinary scientific geoconference SGEM 2017
- Bourke M (2000) Full scale study of chemically enhanced primary treatment in Riviera de Sao Lourenco, Brazil by full scale study of chemically enhanced primary treatment in Riviera de Sao Lourenco, Brazil. Master of Science, thesis, p 148
- Braun R, Wellinger A (2009) Potential of co-digestion. *Int Energy Agency (IEA) Bioeng* 4–14
- Burton F (1996) Water and wastewater industries: characteristics and energy management opportunities. Electric Power Research Institute, Los Altos
- Cabirol N, Barragán EJ, Durán A, Noyola A (2003) Effect of aluminium and sulphate on anaerobic digestion of sludge from wastewater enhanced primary treatment. *Water Sci Technol* 48:235–240
- Cantwell (2009) Running an energy-efficient wastewater utility, modifications that can improve your bottom line. Focus on Energy, SAIC/Energy Systems Group
- Cao Y, Van Loosdrecht MCM, Daigger GT (2017) Mainstream partial nitrification-anammox in municipal wastewater treatment: status, bottlenecks, and further studies. *Appl Microbial Biotechnol* 101:1365–1383. <https://doi.org/10.1007/s00253-016-8058-7>
- Castellet-Viciano L, Hernández-Chover V, Hernández-Sancho F (2018) Modelling the energy costs of the wastewater treatment process: the influence of the aging factor. *Sci Total Environ* 625:363–372. <https://doi.org/10.1016/j.scitotenv.2017.12.304>
- Cerveira GS, Borges CP, Kronemberger FA (2018) Gas permeation applied to biogas upgrading using cellulose acetate and polydimethylsiloxane membranes. *J Clean Prod*

- 187:830–838. <https://doi.org/10.1016/j.jclepro.2018.03.008>
- Chae KJ, Kang J (2013) Estimating the energy independence of a municipal wastewater treatment plant incorporating green energy resources. *Energy Convers Manag* 75:664–672. <https://doi.org/10.1016/j.enconman.2013.08.028>
- Chen S, Chen B (2016) Urban energy–water nexus: a network perspective. *Appl Energy* 184:905–914. <https://doi.org/10.1016/j.apenergy.2016.03.042>
- Christenson L, Sims R (2011) Production and harvesting of microalgae for wastewater treatment, biofuels, and bio-products. *Biotechnol Adv* 29:686–702. <https://doi.org/10.1016/j.biotechadv.2011.05.015>
- Colas H (2017) Drying sludge with concentrated solar power. Utility management, wastewater management, water and wastewater community. 20 Dec. <https://www.fluksaqua.com/en/drying-sludge-with-concentrated-solar-power/>
- Culha O, Gunerhan H, Biyik E et al (2015) Heat exchanger applications in wastewater source heat pumps for buildings: a key review. *Energy Build* 104:215–232. <https://doi.org/10.1016/j.enbuild.2015.07.013>
- Daelman MRJ, Van Voorthuizen EM, Van Dongen LGJM et al (2013) Methane and nitrous oxide emissions from municipal wastewater treatment—results from a long-term study. *Water Sci Technol* 67:2350–2355. <https://doi.org/10.2166/wst.2013.109>
- de Haas DW, Hartly K (2004) Greenhouse gas emission from BNR plants: do we have the right focus? In: Proceedings of EPA workshop: sewage management: risk assessment and triple bottom line, 5–7 Apr 2004, Cairns, Australia
- de Haas DW, Pepperell C, Foley J (2014) Perspectives on greenhouse gas emission estimates based on Australian wastewater treatment plant operating data. *Water Sci Technol* 69:451–463. <https://doi.org/10.2166/wst.2013.572>
- Dular M, Griessler-Bulc T, Gutierrez-Aguirre I et al (2016) Use of hydrodynamic cavitation in (waste)water treatment. *Ultrason Sonochem* 29:577–588. <https://doi.org/10.1016/j.ultsonch.2015.10.010>
- Eimco (2018). <http://www.eimcoinc.com/>
- Enerwater Home—waste water treatment plants project—Enerwater. <http://www.enerwater.eu/>. Accessed 7 Feb 2018
- EPA (2010) Evaluation of energy conservation measures for wastewater treatment facilities. EPA-832-R-10-005. <http://water.epa.gov/scitech/wastetech/upload/Evaluation-of-Energy-Conservation-Measures-for-Wastewater-Treatment-Facilities.pdf>. Accessed 7 Feb 2018
- Esposito G, Frunzo L, Giordano A et al (2012) Anaerobic co-digestion of organic wastes. *Rev Environ Sci Biotechnol* 11:325–341. <https://doi.org/10.1007/s11157-012-9277-8>
- Evangelisti S, Lettieri P, Borello D, Clift R (2014) Life cycle assessment of energy from waste via anaerobic digestion: a UK case study. *Waste Manag* 34:226–237. <https://doi.org/10.1016/j.wasman.2013.09.013>
- Feng Y, Lu X, Al-Hazmi H et al (2017) An overview of the strategies for the deammonification process start-up and recovery after accidental operational failures. *Rev Environ Sci Biotechnol* 16:541–568. <https://doi.org/10.1007/s11157-017-9441-2>
- Flores-Alsina X, Arnell M, Amerlinck Y et al (2014) Balancing effluent quality, economic cost and greenhouse gas emissions during the evaluation of (plant-wide) control/operational strategies in WWTPs. *Sci Total Environ* 466–467:616–624. <https://doi.org/10.1016/J.SCITOTENV.2013.07.046>
- Foladori P, Vaccari M, Vitali F (2015) Energy audit in small wastewater treatment plants: methodology, energy consumption indicators, and lessons learned. *Water Sci Technol* 72:1007–1015. <https://doi.org/10.2166/wst.2015.306>
- Frankl P, Nowak S (2010) Technology roadmap-solar photovoltaic energy. OECD/IEA
- Füreder K, Svardal K, Frey W et al (2017) Energy consumption of agitators in activated sludge tanks—actual state and optimization potential. *Water Sci Technol* 77:800–808. <https://doi.org/10.2166/wst.2017.596>
- Gaius-obaseki T (2010) Hydropower opportunities in the water industry. *Int J Environ Sci*. <https://doi.org/10.6088/ijessi.00103010011>
- Gans N, Mobini S, Zhang XN (2007) Appendix E. Mass and energy balances at the Gaobeidian wastewater treatment plant in Beijing, China, pp 203–209. <http://www.chemeng.lth.se/exjobb/E458.pdf>. Accessed 7 Feb 2018
- Gao H, Scherson YD, Wells GF (2014) Towards energy neutral wastewater treatment: methodology and state of the art. *Environ Sci Process Impacts* 16:1223–1246. <https://doi.org/10.1039/C4EM00069B>
- Gao H, Liu M, Griffin JS et al (2017) Complete nutrient removal coupled to nitrous oxide production as a bioenergy source by denitrifying polyphosphate-accumulating organisms. *Environ Sci Technol* 51:4531–4540. <https://doi.org/10.1021/acs.est.6b04896>
- Gary D, Morton R, Tang C-C, Horvath R (2007) The effect of the microsludge™ treatment process on anaerobic digestion performance. *Proc Water Environ Fed* 2007:1724–1738. <https://doi.org/10.2175/193864707788116455>
- Gori R, Giaccherini F, Jiang L-M et al (2013) Role of primary sedimentation on plant-wide energy recovery and carbon footprint. *Water Sci Technol* 68:870. <https://doi.org/10.2166/wst.2013.270>
- Gray D, Suto P (2008) Anaerobic digestion of food waste. *Bioresour Technol*. <https://doi.org/10.1016/j.biortech.2011.01.082>
- Grigg NS (2005) Water resources management. In: *Water encyclopedia*. John Wiley & Sons, Inc., Hoboken. <https://doi.org/10.1002/047147844x.wr241>
- Gu Y, Dong YN, Wang H et al (2016) Quantification of the water, energy and carbon footprints of wastewater treatment plants in China considering a water-energy nexus perspective. *Ecol Indic* 60:402–409. <https://doi.org/10.1016/j.ecolind.2015.07.012>
- Gu Y, Li Y, Li X et al (2017) The feasibility and challenges of energy self-sufficient wastewater treatment plants. *Appl Energy* 60:402–409. <https://doi.org/10.1016/j.apenergy.2017.02.069>
- Gude VG (2015a) Energy positive wastewater treatment and sludge management. *Edorium J Waste Manag* 1:10–15. <https://doi.org/10.5348/W01-2015-2-ED-2>

- Gude VG (2015b) Energy and water autarky of wastewater treatment and power generation systems. *Renew Sustain Energy Rev* 45:52–68. <https://doi.org/10.1016/J.RSER.2015.01.055>
- Guerrini A, Romano G, Indipendenza A (2017) Energy efficiency drivers in wastewater treatment plants: a double bootstrap DEA analysis. *Sustainability* 9:1126. <https://doi.org/10.3390/su9071126>
- Guerrini A, Romano G, Leardini C (2018) Economic of scale and density in the Italian water industry: a stochastic frontier approach. *Util Policy* 52:103–111. <https://doi.org/10.1016/j.jup.2018.04.003>
- Hao X, Liu R, Huang X (2015) Evaluation of the potential for operating carbon neutral WWTPs in China. *Water Res* 87:424–431. <https://doi.org/10.1016/J.WATRES.2015.05.050>
- Harper D (2017) Australia's first floating solar farm soon to be buoyant in Lismore. ABC North Coast, 16 Nov. <http://www.abc.net.au/news/2017-11-16/australias-first-floating-solar-farm-will-be-buoyant-in-lismore/9157878>
- Haslinger J, Krampe J, Lindtner S (2016) Operating costs and energy demand of wastewater treatment plants in Austria: benchmarking results of the last 10 years. *Water Sci Technol* 74:2620–2626. <https://doi.org/10.2166/wst.2016.390>
- Heidrich ES, Curtis TP, Dolfing J (2011) Determination of the internal chemical energy of wastewater. *Environ Sci Technol* 45:827–832. <https://doi.org/10.1021/es103058w>
- Henriques J, Catarino J (2017) Sustainable value—an energy efficiency indicator in wastewater treatment plants. *J Clean Prod* 142:323–330. <https://doi.org/10.1016/j.jclepro.2016.03.173>
- Hernández-Sancho F, Molinos-Senante M, Sala-Garrido R (2011) Energy efficiency in Spanish wastewater treatment plants: a non-radial DEA approach. *Sci Total Environ* 409:2693–2699. <https://doi.org/10.1016/j.scitotenv.2011.04.018>
- Higgins P (2016) Myths and realities: ammonium based aeration control in wastewater. *YSI*. <https://www.ysi.com/ysi-blog/water-blogged-blog/2014/03/myths-and-realities-ammonium-based-aeration-control-in-wastewater>. Accessed 12 Dec 2017
- Ho SW, Cheung KK, Fung WC (2014) Sustainable wastewater treatment—ways to achieve energy neutrality. *HKIE Trans Hong Kong Inst Eng* 21:240–252. <https://doi.org/10.1080/1023697X.2014.973171>
- Horstmeyer N, Weißbach M, Koch K, Drewes JE (2017) A novel concept to integrate energy recovery into potable water reuse treatment schemes. *J Water Reuse Desalin*. <https://doi.org/10.2166/wrd.2017.051>
- Husmann M (2009) Improving energy efficiency in waste water treatment: What emerging countries can learn from experience gained in the developed world. [http://siteresources.worldbank.org/EXTWAT/Resources/4602122-1213366294492/5106220-1234469721549/21.3\\_Energy\\_efficiency.pdf](http://siteresources.worldbank.org/EXTWAT/Resources/4602122-1213366294492/5106220-1234469721549/21.3_Energy_efficiency.pdf). Accessed 7 Feb 2018
- Jadhav DA, Ghosh Ray S, Ghangrekar MM (2017) Third generation in bio-electrochemical system research—a systematic review on mechanisms for recovery of valuable by-products from wastewater. *Renew Sustain Energy Rev* 76:1022–1031. <https://doi.org/10.1016/j.rser.2017.03.096>
- Jenkins D, Wanner J (2014) *Activated sludge-100 years and counting*, IWA Publishing
- Jiang S, Wang J, Zhao Y et al (2016) Residential water and energy nexus for conservation and management: a case study of Tianjin. *Int J Hydrogen Energy* 41:15919–15929. <https://doi.org/10.1016/J.IJHYDENE.2016.04.181>
- Jonasson M (2007) Energy benchmark for wastewater treatment processes - A comparison between Sweden and Austria. In: Department of Industrial electrical engineering and automation, Lund University, Sweden
- Jordan M (2018) Applications sludge treatment—ULTRA-WAVES. <http://www.ultrawaves.de/wastewater-treatment-plants/applications-sludge-treatment>. Accessed 13 Mar 2018
- Kadier A, Simayi Y, Abdeshahian P et al (2016) A comprehensive review of microbial electrolysis cells (MEC) reactor designs and configurations for sustainable hydrogen gas production. *Alex Eng J* 55:427–443. <https://doi.org/10.1016/J.AEJ.2015.10.008>
- Kanai M, Ferre V, Wakahara S et al (2010) A novel combination of methane fermentation and MBR—Kubota submerged Anaerobic membrane bioreactor process. *Desalination* 250:964–967. <https://doi.org/10.1016/J.DESAL.2009.09.082>
- Karafa D, Devlin J, Yankovich D, Froehlich D (2007) Effluent to energy and it is renewable. In: Proceedings of the water environment federation, WEFTEC. pp 4563–4577. <https://doi.org/10.2175/193864707787974427>
- Kartal B, Kuenen JG, Van Loosdrecht MCM (2010) Sewage treatment with anammox. *Science* 328:702–703
- Keymer P, Ruffell I, Pratt S, Lant P (2013) High pressure thermal hydrolysis as pre-treatment to increase the methane yield during anaerobic digestion of microalgae. *Bioresour Technol* 131:128–133. <https://doi.org/10.1016/j.biortech.2012.12.125>
- Khiewwijit R, Rijnaarts H, Temmink H, Keesman KJ (2018) Global assessment of integrated wastewater treatment and recovery concepts using partial nitrification/Anammox and microalgae for environmental impacts. *Sci Total Environ* 628–629:74–84. <https://doi.org/10.1016/J.SCITOTENV.2018.01.334>
- Klaus S (2016) Comparison of ABAC and AVN aeration strategies for efficient nitrogen removal. Proceedings of the 89th annual water environmental federation technical exhibition and conference. Chicago, Illinois, Sept. 26–30
- Kliggerman DC, Bouwer EJ (2015) Prospects for biodiesel production from algae-based wastewater treatment in Brazil: a review. *Renew Sustain Energy Rev* 52:1834–1846. <https://doi.org/10.1016/j.rser.2015.08.030>
- Koch K, Helmreich B, Drewes JE (2015) Co-digestion of food waste in municipal wastewater treatment plants: effect of different mixtures on methane yield and hydrolysis rate constant. *Appl Energy* 137:250–255. <https://doi.org/10.1016/J.APENERGY.2014.10.025>
- Koch K, Plabst M, Schmidt A et al (2016) Co-digestion of food waste in a municipal wastewater treatment plant: comparison of batch tests and full-scale experiences. *Waste Manag* 47:28–33. <https://doi.org/10.1016/J.WASMAN.2015.04.022>
- Kooijman G, De Kreuk MK, van Lier JB (2017) Influence of chemically enhanced primary treatment on anaerobic

- digestion and dewaterability of waste sludge. *Water Sci Technol* 76:1629–1639. <https://doi.org/10.2166/wst.2017.314>
- Korth B, Maskow T, Günther S, Harnisch F (2017) Estimating the energy content of wastewater using combustion calorimetry and different drying processes. *Front Energy Res* 5:23. <https://doi.org/10.3389/fenrg.2017.00023>
- Labatut RA, Angenent LT, Scott NR (2011) Biochemical methane potential and biodegradability of complex organic substrates. *Bioresour Technol* 102:2255–2264. <https://doi.org/10.1016/j.biortech.2010.10.035>
- Lackner S, Gilbert EM, Vlaeminck SE et al (2014) Full-scale partial nitrification/anammox experiences—an application survey. *Water Res* 55:292–303. <https://doi.org/10.1016/j.watres.2014.02.032>
- Langworthy AC (2008) 2008 Annual reports and summary point Loma wastewater treatment plant and ocean outfall. San Diego
- Lee S, Esfahani IJ, Ifaei P et al (2017) Thermo-environmental modeling and optimization of an integrated wastewater treatment plant with a combined heat and power generation system. *Energy Convers Manag* 142:385–401. <https://doi.org/10.1016/j.enconman.2017.03.060>
- Li W, Li L, Qiu G (2017) Energy consumption and economic cost of typical wastewater treatment systems in Shenzhen, China. *J Clean Prod* 163:S374–S378. <https://doi.org/10.1016/j.jclepro.2015.12.109>
- Lin L, Li R, Li Y et al (2017) Recovery of organic carbon and phosphorus from wastewater by Fe-enhanced primary sedimentation and sludge fermentation. *Process Biochem* 54:135–139. <https://doi.org/10.1016/J.PROCBIO.2016.12.016>
- Lin L, Li R, Li X (2018) Recovery of organic resources from sewage sludge of Al-enhanced primary sedimentation by alkali pretreatment and acidogenic fermentation. *J Clean Prod* 172:3334–3341. <https://doi.org/10.1016/J.JCLEPRO.2017.11.199>
- Lindtner S, Schaar H, Kroiss H (2008) Benchmarking of large municipal wastewater treatment plants treating over 100,000 PE in Austria. *Water Sci Technol* 57:1478–1493. <https://doi.org/10.2166/wst.2008.214>
- Liu G, Wang J (2017) Enhanced removal of total nitrogen and total phosphorus by applying intermittent aeration to the Modified Ludzack-Ettinger (MLE) process. *J Clean Prod* 166:163–171. <https://doi.org/10.1016/j.jclepro.2017.08.017>
- Liu X, Xu Q, Wang D et al (2018) Improved methane production from waste activated sludge by combining free ammonia with heat pretreatment: performance, mechanism and applications. *Bioresour Technol* 268:230–236. <https://doi.org/10.1016/j.biortech.2018.07.109>
- Longo S, d'Antoni BM, Bongards M et al (2016) Monitoring and diagnosis of energy consumption in wastewater treatment plants. A state of the art and proposals for improvement. *Appl Energy* 179:1251–1268. <https://doi.org/10.1016/j.apenergy.2016.07.043>
- Lorenzo-Toja Y, Vázquez-Rowe I, Chenel S et al (2015) Eco-efficiency analysis of Spanish WWTPs using the LCA + DEA method. *Water Res* 68:651–666. <https://doi.org/10.1016/j.watres.2014.10.040>
- Lorenzo-Toja Y, Alfonsin C, Amores MJ et al (2016) Beyond the conventional life cycle inventory in wastewater treatment plants. *Sci Total Environ* 553:71–82. <https://doi.org/10.1016/j.scitotenv.2016.02.073>
- Lu X, Pereira TDS, Al-Hazmi H et al (2018) Model-based evaluation of N<sub>2</sub>O production pathways in the anammox-enriched granular sludge cultivated in a sequencing batch reactor. *Environ Sci Technol* 52:2800–2809. <https://doi.org/10.1021/acs.est.7b05611>
- Mahamuni NN, Adewuyi YG (2010) Advanced oxidation processes (AOPs) involving ultrasound for waste water treatment: a review with emphasis on cost estimation. *Ultrasound Sonochem* 17:990–1003. <https://doi.org/10.1016/J.ULTSONCH.2009.09.005>
- Makaruk A, Miltner M, Harasek M (2010) Membrane biogas upgrading processes for the production of natural gas substitute. *Sep Purif Technol* 74:83–92. <https://doi.org/10.1016/j.seppur.2010.05.010>
- Mamais D, Noutsopoulos C, Dimopoulou A et al (2015) Wastewater treatment process impact on energy savings and greenhouse gas emissions. *Water Sci Technol* 71:303–308. <https://doi.org/10.2166/wst.2014.521>
- Mannina G, Cosenza A, Gori R et al (2016a) Greenhouse gas emissions from wastewater treatment plants on a plantwide scale: sensitivity and uncertainty analysis. *J Environ Eng* 142:04016017. [https://doi.org/10.1061/\(ASCE\)EE.1943-7870.0001082](https://doi.org/10.1061/(ASCE)EE.1943-7870.0001082)
- Mannina G, Ekama G, Caniani D et al (2016b) Greenhouse gases from wastewater treatment—a review of modelling tools. *Sci Total Environ* 551–552:254–270. <https://doi.org/10.1016/J.SCITOTENV.2016.01.163>
- Maragkaki AE, Fountoulakis M, Kyriakou A et al (2018) Boosting biogas production from sewage sludge by adding small amount of agro-industrial by-products and food waste residues. *Waste Manag* 71:605–611. <https://doi.org/10.1016/J.WASMAN.2017.04.024>
- Märner ST, Schröter D, Jardin N (2016) Towards energy neutrality by optimising the activated sludge process of the WWTP Bochum-Ölbachtal. *Water Sci Technol* 73:3057–3063. <https://doi.org/10.2166/wst.2016.142>
- Martin I, Pidou M, Soares A et al (2011) Modelling the energy demands of aerobic and anaerobic membrane bioreactors for wastewater treatment. *Environ Technol* 32:921–932. <https://doi.org/10.1080/09593330.2011.565806>
- Masłóń A (2017) Analysis of energy consumption at the Rzeszów Wastewater Treatment Plant. *E3S Web Conf* 22:00115. <https://doi.org/10.1051/e3sconf/20172200115>
- Mattioli A, Gatti GB, Mattuzzi GP et al (2017) Co-digestion of the organic fraction of municipal solid waste and sludge improves the energy balance of wastewater treatment plants: Rovereto case study. *Renew Energy* 113:980–988. <https://doi.org/10.1016/j.renene.2017.06.079>
- McCarty PL, Bae J, Kim J (2011) Domestic wastewater treatment as a net energy producer—can this be achieved? *Environ Sci Technol* 45:7100–7106. <https://doi.org/10.1021/es2014264>
- McNabola A, Coughlan P, Williams AP (2014) Energy recovery in the water industry: an assessment of the potential of micro-hydropower. *Water Environ J*. <https://doi.org/10.1111/wej.12046>

- Meerburg FA, Boon N, Van Winckel T et al (2016) Live fast, die young: optimizing retention times in high-rate contact stabilization for maximal recovery of organics from wastewater. *Environ Sci Technol* 50:9781–9790. <https://doi.org/10.1021/acs.est.6b01888>
- Menco L (2012) CAMBI thermal hydrolysis sludge treatment: medium to large-scale application. <http://www.environmentindex.com/en/article/cambi-thermal-hydrolysis-sludge-treatment-medium-to-large-scale-application-677.aspx>
- Miller MW, Regmi P, Murthy S et al (2015) Combining high-rate activated sludge and shortcut nitrogen removal for efficient carbon and energy utilization. *Proc Water Environ Fed, Water Energy*. <https://doi.org/10.2175/193864715819559045>
- Mizuta K, Shimada M (2010) Benchmarking energy consumption in municipal wastewater treatment plants in Japan. *Water Sci Technol* 62:2256–2262. <https://doi.org/10.2166/wst.2010.510>
- Molinos-Senante M, Hernández-Sancho F, Mocholí-Arce M, Sala-Garrido R (2014) Economic and environmental performance of wastewater treatment plants: potential reductions in greenhouse gases emissions. *Resour Energy Econ* 38:125–140. <https://doi.org/10.1016/j.reseneeco.2014.07.001>
- Morgan-Sagastume F, Pratt S, Karlsson A et al (2011) Production of volatile fatty acids by fermentation of waste activated sludge pre-treated in full-scale thermal hydrolysis plants. *Bioresour Technol* 102:3089–3097. <https://doi.org/10.1016/j.biortech.2010.10.054>
- Moss L, Donovanm JF, Carr S et al (2013) Enabling the future: advancing resource recovery from biosolids. Water environmental federation (WEF). [http://ftp.weat.org/Presentations/3-Moss-ETF\\_Resource\\_Recovery\\_Biosolids](http://ftp.weat.org/Presentations/3-Moss-ETF_Resource_Recovery_Biosolids). Accessed 7 Feb 2017
- Neugebauer G, Kretschmer F, Kollmann R et al (2015) Mapping thermal energy resource potentials from wastewater treatment plants. *Sustainability* 7:12988–13010. <https://doi.org/10.3390/su71012988>
- NEWRI (2009) Water & energy in the urban water cycle - Improving energy efficiency in municipal wastewater treatment. In: Nanyang environment & water research institute in collaboration with PUB Singapore & global water research coalition. pp 1–18
- Nouri J, Naddafi K, Nabizadeh R, Jafarinia M (2006) Energy recovery from wastewater treatment plant. *Pak J Biol Sci* 9:3–6. <https://doi.org/10.3923/pjbs.2006.3.6>
- Nowak O, Enderle P, Varbanov P (2015) Ways to optimize the energy balance of municipal wastewater systems: lessons learned from Austrian applications. *J Clean Prod* 88:125–131. <https://doi.org/10.1016/j.jclepro.2014.08.068>
- NYSERDA (2010) Water & wastewater energy management, best practices handbook. In: NewYork state energy research & development authority. pp 32–39
- OCHSNER (2012) Waste water as heat source of heat pump. *REHVA J* 2012. p 63. <http://www.ochsner.com>. Accessed 14 May 2018
- Olive N (2002) Design of a chemically enhanced primary treatment plant for the City of Alfenas, Minas, Gerais. Massachusetts Institute of Technology, Boston
- Olsson G (2012) ICA and me—a subjective review. *Water Res* 46:1585–1624. <https://doi.org/10.1016/j.watres.2011.12.054>
- Panepinto D, Fiore S, Zappone M et al (2016) Evaluation of the energy efficiency of a large wastewater treatment plant in Italy. *Appl Energy* 161:404–411. <https://doi.org/10.1016/j.apenergy.2015.10.027>
- Park JBK, Craggs RJ, Shilton AN (2011) Wastewater treatment high rate algal ponds for biofuel production. *Bioresour Technol* 102:35–42. <https://doi.org/10.1016/j.biortech.2010.06.158>
- Parry D (2014) Power positive resource recovery. *Biocycle* 55:45. <https://www.biocycle.net/2014/08/14/power-positive-resource-recovery>. Accessed 21 Mar 2018
- Philippon P (2015) Frequency variation: from energy savings to the smart plant. [Variation de fréquence: Des économies d'énergie]. *Eau, l'INDUSTRIE, les Nuisances* 69–79
- Piao W, Kim Y, Kim H et al (2016) Life cycle assessment and economic efficiency analysis of integrated management of wastewater treatment plants. *J Clean Prod* 113:325–337. <https://doi.org/10.1016/j.jclepro.2015.11.012>
- Pittoors E, Guo Y, Van Hulle SWH (2014) Modeling dissolved oxygen concentration for optimizing aeration systems and reducing oxygen consumption in activated sludge processes: a review. *Chem Eng Commun* 201:983–1002. <https://doi.org/10.1080/00986445.2014.883974>
- Polruang S, Sirivithayapakorn S, Prateep Na Talang R (2018) A comparative life cycle assessment of municipal wastewater treatment plants in Thailand under variable power schemes and effluent management programs. *J Clean Prod* 172:635–648. <https://doi.org/10.1016/J.JCLEPRO.2017.10.183>
- Poole AL (2012) Comparison of ammonia and DO aeration control strategies to optimize energy and performance at low capital cost: a case study. In: WEFTEC annual conference. New Orleans
- Power C, McNabola A, Coughlan P (2014) Development of an evaluation method for hydropower energy recovery in wastewater treatment plants: case studies in Ireland and the UK. *Sustain Energy Technol Assess* 7:166–177. <https://doi.org/10.1016/j.seta.2014.06.001>
- Powerstep Approach Powerstep. <http://powerstep.eu/what-s-powerstep/approach>
- Qi Y (2013) A national survey of biogas use at wastewater treatment plants in the United States: the results. In: Proceedings of the water environment federation. WEF
- Rabaey K, Rodríguez J, Blackall LL et al (2007) Microbial ecology meets electrochemistry: electricity-driven and driving communities. *ISME J* 1:9–18. <https://doi.org/10.1038/ismej.2007.4>
- Raheem A, Prinsen P, Vuppaladadiyam AK et al (2018) A review on sustainable microalgae based biofuel and bioenergy production: recent developments. *J Clean Prod* 181:42–59. <https://doi.org/10.1016/J.JCLEPRO.2018.01.125>
- Rahimnejad M, Adhami A, Darvari S et al (2015) Microbial fuel cell as new technology for bioelectricity generation: a review. *Alex Eng J* 54:745–756. <https://doi.org/10.1016/J.AEJ.2015.03.031>
- Regmi P, Miller MW, Holgate B et al (2014) Control of aeration, aerobic SRT and COD input for mainstream



- nitritation/denitritation. *Water Res* 57:162–171. <https://doi.org/10.1016/j.watres.2014.03.035>
- Regmi P, Holgate B, Fredericks D et al (2015) Optimization of a mainstream nitritation–denitritation process and anammox polishing. *Water Sci Technol* 72:632. <https://doi.org/10.2166/wst.2015.261>
- Remy C, Lesjean B, Waschnewski J (2013) Identifying energy and carbon footprint optimization potentials of a sludge treatment line with life cycle assessment. *Water Sci Technol* 67:63–73. <https://doi.org/10.2166/wst.2012.529>
- Remy C, Boulestreau M, Lesjean B (2014) Proof of concept for a new energy-positive wastewater treatment scheme. *Water Sci Technol* 70:1709. <https://doi.org/10.2166/wst.2014.436>
- Rieger L (2012) Myths about ammonia feedforward aeration control. In: Proceedings of the water environment federation, pp 2483–2502
- Rieger L, Jones RM, Dold PL, Bott CB (2014) Ammonia-based feedforward and feedback aeration control in activated sludge processes. *Water Environ Res* 86:63–73. <https://doi.org/10.2175/106143013X13596524516987>
- Rodriguez-Caballero A, Aymerich I, Marques R et al (2015) Minimizing N<sub>2</sub>O emissions and carbon footprint on a full-scale activated sludge sequencing batch reactor. *Water Res* 71:1–10. <https://doi.org/10.1016/j.watres.2014.12.32>
- Rosso D, Larson LE, Stenstrom MK (2008) Aeration of large-scale municipal wastewater treatment plants: state of the art. *Water Sci Technol* 57:973–978. <https://doi.org/10.2166/wst.2008.218>
- Rothausen SGSA, Conway D (2011) Greenhouse-gas emissions from energy use in the water sector. *Nat Clim Change* 1:210–219. <https://doi.org/10.1038/Nclimate1147>
- Rozendal RA, Hamelers HVM, Rabaey K et al (2008) Towards practical implementation of bioelectrochemical wastewater treatment. *Trends Biotechnol* 26:450–459. <https://doi.org/10.1016/j.tibtech.2008.04.008>
- R3water/R3waterReuse, Recovery and resource efficiency, innovations in urban wastewater treatment. <http://r3water.eu/>
- Sadowski MS (2015) Comparison of aeration strategies for optimization of nitrogen removal in an adsorption/bio-oxidation process with an emphasis on ammonia vs. NO<sub>x</sub> control. Master of Science, thesis, Virginia Polytechnic Institute and State University
- Saghafi S, Mehrdadi N, Bid Hendy GN, Rad HA (2016) Estimating the electrical energy in different processes for Nasir Abad industrial wastewater treatment plant with emphasis on COD removal. *J Environ Stud* 42:4–6
- Sala-Garrido R, Molinos-Senante M, Hernández-Sancho F (2011) Comparing the efficiency of wastewater treatment technologies through a DEA metafrontier model. *Chem Eng J* 173:766–772. <https://doi.org/10.1016/j.cej.2011.08.047>
- Sala-Garrido R, Hernández-Sancho F, Molinos-Senante M (2012) Assessing the efficiency of wastewater treatment plants in an uncertain context: a DEA with tolerances approach. *Environ Sci Policy* 18:34–44. <https://doi.org/10.1016/j.envsci.2011.12.012>
- Sanchez F, Rey H, Viedma A et al (2018) CFD simulation of fluid dynamic and biokinetic processes within activated sludge reactors under intermittent aeration regime. *Water Res* 139:47–57. <https://doi.org/10.1016/j.watres.2018.03.067>
- Santoro C, Arbizzani C, Erable B, Ieropoulos I (2017) Microbial fuel cells: from fundamentals to applications. A review. *J Power Sour* 356:225–244. <https://doi.org/10.1016/J.JPOWSOUR.2017.03.109>
- Santos-Ballardo DU, Rossi S, Reyes-Moreno C, Valdez-Ortiz A (2016) Microalgae potential as a biogas source: current status, restraints and future trends. *Rev Environ Sci Biotechnol* 15:243–264. <https://doi.org/10.1007/s11157-016-9392-z>
- Schaubroeck T, De Clippeleir H, Weissenbacher N et al (2015) Environmental sustainability of an energy self-sufficient sewage treatment plant: improvements through DEMON and co-digestion. *Water Res* 74:166–179. <https://doi.org/10.1016/j.watres.2015.02.013>
- Scherson YD, Wells GF, Woo S-G et al (2013) Nitrogen removal with energy recovery through N<sub>2</sub>O decomposition. *Energy Environ Sci* 6:241–248. <https://doi.org/10.1039/C2EE22487A>
- Scherson YD, Woo S-G, Criddle CS (2014) Production of nitrous oxide from anaerobic digester centrate and its use as a co-oxidant of biogas to enhance energy recovery. *Environ Sci Technol* 48:5612–5619. <https://doi.org/10.1021/es501009j>
- Seuntjens D, Han M, Kerckhof F-M et al (2018) Pinpointing wastewater and process parameters controlling the AOB to NOB activity ratio in sewage treatment plants. *Water Res* 138:37–46. <https://doi.org/10.1016/J.WATRES.2017.11.044>
- Shizas I, Bagley DM (2004) Experimental Determination of energy content of unknown organics in municipal wastewater streams. *J Energy Eng*. [https://doi.org/10.1061/\(ASCE\)0733-9402\(2004\)130:2\(45\)](https://doi.org/10.1061/(ASCE)0733-9402(2004)130:2(45))
- Sialve B, Bernet N, Bernard O (2009) Anaerobic digestion of microalgae as a necessary step to make microalgal bio-diesel sustainable. *Biotechnol Adv* 27:409–416. <https://doi.org/10.1016/j.biotechadv.2009.03.001>
- Siegrist H, Salzgeber D, Eugster J, Joss A (2008) Anammox brings WWTP closer to energy autarky due to increased biogas production and reduced aeration energy for N-removal. *Water Sci Technol* 57:383–388. <https://doi.org/10.2166/wst.2008.048>
- Singh P, Kansal A, Carliell-Marquet C (2016) Energy and carbon footprints of sewage treatment methods. *J Environ Manag* 165:22–30. <https://doi.org/10.1016/J.JENVMAN.2015.09.017>
- Skorkowski L, Zielewicz E, Kawczynski A et al (2018) Assessment of excess sludge ultrasonic, mechanical and hybrid pretreatment in relation to the energy parameters. *Water* 10:551. <https://doi.org/10.3390/w10050551>
- Smith R (2013) How to control activated sludge with online sensors. In: YSI Inc. <http://blog.ysi.com/how-to-control-activated-sludge-with-online-sensors>. Accessed 7 Feb 2018
- Soliman M, Eldyasti A (2016) Development of partial nitrification as a first step of nitrite shunt process in a sequential batch reactor (SBR) using ammonium oxidizing bacteria (AOB) controlled by mixing regime. *Bioresour Technol* 221:85–95. <https://doi.org/10.1016/j.biortech.2016.09.023>

- Solon K, Flores-Alsina X, Kazadi Mbamba C et al (2017) Plant-wide modelling of phosphorus transformations in wastewater treatment systems: impacts of control and operational strategies. *Water Res* 113:97–110. <https://doi.org/10.1016/j.watres.2017.02.007>
- Spinoso L, Ayol A, Baudez J et al (2011) Sustainable and innovative solutions for sewage sludge management. *Water* 3:702–717. <https://doi.org/10.3390/w3020702>
- Stone L, Kuchenrither R, Quintanilla A et al (2010) Renewable energy resources: banking on biosolids. National association of clean water agencies (NACWA)
- Suslick KS, Eddingsaas NC, Flannigan DJ et al (2011) Extreme conditions during multibubble cavitation: sonoluminescence as a spectroscopic probe. *Ultrason Sonochem* 18:842–846. <https://doi.org/10.1016/j.ultsonch.2010.12.012>
- Tartakovsky B, Kleiner Y, Manuel M-F (2017) Bioelectrochemical anaerobic sewage treatment technology for Arctic communities. *Environ Sci Pollut Res*. <https://doi.org/10.1007/s11356-017-8390-1>
- Tchobanoglous G (2009) Impacts of new concepts and technology on the energy sustainability of wastewater management. Proceedings of 3rd Conference on Climate Change, Sustainable Development, and Renewable Energy Sources. 15–17 October 2009, Thessaloniki, Greece
- The European IPPC Bureau (2002) Integrated pollution prevention and control, reference document on best available techniques in common waste water and waste gas treatment/management systems in the chemical sector. <http://infohouse.p2ric.org/ref/21/20554.pdf>. Accessed 14 May 2018
- The Hong Kong University of Science and Technology R and DC (2013) Report No. RD 2071 pilot trial of membrane enhanced primary treatment (MEPT) process (Final Report)
- Tomlinson J (2005) Heat recovery from wastewater using a gravity-film heat exchanger. In: Federal energy management program. Oak Ridge National Laboratory
- Torregrossa D, Schutz G, Cornelissen A et al (2016) Energy saving in WWTP: daily benchmarking under uncertainty and data availability limitations. *Environ Res* 148:330–337. <https://doi.org/10.1016/j.envres.2016.04.010>
- Torregrossa D, Hernández-Sancho F, Hansen J et al (2018) Energy saving in wastewater treatment plants: a plant-generic cooperative decision support system. *J Clean Prod* 167:601–609. <https://doi.org/10.1016/j.jclepro.2017.08.181>
- Trojanowicz K (2016) Energetyczna użycie biogazu jako element gospodarki osadowej w oczyszczalni ścieków w Krośnie. *Forum Eksploatatora* 46–53
- Tyagi VK, Lo S-L (2011) Application of physico-chemical pretreatment methods to enhance the sludge disintegration and subsequent anaerobic digestion: an up to date review. *Rev Environ Sci Bio Technol* 10:215–242. <https://doi.org/10.1007/s11157-011-9244-9>
- Tyagi VK, Lo SL (2013) Sludge: a waste or renewable source for energy and resources recovery? *Renew Sustain Energy Rev* 25:708–728. <https://doi.org/10.1016/j.rser.2013.05.029>
- U.S. Municipal Solid Waste Sector Action Plan (2013). [https://www.globalmethane.org/documents/landfills\\_cap\\_usa.pdf](https://www.globalmethane.org/documents/landfills_cap_usa.pdf). Accessed 15 Nov 2017
- USDOE (2005) Onondaga county department of water environment protection: process optimization saves energy at metropolitan syracuse wastewater treatment plant. <http://www.infohouse.p2ric.org/ref/40/39671.pdf>. Accessed 15 Nov 2017
- Van Horne MP, Rohrbacher J, Pitt P (2013) Coming full circle: moving wastewater treatment plants toward energy neutrality. *Florida Water Resour J*. <https://doi.org/10.2175/193864712811703739>
- Walker ME, Lv Z, Masanet E (2013) Industrial steam systems and the energy-water nexus. *Environ Sci Technol* 47:13060–13067. <https://doi.org/10.1021/es403715z>
- Wang W, Luo Y, Qiao W (2010) Possible solutions for sludge dewatering in China. *Front Environ Sci Eng China* 4:102–107. <https://doi.org/10.1007/s11783-010-0001-z>
- Wang H, Park J-D, Ren ZJ (2015) Practical energy harvesting for microbial fuel cells: a review. *Environ Sci Technol* 49:3267–3277. <https://doi.org/10.1021/es5047765>
- Wang H, Yang Y, Keller AAA et al (2016) Comparative analysis of energy intensity and carbon emissions in wastewater treatment in USA, Germany, China and South Africa. *Appl Energy* 184:873–881. <https://doi.org/10.1016/j.apenergy.2016.07.061>
- Water Environmental Federation, American Society of Civil Engineers (2010) Design of municipal wastewater treatment plants. WEF Manual of practice no.8, ASCE manuals and reports on engineering practice no. 76, Fifth edition. [http://www.wefnet.org/ewef/images/mop8/mop8\\_frontmatter.pdf](http://www.wefnet.org/ewef/images/mop8/mop8_frontmatter.pdf). Accessed 7 Feb 2017
- WEF (2009) Energy conservation in water and wastewater facilities, WEF Manual of Practice No. 32, 601 Wythe Street Alexandria, VA 22314–1994
- Wei W, Zhou X, Wang D et al (2017) Free ammonia pretreatment of secondary sludge significantly increases anaerobic methane production. *Water Res* 118:12–19. <https://doi.org/10.1016/j.watres.2017.04.015>
- Wei W, Wang Q, Zhang L et al (2018) Free nitrous acid pretreatment of waste activated sludge enhances volatile solids destruction and improves sludge dewaterability in continuous anaerobic digestion. *Water Res* 130:13–19. <https://doi.org/10.1016/j.biortech.2014.11.054>
- Weiland P (2010) Biogas production: current state and perspectives. *Appl Microbiol Biotechnol* 85:849–860
- Weißbach M, Thiel P, Drewes JE, Koch K (2018) Nitrogen removal and intentional nitrous oxide production from reject water in a coupled nitrification/nitrous denitrification system under real feed-stream conditions. *Bioresour Technol* 255:58–66. <https://doi.org/10.1016/j.BIORTECH.2018.01.080>
- WERF (2011) Energy production and efficiency research—the roadmap to net-zero energy, VA. pp 1–8
- WERF (2015a) Demonstrated energy neutrality leadership: a study of five champions of change, Water Environment Research Foundation 635 Slaters Lane, Suite GG-110 Alexandria, VA 22314-1177. <https://www.werf.org/a/ka/Search/ResearchProfile.aspx?ReportId=ENER1C12b>. Accessed 21 Mar 2017

- WERF (2015b) *Mainstream deammonification*. ISBN:9781780407852
- Whiting A, Azapagic A (2014) Life cycle environmental impacts of generating electricity and heat from biogas produced by anaerobic digestion. *Energy* 70:181–193. <https://doi.org/10.1016/j.energy.2014.03.103>
- Willis J, Stone L, Durden K et al (2012) Barriers to biogas use for renewable energy. *Water Environ Res Found*
- Wojtowicz A, Jedrzejewski C, Bieniowski M, Darul H (2013) Modelowe rozwiązania w gospodarce osadowej. *Izba Gospodarcza, Polish Waterworks*, pp 440–441
- Xu G, Chen S, Shi J et al (2010) Combination treatment of ultrasound and ozone for improving solubilization and anaerobic biodegradability of waste activated sludge. *J Hazard Mater* 180:340–346. <https://doi.org/10.1016/J.JHAZMAT.2010.04.036>
- Xu J, Li Y, Wang H et al (2017) Exploring the feasibility of energy self-sufficient wastewater treatment plants: a case study in eastern China. *Energy Procedia* 142:3055–3061. <https://doi.org/10.1016/j.egypro.2017.12.444>
- Yan P, Qin RC, Guo JS et al (2017) Net-zero-energy model for sustainable wastewater treatment. *Environ Sci Technol* 51:1017–1023. <https://doi.org/10.1021/acs.est.6b04735>
- Yang Z, Pei H, Hou Q et al (2018) Algal biofilm-assisted microbial fuel cell to enhance domestic wastewater treatment: nutrient, organics removal and bioenergy production. *Chem Eng J* 332:277–285. <https://doi.org/10.1016/J.CEJ.2017.09.096>
- Yeshi C (2015) Measured data based mass balance and energy efficiency of an 800,000 m<sup>3</sup>/day water reclamation plant in Singapore. In: 12th IWA specialised conference on design, operation and economics of large wastewater treatment plants. IWA, Prague, pp 93–99
- Zaborowska E, Czerwionka K, Makinia J (2017) Strategies for achieving energy neutrality in biological nutrient removal systems—a case study of the Slupsk WWTP (northern Poland). *Water Sci Technol* 75:727–740. <https://doi.org/10.2166/wst.2016.564>
- Zamalloa C, Vulsteke E, Albrecht J, Verstraete W (2011) The techno-economic potential of renewable energy through the anaerobic digestion of microalgae. *Bioresour Technol* 102:1149–1158. <https://doi.org/10.1016/j.biortech.2010.09.017>
- Zettl U (2015) WWTP stuttgart—Mühlhausen—changeover to air distribution control system (ADC). In: 12th IWA specialised conference on design, operation and economics of large wastewater treatment plants. IWA, Prague, pp 108–110
- Zou Y, Xu X, Li L et al (2018) Enhancing methane production from *U. lactuca* using combined anaerobically digested sludge (ADS) and rumen fluid pre-treatment and the effect on the solubilization of microbial community structures. *Bioresour Technol* 254:83–90. <https://doi.org/10.1016/j.biortech.2017.12.054>
- Żubrowska-Sudoł M, Podedworna J, Bisak A et al (2017) Intensification of anaerobic digestion efficiency with use of mechanical excess sludge disintegration in the context of increased energy production in wastewater treatment plants. In: E3S Web Conf 22:00208. <https://doi.org/10.1051/e3sconf/20172200208>
- Zylstra GJ, Kukor JJ (2005) What is environmental biotechnology? *Curr Opin Biotechnol* 16:243–245. <https://doi.org/10.1016/J.COPBIO.2005.05.001>