

## AN IMPROVED METHOD FOR FLOW BOILING HEAT TRANSFER WITH ACCOUNT OF THE REDUCED PRESSURE EFFECT

by

**Blanka JAKUBOWSKA\* and Dariusz MIKIELEWICZ**

Department of Energy and Industrial Apparatus, Faculty of Mechanical Engineering,  
Gdansk University of Technology, Gdansk, Poland

Original scientific paper  
<https://doi.org/10.2298/TSCI19S4261J>

*In the paper are presented the results using the authors own model to predict heat transfer coefficient during flow boiling. The model has been tested against a large selection of experimental data to investigate the sensitivity of the in-house developed model. In the work are presented the results of calculations obtained using the semi-empirical model on selected experimental flow boiling data of the refrigerants: R134a, R1234yf, R600a, R290, NH<sub>3</sub>, CO<sub>2</sub>, R236fa, R245fa, R152a, and HFE7000. In the present study, particular attention was focused on the influence of reduced pressure on the predictions of the theoretical model. The main purpose of this paper is to show the effect of the reduced pressure on the predictions of heat transfer during flow boiling.*

**Key words:** mini-channel, conventional channel, heat transfer coefficient, flow boiling, reduced pressure, synthetic refrigerants, natural refrigerants, CO<sub>2</sub>

### Introduction

Nowadays, there is an increasing interest in refrigerants featuring low global warming potential (GWP). The reason for this concern can be attributed to the growing number of regulations and laws prohibiting the use of some synthetic refrigerants. According to these regulations, the new fluids used in *e. g.* air-conditioning and refrigeration applications cannot be implemented with fluorinated greenhouse gases having GWP greater than 150 [1]. Within that document, most of the substances used in the refrigeration system have been regulated due to its ozone depletion potential (ODP). Consequently, one of the working fluids most extensively used in medium evaporation temperatures, such as for example R134a with GWP = 1430 needs to be replaced by more environmentally friendly fluids. Previous studies have considered R152a [2] and the natural refrigerant CO<sub>2</sub> [3] as possible replacements for R134a. On the other hand, CO<sub>2</sub> as compared to contemporary fluids, is a relatively safe one. It is non-toxic, non-flammable, non-explosive, and can be coupled with most metals and plastics. Design of evaporators for use of the CO<sub>2</sub> requires the exact determination of heat transfer coefficient during flow boiling. Available in the literature empirical correlations give different results as compared to the results obtained experimentally [4, 5]. There is hardly any robust and recommended correlation for the purpose of calculation of CO<sub>2</sub> two-phase heat transfer and

\* Corresponding author, e-mail: [Blanka.Jakubowska@pg.edu.pl](mailto:Blanka.Jakubowska@pg.edu.pl)

pressure drop, despite some devoted contributions [3]. Moreover, the traditional refrigerants can be also replaced by other natural refrigerants such as R600a and R290 [6]. These working fluids do not exhibit a harmful impact on the ozone layer and have a negligible GWP. Furthermore, the mixture of R290 and R600a can be one of the most appropriate refrigerants to replace R134a [7]. Recently, R1234yf has been believed to be a promising candidate as an alternative of R134a [8]. Its ODP is equal 0, whereas  $GWP = 4$  and its thermophysical properties are similar to those of R134a. In recent years also much attention has been paid to the possible use of fluorinated propene isomers for the substitution of HFC fluids, being in most cases high GWP refrigerants. However, the available hydrofluoroolefins (HFO) cannot cover all the air-conditioning, heat pump and refrigeration systems when used as pure fluids because their thermodynamic properties are not suitable for all operating conditions and therefore some solutions may be found using blends of refrigerants, to satisfy the demand for a wide range of working conditions [9]. In the literature, there are many empirical correlations for modeling of flow boiling heat transfer and pressure drop. One of the recently proposed model for prediction pressure drop is due to Sempertegui-Tapia *et al.* [10] correlation. Ribatski [11] highlighted the problem connecting with differences among data from independent laboratories that can be related to several following aspects: different surface roughness, channel dimensions uncertainties, channel obstructions, inappropriate data reduction procedures, and presence of thermal instabilities [10]. It can be the reason why most of available in the literature empirical correlations give different results as compared to the results obtained experimentally. It should be also noted that developments in many modern applications are associated with the necessity of sizing heat transfer devices and installation. These developments have spurred unprecedented interest in replacing single-phase systems with boiling and condensation counterparts. While computational methods have shown tremendous success in modeling single-phase systems, their effectiveness with phase change systems is limited mostly to simple configurations [12]. This fact has an impact not only on the development of predicting two-phase frictional pressure drop, but also on the prediction of heat transfer coefficient during flow boiling and flow condensation due to the need to dissipate a large heat flux. Flow boiling and condensation phenomena in mini- and micro-scale channels are essential processes involved in a wide range of industrial applications such as heat exchangers, high heat flux cooling and the like in mechanical, chemical, aerospace, energy, automotive and renewable energy, electronics, and also biological and medical engineering [13, 14]. Previously mentioned investigation have shows how reliable prediction methods of two-phase heat transfer coefficient are necessary.

In the article is presented a semi-empirical model for calculations of flow boiling and flow condensation in mini and conventional size channels. It was authors' intention to show the performance of their own approach in predicting the flow boiling heat transfer coefficient on the example of the data collected from the literature using the in-house developed model [15-18]. Based on the evidence of comparisons with experimental data a correction incorporating the effect of reduced pressure has been postulated to the authors own model to provide a better consistency of the predictions with the experimental data.

### The modeling

The versatile semi-empirical model for calculations of flow boiling and flow condensation due to Mikielewicz [15] and the final version for the calculations of saturated flow boiling due to Mikielewicz and Mikielewicz [16] and Mikielewicz *et al.* [17-19] has been tested for a significant number of experimental data and has returned satisfactory results for



the case of the flow boiling process for numerous fluids. The fundamental hypothesis of the model is the fact that heat transfer during flow boiling with bubble generation can be modeled as a sum of two contributions constituting the total energy dissipation in the flow, namely the energy dissipation due to the shearing flow without the bubbles and dissipation resulting from the bubble generation. The final version of the model reads:

$$\frac{\alpha_{TPB}}{\alpha_{LO}} = \sqrt{\left(\phi_{LO}^2\right)^n + \frac{C}{1+P} \left(\frac{\alpha_{pb}}{\alpha_{LO}}\right)^2} \quad (1)$$

In eq. (1)  $C = 1$  for flow boiling and  $C = 0$  for flow condensation, eq. (1) also includes the empirical correction,  $P$ , defined by eq. (2). Occurring in the eq. (1) the two-phase multiplier is raised to the power  $n$  ( $n = 0.76$  for turbulent,  $n = 2$  for laminar flow):

$$P = 2.53 \cdot 10^{-3} \text{Re}^{1.17} \text{Bo}^{0.6} \left[ \left(\phi_{LO}^2\right)_{MS} - 1 \right]^{-0.65} \quad (2)$$

The model has been recently extended to cases of subcooled flow boiling [17] and post dry out modeling [20]. In presented calculations tested was the sensitivity of the developed heat transfer model to the selection of the two-phase flow multiplier. For that purpose four well established two-phase flow multiplier models were introduced and tested in eq. (1), namely modified correlation due to Muller-Steinhagen and Heck [21], along with relationships which have been outlined in tab 1.

**Table 1. Two-phase frictional pressure drop correlation**

| Authors                                  | Equations   |
|--|---|
| Muller-Steinhagen and Heck [21]          | $\left(\frac{dp}{dz}\right)_{MS} = \left(\frac{dp}{dz}\right)_{LO} + 2 \left[ \left(\frac{dp}{dz}\right)_{GO} - \left(\frac{dp}{dz}\right)_{LO} \right] x \left\{ (1-x)^{1/3} + \left(\frac{dp}{dz}\right)_{GO} x^3 \right\}$ $\left(\frac{dp}{dz}\right)_{MS} = \phi_{LO}^2 \left(\frac{dp}{dz}\right)_{LO} \quad (3)$   |
| Modified Muller-Steinhagen and Heck [22] | $\left(\frac{dp}{dz}\right)_{MS_1} = \phi_{LO}^2 \left(\frac{dp}{dz}\right)_{LO}$ $\phi_{LO}^2 = \left[ 1 + 2 \left( \frac{1}{f_1} - 1 \right) x Con^m \right] (1-x)^{1/3} + \frac{1}{f_{1z}} x \quad (4)$ $Con = \frac{1}{d_h} \sqrt{\frac{\sigma}{g(\rho_l - \rho_g)}}$ <p>Turbulent flow</p> $f_1 = (\rho_l/\rho_g)(\mu_l/\mu_g)^{0.25}, \quad f_{1z} = (\mu_g/\mu_l)(\lambda_l/\lambda_g)^{1.5}(c_{p,l}/c_{p,g})$ <p>Laminar flow</p> $f_1 = (\rho_l/\rho_g)(\mu_l/\mu_g), \quad f_{1z} = (\lambda_g/\lambda_l)$ <p><math>m = 0</math> for flow in conventional channels, <math>m = -1</math> for flow in mini-channels</p> |



|                                     |  |
|-------------------------------------|--|
| Zhang and Webb [23]                 | $\left(\frac{dp}{dz}\right)_{ZW} = \phi_{LO}^2 \left(\frac{dp}{dz}\right)_{LO} \quad (5)$ $\phi_{LO}^2 = (1-x)^2 + \frac{2.87x^2}{p_r} + 1.68x^{0.8}(1-x)^{0.25} p_r^{-1.64}$  |
| Cioncolini et al. [24]              | $-\left(\frac{dp}{dz}\right)_c = 2f_{fp} \frac{G_c^2}{\rho_c d} + G^2 \frac{d}{dz} \left[ \frac{x^2}{\rho_g \varepsilon} + \frac{e^2(1-x)^2}{\rho_l \gamma(1-\varepsilon)} + \frac{(1-e)^2(1-x)^2}{\rho_l(1-\gamma)(1-\varepsilon)} \right] \quad (6)$ <p>The full calculation algorithm was presented in [33]</p>   |
| Sempertegui-Tapia and Ribatski [10] | $\left(\frac{dp}{dz}\right)_{STR} = F(1-x)^{1/\lambda} + \left(\frac{dp}{dz}\right)_{GO} x^2 \quad (7)$ $F = \left(\frac{dp}{dz}\right)_{LO} + \omega \left[ \left(\frac{dp}{dz}\right)_{GO} - \left(\frac{dp}{dz}\right)_{LO} \right] x$ $\omega = ae^{bRe_{GO}/1000}, \quad a = 3.01, \quad b = -0.00464, \quad \lambda = 2.31$  |
| Tran [25]                           | $\phi_{LO}^2 = 1 + \left[ 4.3 \frac{\left(\frac{dp}{dz}\right)_{GO}}{\left(\frac{dp}{dz}\right)_{LO}} \right] \left[ N_{conf} x^{0.875} (1-x)^{0.875} + x^{1.75} \right] \quad (8)$ $N_{conf} = \sqrt{\frac{\sigma}{g(\rho_l - \rho_g) d_h^2}}$  |
| Friedel [26]                        | $\left(\frac{dp}{dz}\right)_F = \phi_{LO}^2 \left(\frac{dp}{dz}\right)_{LO} \quad (9)$ $\phi_{LO}^2 = (1-x)^2 + \frac{x^2 \left(\frac{\rho_l}{\rho_g}\right) \left(\frac{f_g}{f_l}\right) + 3.24x^{0.78} (1-x)^{0.224} \left(\frac{\rho_l}{\rho_g}\right)^{0.91} \left(\frac{\mu_g}{\mu_l}\right)^{0.19} \left(1 - \frac{\mu_g}{\mu_l}\right)^{0.7}}{Fr_h^{0.045} We_l^{0.035}}$ |
| New predictive method               | $\left(\frac{dp}{dz}\right)_{MS_2} = \phi_{LO}^2 \left(\frac{dp}{dz}\right)_{LO} \quad (10)$ $\phi_{LO}^2 = \phi_{MS_1}^2 \left[ 1 - \left(\frac{P_{sat}}{P_{crit}}\right)^{a_1} \right] + 1, \quad a_1 = 1$ $\phi_{MS_1}^2 = \left[ 1 + 2 \left(\frac{1}{f_l} - 1\right) x Con^m \right] (1-x)^{1/3} + \frac{1}{f_{1z}} x^3$  |

It was expected that the accuracy of model predictions could be improved by some modifications to the empirical correction,  $P$ , in this case by incorporation of the reduced pressure effect. Taking into account the reduced pressure in the empirical correction,  $P$ , in case of modeling the condensation process in the flow will not affect the obtained results of the calculations. This is due to the fact that the empirical correction,  $P$ , and thus the reduced pressure included in the calculations, are considered only in the part associated with the generation of bubbles, which is non-existent when modeling the condensation process. The modified in the present work empirical correction,  $P$ , yields:

$$P = \left(\frac{P_{sat}}{P_{crit}}\right)^{a_2} 2.53 \cdot 10^{-3} Re^{1.17} Bo^{0.6} \left[ (\phi_{LO}^2)_{MS} - 1 \right]^{-0.65} \quad (11)$$

The exponent  $a_2$ , present in the modified eq. (11) was adjusted to the available data bank for flow boiling.


### Results and discussions

The collected experimental data came from various studies from literature [28-48] and in case of the HFE7000 for own experimental researches, which were conducted for a full range of quality variation and the relatively wide range of mass velocity and saturation temperature. A full range of variability of parameters for experimental data can be found in [49]. In the work are presented the results of calculations obtained by using the in-house developed semi-empirical model on selected experimental flow boiling data of the refrigerants such as: R134a [27-40], R1234yf [37, 39], R600a [41], R290 [42], NH<sub>3</sub> [36], CO<sub>2</sub> [38, 40, 42-47], R236fa [34], R245fa [34, 48], and HFE7000. The range of the confinement number  $Con$  and reduced pressure for all considered refrigerants in the analysis are presented in tab. 2. For the collected experimental database, the confinement number  $Con$  was determined based on  $Con = 1/d_h[\sigma g(\rho_l - \rho_g)]^{1/2}$ . While, the value of reduced pressure is the ratio of saturation pressure and critical pressure. Using the Kew and Cornwell [50] criterion, the available data bank was divided into conventional size channels and mini-channels and when the confinement number is greater than 0.5 then the flow corresponds to the flow in the mini-channel. Belyaev *et al.* [51] tried to confirm the hypothesis that in the case of high value of reduced pressure, the two-phase flow structures in small diameter channels are similar to those occurring in conventional size diameter. Based on their study they observed that when reduced pressure is greater than 0.4 then is no differences between heat transfer during flow boiling in mini-channels and conventional channels. Mauro [52] reports that at the same value of reduced pressure, the thermodynamic properties of refrigerants are very similar, where in the case of transported properties, these properties are more divergent. The example for selected thermodynamic and transported properties has been shown in figs 1 and 2.

**Table 2. The range of confinement number  $Con$  and reduced pressure**

| Fluid           | $Con$               | $P_{sat}/P_{crit}$ |
|-----------------|---------------------|--------------------|
| CO <sub>2</sub> | 0.071- <b>1.611</b> | 0.359-0.777        |
| NH <sub>3</sub> | <b>0.75-1.167</b>   | 0.0455-0.1125      |
| R600a           | <b>0.537-0.855</b>  | 0.0884-0.1023      |
| R290            | 0.021- <b>0.889</b> | 0.0328-0.273       |
| R152a           | <b>0.639-0.656</b>  | 0.14-0.162         |
| R134a           | 0.234- <b>1.65</b>  | 0.094-0.257        |
| R1234yf         | 0.218- <b>0.736</b> | 0.111-0.244        |
| R236fa          | <b>0.826</b>        | 0.104              |
| R245fa          | 0.441- <b>1.592</b> | 0.050-0.071        |
| HFE7000         | 0,361-0,396         | 0.034-0.080        |


Figure 3 displays the evolution of the two-phase pressure drop gradient with the vapour quality according to the predictive methods from the literature listed in tab. 1. As can be seen the discrepancies in the presented values of two-phase pressure drop are very large. In addition, the slight differences in pressure drop can be observed for the original model due to Muller-Steinhagen and Heck [21] eq. (3), Zhang and Webb [23] eq. (5), and Sempertegui-Tapia and Ribatski [10] eq. (7). Also, the newly proposed model eq. (10) and Zhang and Webb eq. (5) models give very similar results of calculation, but on the other hand, the two-phase pressure drop obtained by the new prediction method eq. (10) is about 20% greater than obtained by Zhang and Webb correlation eq. (5).

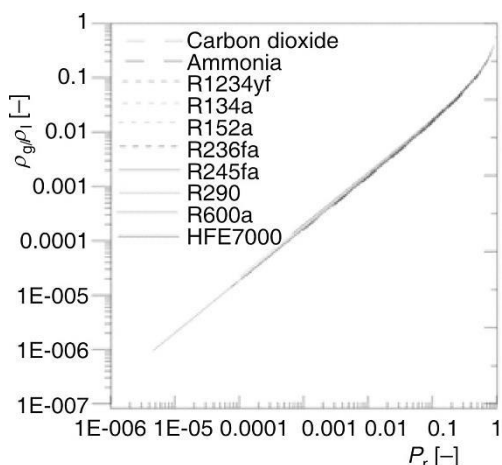


**Figure 1.** Ratio of gas density to liquid density as a function of reduced pressure

In tab. 3 have been presented the values of mean absolute error as a results of calculations of heat transfer coefficient using the model presented pressure drops related to boiling in flow using the relationships specified in tab. 1 with exclusion the model described by eq. (3) and without taking into account the effect of reduced pressure in empirical correction,  $P$ , eq. (11).

The analysis showed that the most satisfactory results have been obtained if taken into account Friedel and based on Muller-Steinhagen and Heck correlations. In this case, only the new predictive method eq. (10) takes into account the influence of the reduced pressure effect. Because, it was expected that the model can be improved by taking into account the effect of reduced pressure in empirical correction,  $P$ , for further analysis in eq. (1), has been adopted the new predictive method eq. (10) as a two-phase flow multiplier and modified empirical correction,  $P$ , eq. (11). Therefore the general form of the model eq. (1) with an account of reduced pressure in the convection term and bubble generation term reads:

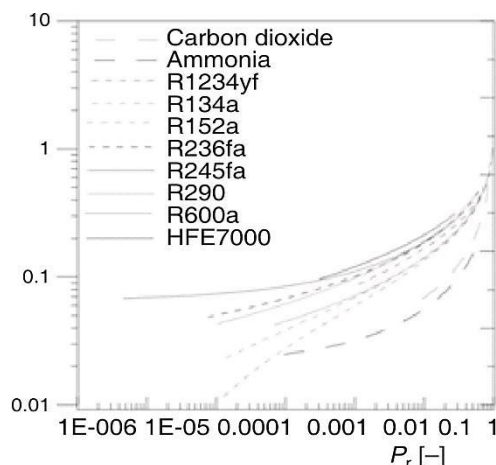

**Figure 2.** Ratio of gas conductivity to liquid conductivity as a function of reduced pressure

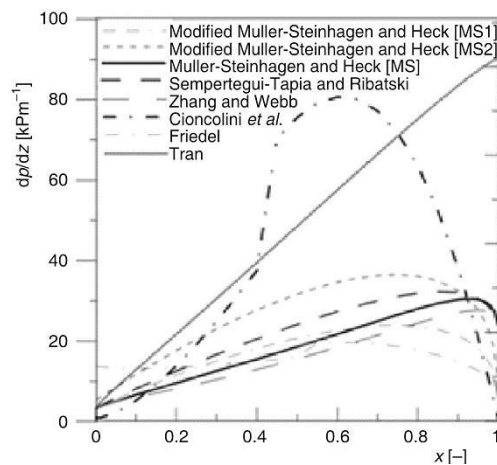

**Figure 3.** The comparison of correlations describing the two-phase pressure drop for  $\text{CO}_2$  at  $G = 400 \text{ kg m}^{-2} \text{ s}^{-1}$ ,  $T_{\text{sat}} = 0^\circ\text{C}$ , and  $d_h = 1 \text{ mm}$

**Table 3.** The values of mean absolute error

| Model   | MAE [%] |
|---|---------|
| Modified Muller-Steinhagen and Heck (MS <sub>1</sub> ) [22] | 37.53   |
| Zhang and Webb [23]   | 70.61   |
| Cioncolini <i>et al.</i> [24]                               | 63.70   |
| Sempertegui-Tapia and Ribatski [10]                         | 46.35   |
| Tran [25]   | 49.67   |
| Friedel [26]  | 33.78   |
| Modified Muller-Steinhagen and Heck (MS <sub>2</sub> ) [21] | 36.73   |

$$\frac{\alpha_{TBP}}{\alpha_{LO}} = \sqrt{\left\{ \left( \phi_{LO}^2 \right)_{MSi} \left[ 1 - \left( \frac{p_{sat}}{p_{crit}} \right)^{a_1} + 1 \right]^n + \frac{C}{1 + \left( \frac{p_{sat}}{p_{crit}} \right)^{a_2}} \cdot 2.53 \cdot 10^{-3} \text{Re}^{1.17} \text{Bo}^{0.6} \left[ \left( \phi_{LO}^2 \right)_{MSi} - 1 \right]^{-0.65} \left( \frac{\alpha_{pb}}{\alpha_{LO}} \right)^2 \right\}} \quad (12)$$

where  $(\phi_{LO}^2)_{MSi}$  is two-phase flow multiplier due to modified Muller-Steinhagen and Heck eq. (4). It should be also noted that there is another term in eq. (1) and the final version of that eq. (12), which should account for the fact that it may be prone to the reduced pressure. That is the pool boiling heat transfer coefficient. In the considered model the generalized Cooper [53] model is used. That model is featuring reduced pressure as one of the independent parameters. For that reason, no amendments are required to that issue. The final form of the generalized pool boiling model yields:

$$\alpha_{pb} = A q^{2/3} M^{-0.5} p_r^{0.12} (-\lg p_r)^{-0.55} \quad (13)$$

The term  $A$  in the eq. (13) is a constant dependent on the type of refrigerant and in the case of freons this value is 55.

In order to improve the predictive compliance of the model eq. (12) with the collected database, in the first analysis approach was performed for individual groups of fluids, *i. e.* synthetic, natural and  $\text{CO}_2$ . The  $\text{CO}_2$  is a separate group due to its specificity. However, this approach did not give satisfactory results. The conducted research has shown that the best convergence of the experimental data with the model could be obtained considering all the data without a division into a group of refrigerants. The values of the exponents  $a_1$  and  $a_2$  in eq. (12) were adjusted using the regression analysis and the following results were obtained  $a_1 = 1$  and  $a_2 = -0.985$ . The results of calculations, which were obtained with taking into account the reduced pressure are presented in figs. 4-7. The information about the mean absolute error is given in tab. 4.

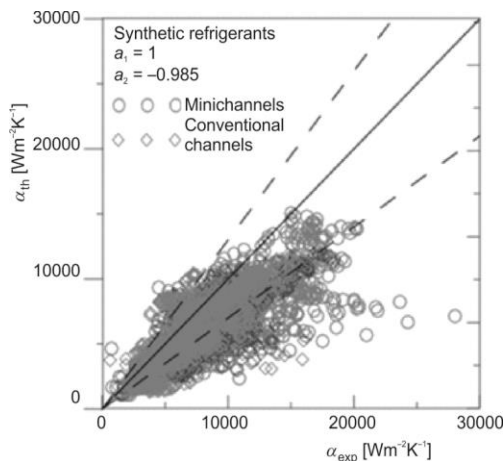


Figure 4. Comparison of the test results  $\alpha_{exp}$  with predictions  $\alpha_{th}$  using eq. (12) for synthetic refrigerants at  $a_1 = 1$  and  $a_2 = -0.985$



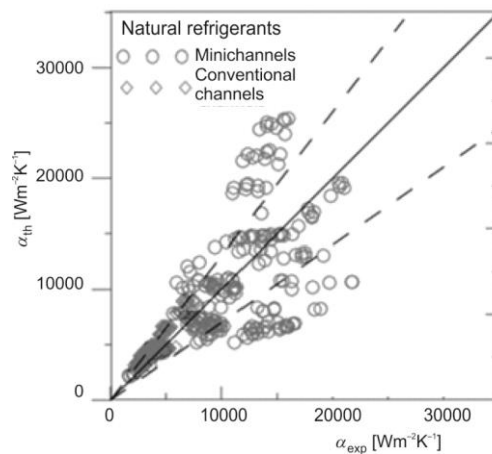


Figure 5. Comparison of the test results  $\alpha_{exp}$  with predictions  $\alpha_{th}$  using eq. (12) for natural refrigerants at  $a_1 = 1$  and  $a_2 = -0.985$

The graphs show that the correlation equations adopted for analysis reflect the experimental data in a satisfactory manner.

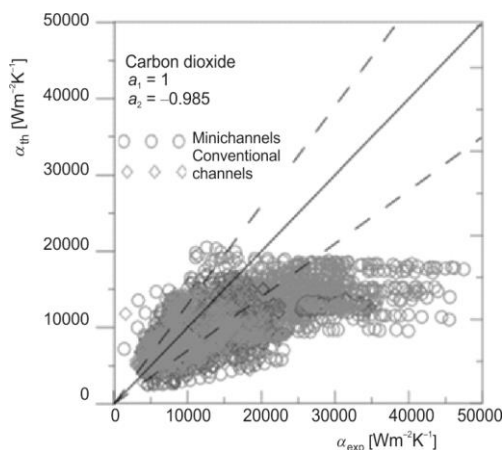

**Figure 6.** Comparison of the test results  $\alpha_{exp}$  with predictions  $\alpha_{th}$  using eq. (12) for CO<sub>2</sub> at  $a_1 = 1$  and  $a_2 = -0.985$

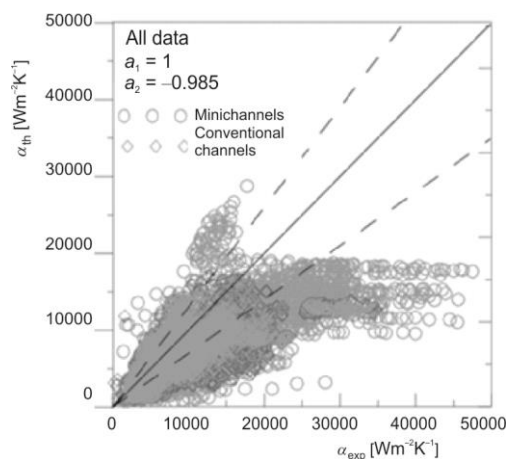

**Figure 7.** Comparison of the test results  $\alpha_{exp}$  with predictions  $\alpha_{th}$  using eq. (12) for CO<sub>2</sub> at  $a_1 = 1$  and  $a_2 = -0.985$


**Table 4.** The values of mean absolute error for the model described by eq. (12)

| Group of refrigerants | MAE [%] |
|-----------------------|---------|
| Synthetic             | 25.20   |
| Natural               | 22.40   |
| CO <sub>2</sub>       | 31.14   |
| All data              | 28.20   |

Furthermore, it should be added that in addition to reducing the average relative error, the amount of experimental data falling within the error limits of  $\pm 30\%$  in relation to the original form of the model adopted for analysis also increased. For the case of considered group of fluids, synthetic refrigerants data it amounts to 70%, natural refrigerants data it amounts to 76% and CO<sub>2</sub> data it amounts to 52%. The histogram of deviations for all experimental data is presented in fig. 8.

## Conclusions

The paper presents the analysis of the results of flow boiling calculations using the authors' own model to predict the heat transfer coefficient in a wide range of reduced pressures. The special correction has been postulated to the in-house model of flow boiling and condensation in which modified was the two-phase flow multiplier. Eight two-phase flow multiplier models were tested for this purpose, *i. e.* due to Muller-Steinhagen and Heck, modified Muller-Steinhagen and Heck, Zhang and Webb, Cioncolini *et al.*, Sempertegui-Tapia and Ribatski, Tran, Friedel and finally Muller-

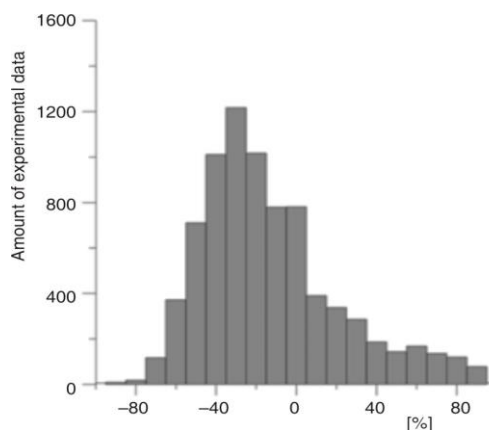

**Figure 8.** Histogram of deviations of the results  $\alpha_{th}$



Steinhagen and Heck in-house modification with the effect of reduced pressure. The model has been tested against a large selection of experimental data collected from various researchers to investigate the sensitivity of the in-house developed model. The collected experimental data were conducted for the full range of quality variation and a wide range of mass velocity and saturation temperature. The results show that change of the model which describes the two-phase flow multiplier is significant in the case of CO<sub>2</sub>, where the best compliance with experimental data obtained using the Tran correlation. The results also show that taking into account appropriate two-phase multiplier model and reduced pressure effects can significantly contribute to the convergence with experimental data compared to the original model. In the authors' opinion, the proposed method to calculate the heat transfer coefficient is a reliable tool in engineering calculations. An example of an application can be found in [54-56].

### Acknowledgment

Results presented in the paper have been funded from the project 2017/25/B/ST8/00755 by the National Science Centre, Poland.

### Nomenclature

Bo – boiling number, ( $= q/Gh_{ig}$ ), [-]  
 C – mass concentration of droplets in two-phase core, [-]  
 Con – confinement number, ( $= 1/d_h[\sigma g(\rho_l - \rho_g)]^{1/2}$ ), [-]  
 $c_p$  – specific heat, [ $Jkg^{-1}K^{-1}$ ]  
 $d_h$  – hydraulic diameter, [m]  
 G – mass flux, [ $kgm^{-2}s^{-1}$ ]  
 h – heat transfer coefficient, [ $Wm^{-2}K^{-1}$ ]  
 $h_{ig}$  – specific enthalpy of vaporization, [ $Jkg^{-1}$ ]  
 M – molecular weight, [ $kgkmol^{-1}$ ]  
 MAE – mean absolute error, [%]  
 Nu – Nusselt number, ( $= ad_h/\lambda$ ), [-]  
 P – empirical correction, [-]  
 p – pressure, [Pa]  
 q – heat flux, [ $Wm^{-2}$ ]  
 Re – Reynolds number, ( $= Gd_h/\mu$ ), [-]  
 T – temperature, [K]  
 x – quality, [-]

$\sigma$  – surface tension, [ $Nm^{-1}$ ]  
 $\lambda$  – thermal conductivity, [ $Wm^{-1}K^{-1}$ ]  
 $\rho$  – density, [ $kgm^{-3}$ ]  
 $\mu$  – dynamic viscosity, [Pa s]  
 $\phi_{LO}^2$  – two-phase flow multiplier, [-]

#### Subscripts

crit – critical  
 exp – experimental  
 g – vapor  
 GO – total vapour flow rate  
 l – liquid  
 LO – total liquid flow rate  
 Pb – pool boiling  
 r – reduced  
 sat – saturation  
 th – theoretical

#### Acronyms

ODP – Ozone Depletion Potential [-]  
 GWP – Global Warming Potential [-]  
 TBP – two-phase boiling  
 TP – two-phase

### References

- [1] \*\*\*, United Nations Environment Program (UNEP) Montreal Protocol on Substances that Deplete the Ozone Layer, 1997 (Final Act. United Nations, New York, USA)
- [2] Ghodbane, M., An Investigation of R152a and Hydrocarbon Refrigerants in Mobile Air Conditioning, *Proceedings*, International Congress and Exposition, Detroit, Mich., USA, 1999, No. 1999-01-0874
- [3] Cheng, L., *et al.*, New Prediction Methods for CO<sub>2</sub> Evaporation Inside Tubes: Part II – An Updated General Flow Boiling Heat Transfer Model Based on Flow Patterns, *Int. J. Heat Mass Transf.*, 51 (2008), 1-2, pp. 125-135
- [4] Mikielwicz, D., Jakubowska, B., Prediction of Flow Boiling Heat Transfer Coefficient for Carbon Dioxide in Mini-Channels and Conventional Channels, *Arch. Thermodyn.*, 37 (2016), 2, pp. 89-106

- [5] Mikielwicz, D., Jakubowska, B., The Effect of Reduced Pressure on Carbon Dioxide Flow Boiling Heat Transfer in Mini-Channels, *E3S Web Conf.*, 70 (2018), 2012
- [6] Mikielwicz, D., Jakubowska, B., Prediction of Flow Boiling Heat Transfer Data for R134a, R600a and R290 in Mini-Channels, *Arch. Thermodyn.*, 35 (2014), 4, pp. 97-114
- [7] Wongwiess, S., Chimres, N., Experimental Study of Hydrocarbon Mixtures to Replace HFC-134a in a Domestic Refrigerator, *Energ. Convers. Manag.*, 46 (2005), 1, pp. 85-100
- [8] Mikielwicz, D., Jakubowska, B., Calculation Method for Flow Boiling and Flow Condensation of R134a and R1234yf in Conventional and Small Diameter Channels, *Polish Marit. Res.*, 24 (2017), Special Issue 2017 S1 (93), pp. 141-148
- [9] Azzolin, M., et al., Flow Boiling Heat Transfer of a Zeotropic Binary Mixture of New Refrigerants Inside a Single Microchannel, *Int. J. Therm. Sci.*, 110 (2016), Dec., pp. 83-95
- [10] Sempertegui-Tapia, D. F., et al., Two-Phase Frictional Pressure Drop in Horizontal Micro-Scale Channels: Experimental Data Analysis and Prediction Method Development, *Int. J. Refrig.*, 79 (2017), July, pp. 143-163
- [11] Ribatski, G., A Critical Overview on the Recent Literature Concerning Flow Boiling and Two-Phase Flows Inside Micro-Scale Channels, *Exp. Heat Transf.*, 26 (2013), 2-3, pp. 198-246
- [12] Kharangate, C. R., Mudawar, I., Review of Computational Studies on Boiling and Condensation, *Int. J. Heat Mass Transf.*, 108 (2017), Part A, pp. 1164-1196
- [13] Cheng, L., Xia, G., Fundamental Issues, Mechanisms and Models of Flow Boiling Heat Transfer in Microscale Channels, *Int. J. Heat Mass Transf.*, 108 (2017), Part A, pp. 97-127
- [14] Ong, C. I., Thome, J. R., Flow Boiling Heat Transfer of R134a, R236f and R245fa in a Horizontal 1.030 Mm Circular Channel, *Exp. Therm. Fluid Sci.*, 33 (2009), 4, pp. 651-663
- [15] Mikielwicz, J., Semi-Empirical Method of Determining the Heat Transfer Coefficient for Subcooled Saturated Boiling in a Channel, *Int. J. Heat Transf.*, 17 (1973), 10, pp. 1129-1134
- [16] Mikielwicz, D., Mikielwicz, J., A Common Method for Calculation of Flow Boiling and Flow Condensation Heat Transfer Coefficients in Mini-Channels with Account of Nonadiabatic Effects, *Heat Transf. Eng.*, 32 (2011), 13-14, pp. 1173-1181
- [17] Mikielwicz, D., et al., Improved Semi-Empirical Method for Determination of Heat Transfer Coefficient in Flow Boiling in Conventional and Small Diameter Tubes, *Int. J. Heat Mass Transf.*, 50 (2007), 19-20, pp. 3949-3956
- [18] Mikielwicz, D., et al., A General Method for Calculation of Two-Phase Flow Pressure Drop in Flow Boiling and Flow Condensation, *Proceedings, ECI 8<sup>th</sup> Int. Conference on Boiling and Condensation Heat Transfer*, Lausanne, Switzerland, 2012
- [19] Mikielwicz, D., et al., Analytical Model with Nonadiabatic Effects for Pressure Drop and Heat Transfer During Boiling and Condensation Flows in Conventional Channels and Mini-channels, *Heat Transf. Eng.*, 37 (2016), 13-14, pp. 1158-1171
- [20] Mikielwicz, J., Mikielwicz, D., A Simplified Energy Dissipation Based Model of Heat Transfer for Post-dryout Flow Boiling, *Int. J. Heat Mass Transf.*, 124 (2018), Sept., pp. 260-268
- [21] Muller-Steinhagen, H., Heck, K., A Simple Friction Pressure Drop Correlation for Two-phase Flow in Pipes, *Chem. Eng. Process*, 20 (1986), 6, pp. 197-308
- [22] Mikielwicz, D., A New Method for Determination of Flow Boiling Heat Transfer Coefficient in Conventional Diameter Channels and Mini-Channels, *Heat Transf. Eng.*, 31 (2010), 4, pp. 276-287
- [23] Zhang, M., Webb, R. L., Correlation of Two-phase Friction for Refrigerants in Small-Diameter Tubes, *Exp. Therm. Fluid Sci.*, 25 (2001), 3-4, pp. 131-139
- [24] Cioncolini, A., Unified Macro-to-Microscale Method to Predict Two-Phase Frictional Pressure Drops of Annular Flows, *Int. J. Multiph. Flow*, 35 (2009), 12, pp. 1138-1148
- [25] Tran, T. N., et al., Two-Phase Pressure Drop of Refrigerants During Flow Boiling in Small Channels: An Experimental Investigation and Correlation Development, *Int. J. Refrig.*, 26 (2000), 11, pp. 1739-1754
- [26] Friedel, L., Improved Friction Pressure Drop Correlations for Horizontal and Vertical Two-Phase Pipe Flow, *Proceedings, European Two-Phase Flow Group Meeting*, Ispra, Italy, 1979, Paper E2

- [27] Kundu, A., *et al.*, Heat Transfer Characteristic and Flow Pattern During Two-Phase Flow Boiling of R134a and R407C in a Horizontal Smooth Tube, *Exp. Therm. Fluid Sci.*, 57 (2014), Sept., pp. 344-352
- [28] Xu, Y., *et al.*, An Experimental Study of Flow Boiling Frictional Pressure Drop of R134a and Evaluation of Existing Correlations, *Int. J. Heat Mass Transf.*, 98 (2016), July, pp. 150-163
- [29] Mancin, S., *et al.*, R134a Flow Boiling Heat Transfer Coefficient and Pressure Drop Inside 3.4 Mm ID Microfin Tube, *Energy Procedia*, 45 (2014), Dec., pp. 6098-615
- [30] Tibirica, C. B., Ribatski, G., An Experimental Study on Flow Boiling Heat Transfer of R134a in a 2.3 Mm Tube, *Int. J. Microsc. Nanosc. Therm. Fluid Transp. Phenom.v*, 1 (2010), Feb., pp. 37-58
- [31] Owhaib, W., Experimental Heat Transfer, Pressure Drop, and Flow Visualization of R-134a in Vertical Mini / Micro Tubes, Ph. D thesis, School of Industrial Engineering and Management, Energy Technology, Applied Thermodynamics and Refrigeration, KTH, Stockholm, Sweden 2007
- [32] Shiferaw, D., *et al.*, Flow Boiling in a 1.1 mm Tube with R134a: Experimental Results and Comparison with Model, *Int. J. Therm. Sci.*, 48 (2009), 2, pp. 331-341
- [33] Martin-Callizo, C., *et al.*, New Experimental Results of Flow Boiling of R134a in Vertical Microchannel, *Proceedings*, Heat Transfer Conference Proceedings, Edinburgh, UK, 2007
- [34] Consolini, L., Thome, J. R., Micro-Channel Flow Boiling Heat Transfer of R134a, R236fa and R245fa, *Microfluid Nanofluid*, 6 (2009), 6, pp. 731-746
- [35] Mahmoud, M. M., *et al.*, Single and Two Phase Heat Transfer and Pressure Drop in a 0.52 mm Vertical Metallic Tube, *Proceedings*, 7<sup>th</sup> Int. Conference in Enhanced, Compact and Ultra-compact Heat Exchangers: From Microscale Phenomena to Industrial Applications, Heredia, Costa Rica
- [36] Anwar, Z., Flow Boiling Heat Transfer, Pressure Drop and Dryout Characteristics of Low GWP Refrigerants in a Vertical Mini-Channel, Ph. D. thesis, Royal Institute of Technology, Stockholm, Sweden, 2014
- [37] Del Col, D., *et al.*, Flow Boiling of R1234yf in a 1 mm Diameter Channel, *Proceedings*, 23<sup>rd</sup> IIR International Congress of Refrigeration, Prague, Czech Republic, 2011
- [38] Choi, K.-I., *et al.*, Boiling Heat Transfer of R22, R134a and CO<sub>2</sub> in Horizontal Smooth Mini-Channels, *Int. J. Refrig.*, 30 (2007), 8, pp. 1336-1346
- [39] Diani, A., *et al.*, Flow Boiling Heat Transfer of R1234yf Inside 3.4 mm ID Microfin Tube, *Exp. Therm. Fluid Sci.*, 66 (2015), Sept., pp. 127-136
- [40] Wang, C. C., *et al.*, Visual Observation of Two-Phase Flow Pattern of R-22, R-134a, and R-407C in a 6.5-mm Smooth Tube, *Exp Therm. Fluid Sci.*, 15 (1997), 4, pp. 395-405
- [41] Pamitran, A. S., *et al.*, Evaporation Heat Transfer Coefficient in Single Circular Small Tubes for Flow Natural Refrigerants of C3H8, NH<sub>3</sub> and CO<sub>2</sub>, *Int. Multiph. Flow*, 37 (2011), 7, pp. 794-801
- [42] Pamitran, A. S., *et al.*, Characteristics of Two-Phase Flow Pattern Transitions and Pressure Drop of Five Refrigerants in Horizontal Circular Small Tubes, *Int. J. Refrig.*, 33 (2010), 3, pp. 578-588
- [43] Docoulombier, M., *et al.*, Carbon Dioxide Flow Boiling in a Single Microchannel – Part II: Heat Transfer, *Exp. Therm. Fluid Sci.*, 35 (2011), 4, pp. 597-611
- [44] Mastrullo, R., *et al.*, Carbon Dioxide Heat Transfer Coefficients and Pressure Drops During Flow Boiling: Assessment of Predictive Methods, *Int. J. Refrig.*, 33 (2010), 6, pp. 1068-1085
- [45] Oh, H.-K., Son, C. H., Flow Boiling Heat Transfer and Pressure Drop Characteristics of CO<sub>2</sub> in Horizontal Tube of 4.57 mm Inner Diameter, *Appl. Therm. Eng.*, 31 (2011), 2-3, pp. 163-172
- [46] Dang, C., *et al.*, Flow Boiling Heat Transfer of Carbon Dioxide Inside a Small-Sized Microfin Tube, *Int. J. Refrig.*, 33 (2010), 4, pp. 655-663
- [47] Zhao, X., Bansal, P. K., Flow Boiling Heat Transfer Characteristic of CO<sub>2</sub> at Low Temperatures, *Int. J. Refrig.*, 30 (2007), 6, pp. 937-945
- [48] Tibirica, C. B., *et al.*, Experimental Investigation of Flow Boiling Pressure Drop of R134q in Microscale Horizontal Smooth Tube, *J. Therm. Sci. Eng. Appl.*, 3 (2011), 1, pp. 11006-1-11006-8
- [49] Mikielwicz, D., Jakubowska, B., Comparison of Predictive Methods for Flow Boiling Heat Transfer in Conventional Channels and Mini-channels - The Effect of Reduced Pressure, *MATEC Web Conf.*, 240 (2018), 1028



- [50] Kew, P. A., Cornwell, K., Correlations for the Prediction of Boiling Heat Transfer in Small Diameter Channels, *Appl. Therm. Eng.*, 17 (1997), 8-10, pp. 705-715
- [51] Belyaev, A. V., *et al.*, An Experimental Study of Flow Boiling in Mini-Channels at High Reduced Pressure, *Int. J. Heat Mass Transf.*, 110 (2017), July, pp. 360-373
- [52] Mauro, A. W., Flow Boiling of Refrigerants: From Low to High Reduced Pressure, *Proceedings*, UIT Summer School, Siena, Italy, 2017
- [53] Cooper, M. G., Saturation Nucleate Pool Boiling-a Simple Correlation, *Int. Chem. Eng. Symp. Ser.*, 86 (1984), Dec., pp. 785-792
- [54] Wajs, J., *et al.*, Performance of the Domestic Micro ORC Equipped with the Shell-and-Tube Condenser with Mini-Channels, *Energy*, 157 (2018), Aug., pp. 853-861
- [55] Andrzejczyk, R., *et al.*, Experimental Investigations on Adiabatic Frictional Pressure Drops of R134a During Flow in 5 mm Diameter Channel, *Exp. Therm. Fluid Sci.*, 83 (2016), May, pp. 78-87
- [56] Muszynski, T., *et al.*, Detailed Experimental Investigations on Frictional Pressure Drop of R134a During Flow Boiling in 5 mm Diameter Channel: The Influence of Acceleration Pressure Drop Component, *Int. J. Refrig.*, 82 (2017), Oct., pp. 163-173

