

The evaluation of COD fractionation and modeling as a key factor for appropriate optimization and monitoring of modern cost-effective activated sludge systems

Jakub Drewnowski, Anna Remiszewska-Skwarek, Sylwia Fudala-Ksiazek, Aneta Luczkiewicz, Sheena Kumari, and Faizal Bux

This page lists questions we have about your paper. The numbers displayed at left are hyperlinked to the location of the query in your paper.

The title and author names are listed on this sheet as they will be published, both on your paper and on the Table of Contents. Please review and ensure the information is correct and advise us if any changes need to be made. In addition, please review your paper as a whole for typographical and essential corrections.



Your PDF proof has been enabled so that you can comment on the proof directly using Adobe Acrobat. For further information on marking corrections using Acrobat, please visit <http://journalauthors.tandf.co.uk/production/acrobat.asp>; <https://authorservices.taylorandfrancis.com/how-to-correct-proofs-with-adobe/>

The CrossRef database (www.crossref.org/) has been used to validate the references.

AUTHOR QUERIES

- Q1** Please note that the original references [15] and [46] are identical hence the latter one has been deleted. Please check.
- Q2** Please provide the in-text citation for reference [45] or delete the reference from the list.
- Q3** The ORCID details of the authors have been validated against ORCID registry. please check the ORCID ID details of the authors.

The evaluation of COD fractionation and modeling as a key factor for appropriate optimization and monitoring of modern cost-effective activated sludge systems

Q3 Jakub Drewnowski^a , Anna Remiszewska-Skwarek^b , Sylwia Fudala-Ksiazek^a, Aneta Luczkiewicz^a, Sheena Kumari^c, and Faizal Bux^c

^aFaculty of Civil and Environmental Engineering, Gdansk University of Technology, Gdansk, Poland; ^bWater and Sewage Management Utility Ltd. in Gdynia, Gdynia, Poland; ^cInstitute for Water and Wastewater Technology, Durban University of Technology, Durban, South Africa

ABSTRACT

A study was conducted to characterize the raw wastewater entering a modern cost effective municipal WWTP in Poland using two approaches; 1) a combination of modeling and carbonaceous oxygen demand (COD) fractionation using respirometric test coupled with model estimation (RT-ME) and 2) flocculation/filtration COD fractionation method combined with BOD measurements (FF-BOD). It was observed that the particulate fractions of COD obtained using FF-BOD method was higher than those estimated by RT-ME approach. Contrary to the above, the values of inert soluble fraction evaluated by FF-BOD method was significantly lower than RT-ME approach (2.4% and 3.9% respectively). Furthermore, the values for low colloidal and particulate fractions as well as soluble inert fractions were different than expected from a typical municipal wastewater. These observations suggest that even at low load (10% of the total wastewater treatment inflow), the industrial wastewater composition can significantly affect the characteristics of municipal wastewater which could also affect the performance and accuracy of respirometric tests. Therefore, in such cases, comparison of the respirometric tests with flocculation/filtration COD/BOD measurements are recommended. Oxygen uptake rate profile with settled wastewater and/or after coagulation-flocculation, however, could still be recommended as a "rapid" control method for monitoring/optimising modern cost-effective wastewater treatment plants.

Introduction

In the last 15 years, from 2004 onwards, when Poland was still a part of European Union (EU), the Polish National Program for Municipal Wastewater Treatment Plants (MWWTP) have aimed for identifying and solving wastewater treatment and management problems in Poland. This program was conducted with the aim of modernizing or expanding nearly 600 WWTP already identified and also constructing nearly 200 new facilities with a total population equivalent (PE) representing almost 97% of the total PE of the Polish National Program for MWWTP.^[1] In large facilities (more than 100,000 PE) such as Gdynia-Debogorze WWTP, in order to achieve the high quality effluent standards defined by the EU regulations, an intense process modification was recommended. However, the main challenge was to develop modern and cost-effective activated sludge (AS) systems. In these circumstances, the appropriate characterization of raw wastewater has been identified as an important aspect and a key factor for the optimization of treatment processes and new reactor design. Operation of a typical MWWTP is usually controlled by parameters such as flow rate, solid retention time, concentration of ammonia

and dissolved oxygen etc. It is considered that, together with the chemical and biochemical oxygen demand (COD and BOD), the above parameters indirectly affect the performance of AS processes. In an aerobic AS system the BOD5: N ratio is recommended to be 100:5 in order to avoid nutrient deficiency.^[2,3] A high influent C:N ratio (e.g. 100:10) could negatively affect the nutrient removal efficiencies of the treatment plant, however, depending on the quality of the carbon source it could vary remarkably.^[4] Particularly, the BOD indicates the amount of organic pollutants that can be biologically degraded, however, in reality, BOD measurement is inadequate to define the actual biodegradation kinetics of all organic compounds present in wastewater. In contrast, the use of effluent soluble COD for estimating the yield coefficient and decay rate is in practise, however, is not valid under many practical conditions, since the concentration of the influent wastewater is much higher than that of the effluent concentration. Moreover, the particulate COD as slowly biodegradable organics can exhibit a significant effect on the determination of kinetic coefficients, e.g., the specific substrate removal rate for the multiple substrate hydrolysis model and the first-order rate constant. Additionally, particulate compounds can be related to a

58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100
101
102
103
104
105
106
107
108
109
110
111
112
113
114

115 wide range of physical-chemical and biological phenomena
116 in conventional wastewater treatment systems which
117 demand the need for more research on the proper methods
118 for determination of COD fractionation as a key factor for
119 appropriate modeling and monitoring of activated sludge
120 processes. Thus, among several parameters, COD fractionation
121 has become an important criterion for the development
122 of efficient nutrients removal AS systems in Poland. In
123 such circumstances, special attention has been paid to the
124 slowly biodegradable fractions, essential to design an effective
125 technology for wastewater treatment, mainly denitrification
126 and Enhanced Biological Phosphorus Removal (EBPR).

127 The Activated Sludge Models^[5,6] commonly used by IWA
128 Task Group, are developed based on the COD fractionation,
129 nevertheless, a proper evaluation of COD fractionation, which
130 is crucial for modeling and model predictions, is still under
131 debate. In general, total COD in the wastewater consists of:
132 readily (soluble) biodegradable organic substrates (S_S), slowly
133 (particulate) biodegradable substrates (X_S), inert suspended
134 organic matter (X_I), and inert soluble organic matter (S_I).^[6]
135 There are two main approaches for determining the COD
136 fraction in wastewater; 1) based on their physical-chemical
137 properties^[7] and 2) microbial growth kinetics, viz., respirometric
138 test based on oxygen uptake rate (OUR) and COD
139 measurements.^[8] Respirometric method was first introduced
140 by Ekama et al.^[9] in the 70's of the last century and are still
141 being used by many researchers. It is used mainly for determining
142 S_S , whether X_S requires simulation modeling, which is
143 adjusted to the batch experimental data. Additionally, the
144 respirometric approach is highly influenced by experimental
145 conditions and therefore to be reliable, it should be carried
146 out with precision and careful maintenance. Alternatively,
147 physico-chemical method, which is based on physical (particle
148 size) and chemical (coagulation/flocculation) properties of
149 organic matter present in wastewater are used. The disadvantage
150 of this method is connected with imprecise definition of
151 colloidal organic matter, which may contribute to both readily
152 and slowly biodegradable fractions. Thus modification of
153 physico-chemical method was proposed by Roeleveld and
154 Loosdrecht,^[10] which combined flocculation and filtration
155 steps with BOD measurements (STOWA protocol).

156 The aim of this study was therefore to evaluate and compare
157 the COD fractionation method for a municipal wastewater
158 treatment plant using respirometric batch tests combined
159 with model estimation (RT-ME approach) and flocculation/
160 filtration COD method combined with BOD measurements
161 (FF-BOD approach). The first method measures biomass
162 activity *in situ* and is expressed by changes in the dissolved
163 oxygen (DO) and the results are compared with COD
164 measurements. In the second method, the characterization
165 of COD into readily, slowly and non-biodegradable
166 fractions is achieved indirectly, which involves physical-
167 chemical and biological processes. The COD fractionation
168 and modeling results obtained were discussed and compared
169 in terms of appropriate prediction of the effectiveness of
170 organic carbon, nitrogen and phosphorus removal in
171 activated sludge processes which forms a key factor for
172 process optimization in modern cost-effective WWTPs.

174 Material and methods

175 The wastewater and activated sludge samples were obtained
176 from Gdynia-Debogorze WWTP, which receives mainly
177 municipal wastewater (only 10% of industrial wastewater in
178 the total inflow) with a pollutant load corresponding to
179 420,000 PE and an average flow rate of $Q_{av} = 55\ 000\ m^3/d$.
180 Twenty-four-hour composite samples of influent wastewater
181 were taken after fine screening and/or after primary clarifier,
182 while the final effluent samples were collected at the outlet
183 of the secondary sedimentation tanks. Wastewater samples
184 were collected for about 8–9 months for each study period,
185 representing different sessions of the year from September
186 2009 to May 2010 for RT-ME approach, and from February
187 to September 2015 for FF-BOD approach. The raw wastewater
188 was characterized by total COD value ($COD_{T,influent}$).
189 Additionally, the Gdynia-Debogorze WWTP is equipped
190 with a brand new computer controlled automation system,
191 where, information from field controllers and online probes
192 are directed to the central control room. The computer network
193 includes all the instrumentation system, which consists
194 of 21 field controllers and operator station SCADA 4. Each
195 controller supports one separate area of technology and are
196 located at different points of the plant. More information
197 about process configuration, operational conditions and control
198 system are available from Drewnowski et al.^[11]

199 Evaluation of COD fraction using the flocculation/ 200 filtration COD method combined with BOD 201 measurements (FF-BOD approach)

202 The FF-BOD approach was carried out using a modified
203 STOWA protocol.^[10] The total soluble organic fraction (S_T)
204 was determined as COD of raw wastewater after coagulation.
205 The inert (soluble) non-biodegradable organic fraction – S_I
206 was determined as COD of wastewater, biologically treated in
207 WWTP Gdynia-Debogorze – taken from the outlet of the
208 secondary sedimentation tanks, then coagulated and filtrated
209 through $0.45\ \mu m$ membrane filters. Additionally in raw
210 wastewater, the BOD was measured for a period of 20 days
211 (BOD_{20}). In the case of other COD fractions viz., S_S – readily
212 (soluble) biodegradable, X_S – slowly (particulate) biodegradable,
213 X_T – total particulate organic fraction, X_I – inert (particulate)
214 non-biodegradable and X_B – biomass were calculated
215 according to the conversion formulas set out in the
216 ATV-A113.^[11] Briefly, the fractions were calculated as: $S_S = S_T - S_I$,
217 X_S as: $X_S = BOD_{20} - S_S$, X_T as: $X_T = COD_{T,influent} - (S_S + X_S)$
218 and X_I as: $X_I = COD_{T,influent} - (S_S + X_S + X_B)$. In total,
219 the COD fractions were determined twenty-two times.

220 Evaluation of COD fraction using the respirometric tests 221 combined with model estimation (RT-ME approach)

222 The experimental set-up consisted of a computer controlled
223 batch reactor equipped with stirring and aeration systems,
224 thermostatic unit, DO, redox, and pH/temperature probes.
225 In order to eliminate the oxygen consumption via

Table 1. The fractionation procedure of COD in the raw/settled wastewater for the modeling evaluation based on the literature data and measurements carried out at "Gdynia-Debogorze" WWTP.

Measured parameters				
Definition	Symbol	Unit	Monthly average value raw/settled wastewater	Source of data
Influent COD	COD_{in}	$gCOD/m^3$	1078/856	Laboratory analyses at study WWTP
Influent COD in filtered sample	$COD_{f,in}$	$gCOD/m^3$	267/211*	
Volatile fatty acids	VFA	g/m^3	—/167	
Influent BOD_5	$BOD_{5,in}$	$gBOD_5/m^3$	472/319	
Influent biodegradable COD	$BCOD_{in}$	$gCOD/m^3$	806/545	Calculation (Grady et al. 1999) $BCOD_{in} = \frac{BCOD_{5,in}}{f_{BOD}(1 - Y_H \cdot f_p)}$
Effluent COD	COD_{out}	$gCOD/m^3$	25.4	Laboratory analyses at study WWTP
Effluent COD in filtered sample	$COD_{f,out}$	$gCOD/m^3$	20.5**	
BOD_5/BOD_U ratio	f_{BOD}	—	0.67	(Grady et al. 1999)
Heterotrophic biomass yield coefficient	Y_H	$gCOD/gCOD$	0.63	
Unbiodegradable fraction from the biomass decay	f_p	—	0.2	
Model components – raw/settled wastewater				
Average % of COD				
Fraction name	Symbol	Unit	Equation	This procedure / Calibration of SRT
Inert soluble	S_I	$gCOD/m^3$	$0.95 COD_{f,out}$	2.8
Readily biodegradable	S_S	$gCOD/m^3$	$COD_{f,out} - S_I$	22.8/21.8
Slowly biodegradable	X_S	$gCOD/m^3$	$BCOD_{in} - S_S$	51.9/41.8
Inert particulate	X_I	$gCOD/m^3$	$COD_{in} - COD_{f,in} - X_S$	22.5/33.6 / 26.5/36.6

Note:

*Measured by coagulation-flocculation method of Mamais et al. (1993) during batch tests.

**Correlated with daily measurements of $COD_{f,out}/COD_{out}$ ratio.

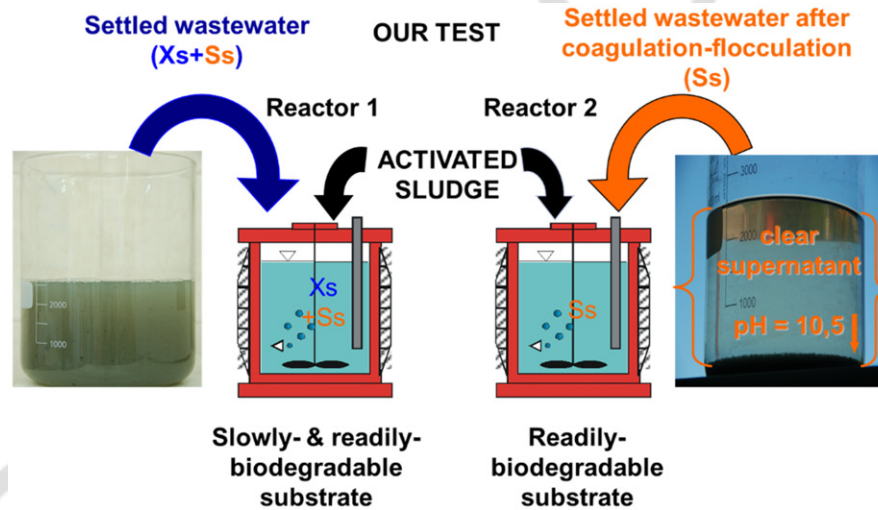


Figure 1. The experimental procedure with the coagulation-flocculation method^[15] to evaluate the contribution of $S_S/COD_{T,influent}$ by single respirometric tests.

nitrification, allylthiourea (ATU) was added to the reactor. The pH was kept in the range of 7.0 to 8.0 and the oxygen level in the reactor was controlled with a WTW Oxi-Stirrer 300 (magnetic stirrer) probes.

The oxygen utilization rate (OUR) was measured according to the method described by Kristensen et al.^[12] Activated sludge was tested with raw/settled wastewater (SWW), and after coagulation-flocculation in 4L batch reactors at 15.4–17.2 °C. The OUR was obtained by measuring the decrease in oxygen concentration every 3 min, with a constant oxygen supply every 10 s (6–7 mg/L oxygen was supplied to the system) for 6–7 h. The OUR was further calculated from the linear regression of the slope of the obtained curve. The fractionation of organic matter in the influent wastewater was performed according to the modified method of Grady et al.^[3] and Makinia.^[13] The

procedure was developed based on the Dutch STOWA standard guidelines for wastewater characterization (Table 1) with minor modifications. The standard laboratory analyses at Gdynia-Debogorze WWTP does not include the measurement of soluble COD. However, additional measurements were needed to analyze the contribution of S_S to $COD_{T,influent}$ for the respirometric tests combined with model estimation and the coagulation-flocculation method of Mamais et al.^[14] Figure 1 shows the experimental procedure with the coagulation-flocculation method of Mamais et al. (1993) to evaluate the contribution of $S_S/COD_{T,influent}$ by single respirometric tests. Additionally, the actual laboratory measurements of volatile fatty acids (VFA)s (assumed to be equal to S_A – fermentation products) were carried out from the samples of the SWW. The X_S/X_I ratio was estimated by calibrating the sludge retention time (SRT) in

Table 2. Results of the average COD fractionation determined by the flocculation/filtration COD method and respirometric test method in municipal wastewater in Gdynia-Debogorze WWTP.

Component	FF-BOD (flocculation/filtration COD) approach combined with BOD Average COD (range)		RT-ME approach combined with Dutch STOWA Average COD (range)	
	g O ₂ /m ³	%	g O ₂ /m ³	%
COD fraction in Gdynia-Debogorze WWTP				
S _i	27.0	2.4 (1.1–3.2)	42.0	3.9 (2.8*–4.9)
X _i	382.3	33.1 (8.3–62.7)	263.6	24.4 (12.8**–36.1)
S _s	200.0	18.1 (10.1–34.1)	292.1	27.1 (22.8*–31.3)
X _s	521.7	46.3 (22.0–71.4)	480.8	44.6 (37.3–51.9*)
Total COD	1130.9	100	1077.9	100

*Combined with the standard Dutch STOWA guidelines.

**Combined with model estimation proposed by Henze et al. (1999) according $ASM2d X_i = 0.128 \times COD_{T,influent}$.

modeling predictions. The results of the respirometric test were simulated by ASM2d to compare predictions in terms of OUR and COD behavior. The biodegradable COD fractionations were directly estimated during OUR batch tests. The soluble inert COD component (S_i) of SWW was determined according to Henze et al.^[15] In this approach, the COD fractionations were carried out sixteen times and evaluated by mathematical modeling and computer simulations.

Mathematical modeling and computer simulation

The mathematical modeling and computer simulation procedure were followed as described previously.^[1] Briefly, data sets obtained from the full-scale Gdynia-Debogorze WWTP were used for steady-state simulations in the software GPS-x ver. 5.0.2.^[16] The mathematical modeling and computer simulations were carried out based on the ASM2d model according to Henze et al.^[17] In order to perform accurate calibration, the data sets from both full-scale WWTP and laboratory batch tests were used from our previous study.^[1] The stoichiometric and kinetic parameters were determined by numerical optimization using the Nelder-Mead simplex method by Nelder and Mead.^[18] The respirometric batch tests (OUR and corresponding COD consumption for estimating fractionation) were carried out and the OUR, biodegradable substrates monitoring and the conditions of activated sludge were also determined. Once calibrated and validated, the model used in this study and the data collected previously during different seasons (Drewnowski et al.^[1]) were used to evaluate the performance of Gdynia-Debogorze WWTP as well as to validate the COD fractionation and modeling approach for appropriate optimization and monitoring of modern cost-effective activated sludge system.

Analytical methods

The COD, BOD₂₀, and TSS/VSS were determined according to Standard Methods (APHA, 2005). The total soluble COD fractions (S_T) and the inert (soluble) non-biodegradable organic fraction (S_i) in wastewater were also determined after coagulation with zinc sulfate (10% ZnSO₄, at pH = 10.5) followed by filtration through 0.45 μm membrane filters.^[14] The detailed procedure can be obtained from Makinia^[19] and Drewnowski et al.^[20]

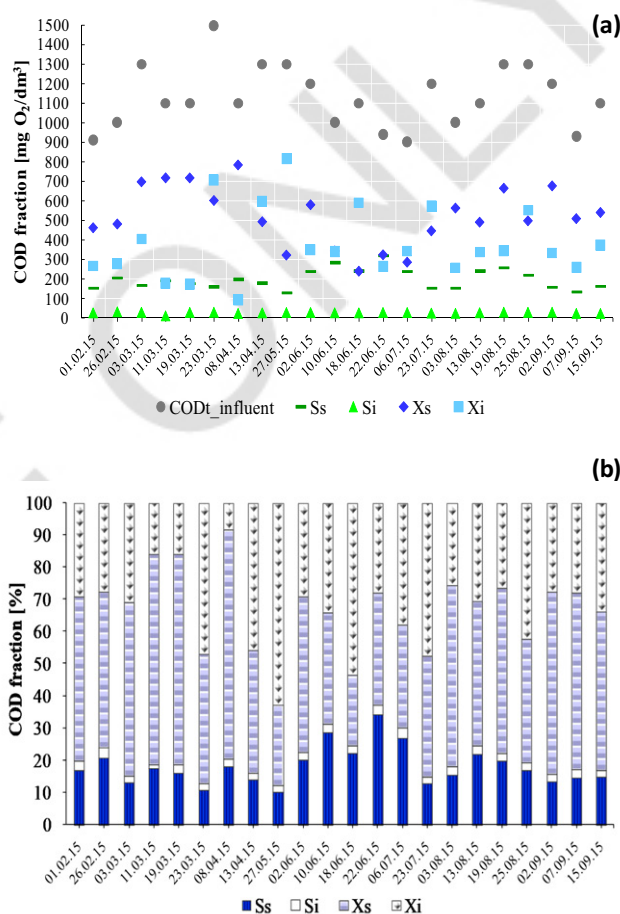


Figure 2. Values (a) and the ratio of COD fractions to COD_{T,influent} (b).

Results and discussion

In this study, the total influent COD (COD_{T,influent}) and COD fractionation of Gdynia-Debogorze MWWTP were determined by RT-ME (September 2009 to May 2010) and FF-BOD (February to September 2015) approaches. During the study period, the COD_{T,influent} values detected in raw wastewater varied from 750 to 1570 mg O₂/dm³ (average 1077.9 mg O₂/dm³) and 900 to 1500 mg O₂/dm³, (av. 1130.9 mg O₂/dm³), respectively (Table 2 and Figure 2a). These observed values were higher, in comparison to a typical municipal wastewater (av. 750 mg O₂/dm³).^[21] The higher COD value could be due to low water consumption or the influence of industrial wastewater. Though in Gdynia-Debogorze WWTP, the industrial wastewater

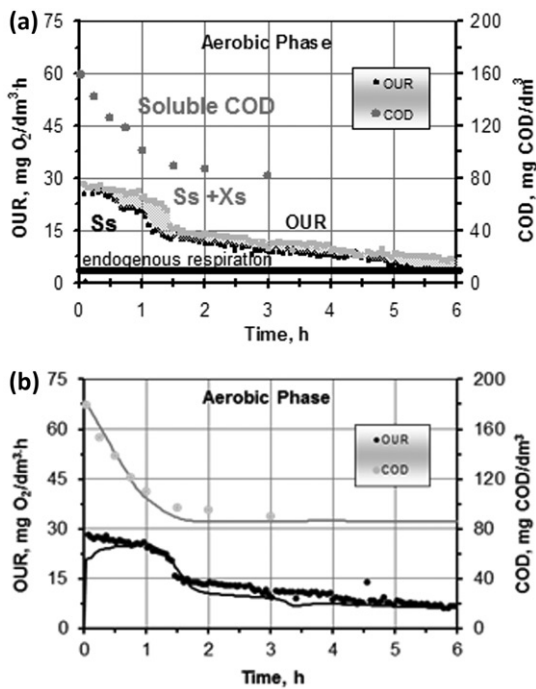


Figure 3. Results of the OUR and COD profiles during the respirometric batch test: a) the settled wastewater without pretreatment ($S_s + X_s$ - gray) and after coagulation-flocculation (only S_s - black) b) data vs. model predictions by ASM2d.

represents only 10% of the raw inflow, it could probably affect the quantity and quality of organic matter entering the plant. In such cases, reliable evaluation of COD fractionation is crucial for process optimization and model predictions.

COD fractionation determined by FF-BOD approach

The data obtained for $COD_{T,influent}$ and the FF-BOD approach are presented in the Figure 1a–b and in Table 2. The S_s fraction accounted from 10.1% to 34.1% of the $COD_{T,influent}$, with higher values observed for summer months (>20%; Figure 3a–b). This could be as a result of recreational activities in the studied area or due to the discharge of higher amount of typical domestic wastewater to the sewer during the summer season. In the case of S_i , it appeared to be the most stable fraction in the tested wastewater (1.1% to 3.2% of the $COD_{T,influent}$). The X_s together with X_i constituted the main fraction of total $COD_{T,influent}$ (av. 46.3% and 33.1%, respectively). Using a similar approach, a short term study conducted by Myszograj and Sadecka^[22] obtained the following values for COD fractions: $S_s = 23\text{--}29\%$, $S_i = 2\text{--}3\%$, $X_s = 51\text{--}56\%$, $X_i = 7\text{--}19\%$ of the $COD_{T,influent}$ which are slightly different from the current observations. It should be noted, however that besides duration, the above study was also differed in the size of the WWTP investigated, volume of wastewater treated and population equivalent (PE). Therefore, to reflect the impact of seasonal changes on wastewater quality and to understand the specificity of both WWTP catchment and sewer systems, a long-term study deem necessary.

COD fractionation determined by RT-ME approach

The measurement of COD by respirometric tests combined with model estimation showed similar differences in the raw and SWW in the amount of soluble COD fractions without pretreatment and also after coagulation-flocculation. However, in the amount of particulate COD fractions, more discrepancy for the X_s/X_i ratio was observed between the raw and SWW. After settling in primary clarifier, low X_s value was measured, which was a key factor for appropriate modeling of short- and long-SRT and monitoring of activated sludge processes. In a study, Ginestet et al.^[23] characterized raw wastewater originating from seven WWTPs in French. Respirometric measurements were carried out with samples of the raw, settled and “coagulated” (i.e. settled and precipitated with $FeCl_3$) wastewater. The latter group predominantly consisted of the readily hydrolyzable fractions (37–90%), whereas the readily biodegradable and inert fractions accounted for 2–27% and 2–47% of soluble COD respectively. Koch et al.^[24] found a poor correlation between soluble COD (after filtration on a 0.45 μm pore size filter) and S_s readily biodegradable COD (estimated based on aerobic respiration tests) under Swiss conditions, where the biodegradable fraction of wastewater primarily consisted of slowly biodegradable compounds X_s due to short hydraulic retention times in the sewer systems.

The aerobic batch respirometric test monitors the oxygen uptake rate (OUR), which indicates the oxygen consumption rate resulting from the microbial activity. In the current study, the total duration of each OUR test was about 6–7 h, however, approximately after 1 h, a sudden change in OUR plot was observed. Once the readily biodegradable compounds (S_s) were consumed, the OUR stabilized due to the switch to slowly biodegradable substrate (X_s) and endogenous respiration products (Figure 3a). In the experiments with the SWW, the observed OUR was found to be associated with the utilization of S_s in soluble form as well as colloidal and particulate organic compounds (X_s). By taking the VSS into account (average value 256 mg/L), the specific OUR for a particular activated sludge was obtained. The maximum OUR values with the SWW varied within the range of 19.0–24.2 g O₂/(kg VSS·h) respectively, in the studied WWTP. In comparison with the values reported for the OUR experiments^[25] with real wastewater and activated sludge from a pilot-scale plant, the results from this study varied around the level of 20 mg O₂/gVSS·h. When the pretreated samples of wastewater were used in the experiments, the observed OUR was found to be associated with the utilization of S_s and the remaining colloidal organic fraction (part of X_s). Consequently, the values of OUR from studied plant were lower (11.8–17.8 g O₂/(kg VSS·h) in comparison with the parallel tests with the SWW. The average difference of OUR profiles observed between the parallel reactors with the SWW without and with pretreatment were between 30 and 50% in comparison to the most extreme cases.

The results of OUR and COD during the respirometric batch test vs. model predictions by ASM2d are shown in Figure 3a–b. Additional profiles of pH and ORP during the respirometric batch test are presented in Figure 3a–b. Based

587
588
589
590
591
592
593
594
595
596
597
598
599
600
601
602
603
604
605
606
607
608
609
610
611
612
613
614
615
616
617
618
619
620
621
622
623
624
625
626
627
628
629
630
631
632
633
634
635
636
637
638
639
640
641
642
643
644
645

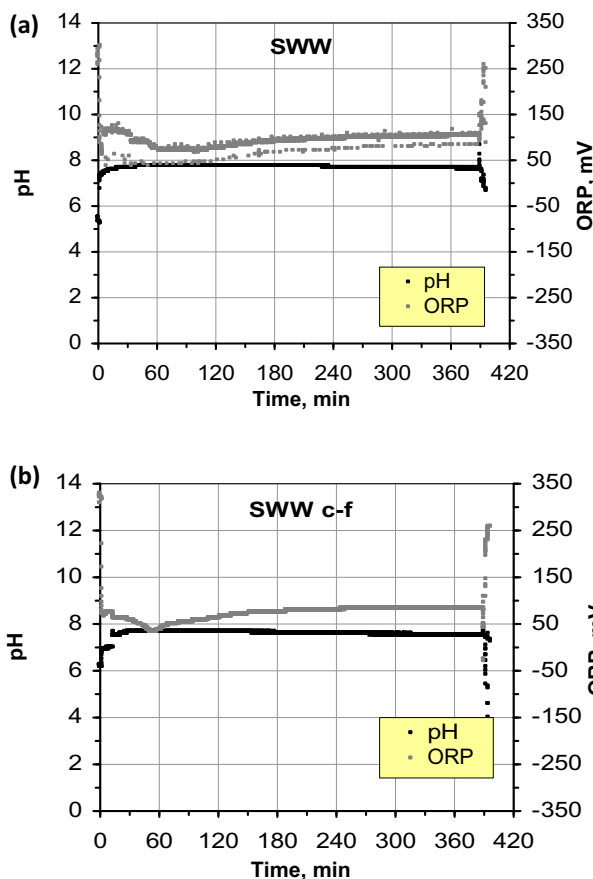


Figure 4. Profiles of pH and ORP during the respirometric batch test: a) the settled wastewater without pretreatment, b) the settled wastewater after coagulation-flocculation.

on the results obtained, it can be observed that duration of OUR tests (6–7 h in total) in some cases could be extended, so that the biodegradation of slowly hydrolyzable fraction as well as other form of COD continues. Describing the ORP and pH values during the respirometric batch test, it should be noted that the pH remained stable for about 7.8–7.9 for both investigated samples, i.e., the SWW without pretreatment and after coagulation-flocculation. However, the ORP values decreased from 100 mV to 50 mV in the initial feeding hour due to the rapid degradation of readily biodegradable substrates. Once the readily biodegradable COD fractions (mostly S_S and partly X_S after hydrolysis process conversion) were utilized, conditions were reestablished and the ORP increased from 50 mV to 100 mV reaching a steady-state, which is similar to the value obtained during the initial-stage tests.

The effect of primary clarifiers and precipitation on COD removal in the SWW and after coagulation-flocculation (c-f) using the method of Mamais et al.^[14] are shown in Figure 5a–b. The soluble fraction in the 24-h wastewater samples used in the experiments accounted for 23 to 46% of $COD_{T,influent}$ in the tested (16 samples) SWW. The average values of total and soluble COD in SWW determined (c-f) from the annual routine operational data were slightly different from the raw wastewater concentrations, i.e. 751 and 168 g COD/m³ (2009) vs. 788 and 167 g COD/m³ (2010). In an earlier modeling study,^[13] the estimated ratio of

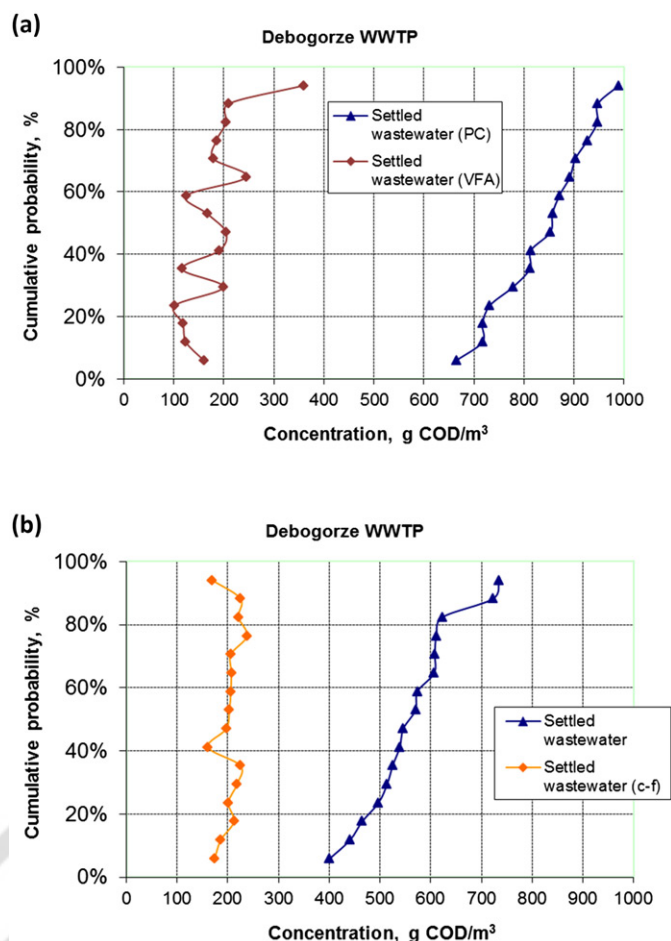


Figure 5. The effect of (a) primary clarifiers (PC) with volatile fatty acid (VFA) release and (b) precipitation on COD removal in the settled wastewater and after coagulation-flocculation (c-f).

biodegradable to non-biodegradable particulate (and colloidal) organic fractions varied in the range of 1.4–1.5 to fit the waste activated sludge (WAS) production. As a consequence, the ratios of ($S_S/(S_S+X_S)$) at the Gdynia-Debogorze WWTP (0.50–0.54) slightly exceeded a typical range of 0.3–0.5. Specifically, in a WWTP the successful settling has been described to be highly dependent on floc density, size and chemical composition.^[26] These characteristics are in turn dependent on factors such as the retention time of solids,^[27,28] oxygen concentration,^[29] predator grazing effects,^[30] levels of filamentous bacteria^[31] and floc size.^[32]

From a practical point of view, it should be noted that the conventional chemical precipitation with $FeCl_3$ has very similar effects as the method of Mamais et al.^[14] In a full-scale WWTP using $FeCl_3$ to precipitate SWW, Xu and Hultman^[33] found no difference in COD determined in the samples of SWW (untreated and treated with $ZnSO_4$). Due to sedimentation in the primary clarifiers, the ratio of particulate (and colloidal) COD (XCOD) to volatile suspended solids (VSS) increased from 1.67–2.58 g COD/g (raw wastewater) to 1.83–2.68 g COD/g (SWW). This indicates that a VSS fraction with a low COD/VSS ratio, such as particulate carbohydrates^[34] was removed in the primary clarifiers (Figure 4b). The clarifiers are operated with a high sludge blanket level to hydrolyze settleable organic particulates to

646
647
648
649
650
651
652
653
654
655
656
657
658
659
660
661
662
663
664
665
666
667
668
669
670
671
672
673
674
675
676
677
678
679
680
681
682
683
684
685
686
687
688
689
690
691
692
693
694
695
696
697
698
699
700
701
702
703
704

VFAs for enhancing denitrification and Enhanced Biological Phosphorus Removal (EBPR) in the bioreactor (Figure 5a). The above observations indicate that particulate compounds in wastewater may be related to a wide range of physical-chemical and biological phenomenon in conventional wastewater treatment systems. This warrants a pressing need for further research on the development of accurate methods for COD fractionation as a key factor for modeling and monitoring of activated sludge processes. Figure 5a–b is a typical example showing potential differences in precipitation on COD removal in the SWW and after coagulation-flocculation (c-f) representing conventional chemical precipitation in comparison to the effect of primary clarifiers (PC) with VFA in real conditions of WWTP operation strategy.

Comparison of FF-BOD and RT-ME approaches in determination of COD fractionation

COD fractionation has been described as a major challenge in conventional activated sludge systems: in solid and liquid separation in clarifiers,^[35] in nitrogen removal^[36] and in assessing the kinetics of NUR, PUR, AUR in biological reactors with different internal and external COD composition.^[19] The average values of COD fractions estimated during this study for Gdynia-Debogorze WWTP are presented in the Table 1.

Based on the results obtained, the particulate fractions of COD (X_S and X_I) in FF-BOD were higher than those estimated by RT-ME approach. Contrary to the above, the values of inert soluble fraction (S_I) evaluated by FF-BOD were significantly lower than in RT-ME approach (2.4% and 3.9% of $COD_{T,influent}$ respectively), suggesting that the evaluation of the inert COD amount in wastewater is significantly dependent on the method used for wastewater characterization. Similarly, S_S determined by the FF-BOD and RT-ME approaches differed, and accounted for 18.1% (10.1%–34.1%) and 27.1% (22.8%–31.3%) of $COD_{T,influent}$ respectively.

All COD fractions obtained in this study by RT-ME and FF-BOD approaches for raw wastewater corresponds to the ranges presented in literature of other European countries (S_S : 3.0%–35%; S_I : 2.0%–8.5%; X_S : 28%–66.2%, X_I : 10%–39%).^[10,37–42] However, the main challenge is the lack of standardized definition and methodology for COD fractionation. Inconsistency in the adopted methods by various researchers made the available literature results uncomparable. In this study, the discrepancies between the physico-chemical method and respirometric measurements could also be related to the essential content of industrial wastewater in municipal wastewater stream^[43] and the presence of soluble COD fractions with different degradation kinetics. For industrial wastewater, the truly soluble COD can be a sum of three fractions: inert (S_I), readily biodegradable (S_S) as well as rapidly (S_{RH}) and slowly (S_{SH}) hydrolyzable fraction.^[44]

In this study, the COD fractions obtained for Gdynia-Debogorze WWTP using the FF-BOD approach can be regarded as a close to real value. Due to the longer HRT (which is long enough for the degradation of slowly

hydrolyzable fractions) as well as application of coagulation/filtration procedure, it can be expected that both S_I and S_T fractions were determined with acceptable accuracy. Accordingly, other fractions (S_S , X_S , X_I) calculated on this basis of S_I and S_T fractions and BOD_{20} , are also expected to be properly estimated.

RT-ME approach is suitable to determine the adequate COD fractionation profile of a particular wastewater. However, when dealing with the industrial wastewater, special attention needs to be given for the proper estimation of S_I value as well as the low colloidal and particulate fraction as it can pass through the filter even after the coagulation. For the estimation of biodegradability, S_S results might be overestimated, as it probably happened in this study, since only coagulation-flocculation procedure was used. As both inert and easily biodegradable COD are essential for the prediction of wastewater treatment processes, for municipal wastewater that are influenced by industrial wastewater, a comparison of respirometric tests with results obtained from a long-term flocculation/filtration COD/BOD measurements can be made for better characterization. To confirm or exclude the presence of slowly hydrolyzable fraction, soluble and/or particulate, as well as the presence of biodegradable, low colloidal/particulate fraction, the RT-ME approach for raw wastewater, after coagulation/filtration can be considered for better profiling. Such data sets together with biological treatment efficiency and precise evaluation of industrial/municipal wastewater ratios may facilitate to maintain a constant high level of phosphorus and nitrogen removal from wastewater treatment plants and to develop efficient and cost effective wastewater treatment systems.

Conclusions

The discrepancies in results obtained between the physico-chemical method and respirometric measurements in determination of COD fractions in this study is suggested to be related to the contribution of the industrial wastewater load in municipal wastewater stream. Mainly, the low colloidal and particulate fractions as well as the soluble inert fraction related to a wide range of physical-chemical and biological phenomena may be present at different concentrations in the municipal wastewater. Thus as presented in this study more research on the proper methods for determination of COD fractionation as a key factor for appropriate modeling and monitoring of activated sludge processes deem necessary. As presented in this study, the comparison of the respirometric tests with the results obtained during flocculation/filtration COD/BOD measurements shown potential in proper fractionation of COD in municipal wastewater with industrial load. Such data sets and different methodology overview in comparison to traditional COD fractionation procedures together with the phosphorus release and denitrification efficiency may facilitate efficient optimization of the treatment processes at full scale level for better nutrient removal. Additionally, kinetic/stoichiometric coefficients in mathematical modeling and computer simulations might also play an important role in general estimation and

proposing a cost-effective global solution for worldwide “positive-energy” trends in municipal WWTPs.

Nowadays, carbon (C) extraction is achieved at a rate of 30% in the primary settler and have to be appropriately balanced between biogas production and efficiency of biochemical processes such as denitrification and EBPR in the activated sludge bioreactor. Therefore, the physico-chemical and biological characterization methods of COD fractionation compared in this study might be useful for the modeling approach as well as for monitoring and operating (e.g. short- and/or long- SRT activated sludge) modern WWTP. The wastewater characteristic (soluble, colloidal and particulate fractions) and loading of biodegradable organic compounds could affect the performance of conventional respirometric tests. However evaluation of the OUR profile with SWW and/or after coagulation-flocculation could still be recommended as a “rapid” control method for monitoring/optimising modern cost-effective WWTP.

ORCID

Jakub Drewnowski  <http://orcid.org/0000-0003-1424-0403>
Anna Remiszewska-Skwarek  <http://orcid.org/0000-0002-6875-4701>

References

[1] Drewnowski, J.; Remiszewska-Skwarek, A.; Fernandez-Morales, F. J. Model Based Evaluation of Plant Improvement at a Large Wastewater Treatment Plant (WWTP). *J. Environ. Sci. Health B*. **2018**, *53*, 669–675. DOI: [10.1080/10934529.2018.1438821](https://doi.org/10.1080/10934529.2018.1438821).

[2] Jenkins, D.; Richard, M. G.; Daigger, G. T. *Manual on the Causes and Control of Activated Sludge Bulking, Foaming, and Other Solids Separation Problems*, 3rd ed.; CRC Press LLC: Boca Raton, **2004**.

[3] Grady, C. P. L.; Daiger, G. T.; Lim, H. C. *Biological Wastewater Treatment*, 2nd ed.; Marcel Dekker, Inc.: New York, Basel, **1999**.

[4] Tardy, G. M.; Bakos, V.; Jobbagy, A. Conditions and Technologies of Biological Wastewater Treatment in Hungary. *Water Sci. Technol.* **2012**, *65*, 1676–1683. DOI: [10.2166/wst.2012.062](https://doi.org/10.2166/wst.2012.062).

[5] Henze, M.; Gujer, W.; Mino, T.; Matsuo, T.; Wentzel, M.; Marais, G. Activated Sludge Model No. 2. In *IAWQ Scientific and Technical Reports*, No. 3; IAWQ: London, **1995**; ISBN: 1 (900222) 00. DOI: [10.2166/wst.1995.0061](https://doi.org/10.2166/wst.1995.0061).

[6] Henze, M. Activated Sludge Model No. 1. In *Scientific and Technical Report No. 1*; IAWQ: London, **1986**.

[7] Ruiz, L. M.; Perez, J. I.; Gomez, M. A. Comparison of Five Wastewater COD Fractionation Methods for Dynamic Simulation of MBR Systems. *J. Environ. Sci. Health. A Tox. Hazard. Subst. Environ. Eng.* **2014**, *49*, 1553–1563. DOI: [10.1080/10934529.2014.938533](https://doi.org/10.1080/10934529.2014.938533).

[8] Surerus, V.; Giordano, G.; Teixeira, L. Activated Sludge Inhibition Capacity Index. *Braz. J. Chem. Eng.* **2014**, *31*, 385–392. DOI: [10.1590/0104-6632.20140312s00002516](https://doi.org/10.1590/0104-6632.20140312s00002516).

[9] Ekama, G.; Dold, P.; Marais, G. R. Procedures for Determining Influent COD Fractions and the Maximum Specific Growth Rate of Heterotrophs in Activated Sludge Systems. *Water Sci. Technol.* **1986**, *18*, 91–114. DOI: [10.2166/wst.1986.0062](https://doi.org/10.2166/wst.1986.0062).

[10] Roeleveld, P.; van.; Loosdrecht, M. Experience with Guidelines for Wastewater Characterisation in The Netherlands. *Water Sci. Technol.* **2002**, *45*, 77–87.

[11] DWA. *Dimensioning of Single-Stage Activated Sludge Plants*. GFA Publishing: Hennef; ATV-DVWK Worksheet A 131 E. Department of Water Affairs, **2002**.

[12] Kristensen, G. H.; Jørgensen, P. E.; Henze, M. Characterization of Functional Microorganism Groups and Substrate in Activated Sludge and Wastewater by AUR, NUR and OUR. *Water Sci. Technol.* **1992**, *25*, 43. DOI: [10.2166/wst.1992.0113](https://doi.org/10.2166/wst.1992.0113).

[13] Grady, C. P. L.; Daigger, G. T.; Lim, H. C. *Biological Wastewater Treatment*, 2nd ed.; Revised and Expanded; Marcel Dekker, Inc.: New York, **1999**.

[14] Makinia, J. *Performance Prediction of Full-Scale Biological Nutrient Removal Systems Using Complex Activated Sludge Models*; ISAH: New York, **2006**.

[15] Mamais, D.; Jenkins, D.; Prrr, P. A Rapid Physical-Chemical Method for the Determination of Readily Biodegradable Soluble COD in Municipal Wastewater. *Water Res.* **1993**, *27*, 195–197. DOI: [10.1016/0043-1354\(93\)90211-Y](https://doi.org/10.1016/0043-1354(93)90211-Y).

[16] Henze, M.; Gujer, W.; Mino, T.; Van Loosdrecht, M. *Activated Sludge Models ASM1, ASM2, ASM2d and ASM3*; IWA Publishing: London, **2000**.

[17] Hydromantis, I. inventorGPS – X 5.0.2. User’s Guide and Technical Reference. **2007**.

[18] Henze, M.; Gujer, W.; Mino, T.; Matsuo, T.; Wentzel, M. C.; Marais, G. v R.; Van Loosdrecht, M. C. M. Activated Sludge Model No. 2d, ASM2d. *Water Sci. Technol.* **1999**, *39*, 165–182. DOI: [10.2166/wst.1999.0036](https://doi.org/10.2166/wst.1999.0036).

[19] Nelder, J. A.; Mead, R. A. A Simplex Method for Function Minimization. *Comp. J.* **1965**, *7*, 308–313. DOI: [10.1093/comjnl/7.4.308](https://doi.org/10.1093/comjnl/7.4.308).

[20] Makinia, J.; Drewnowski, J.; Swinarski, M.; Czerwionka, K.; Kaszubowska, M.; Majtacz, J. The Impact of Precipitation and External Carbon Source Addition on Biological Nutrient Removal in Activated Sludge Systems—Experimental Investigation and Mathematical Modeling. *Water Pract. Technol.* **2012**, *7*, 2012011.

[21] Drewnowski, J.; Makinia, J. The Role of Biodegradable Particulate and Colloidal Organic Compounds in Biological Nutrient Removal Activated Sludge Systems. *Int. J. Environ. Sci. Technol.* **2014**, *11*, 1973–1988. DOI: [10.1007/s13762-013-0402-1](https://doi.org/10.1007/s13762-013-0402-1).

[22] Henze, M.; Comeau, Y. Wastewater characterization. Biological wastewater treatment: Principles modelling and design. Henze, M.; van Loosdrecht, M.C.M.G.; Ekama A.; Brdjanovic, D, Eds.; IWA Publishing: London, UK, **2008**, pp. 33–52.

[23] Sadecka, Z.; Jędrzak, A.; Pluciennik-Koropczuk, E.; Myszograj, S.; Suchowska-Kisielewicz, M. COD Fractions in Sewage Flowing into Polish Sewage Treatment Plants. *Chem. Biochem. Eng. Q* **2013**, *27*, 185–195.

[24] Ginestet, P.; Maisonnier, A.; Sperandio, M. Wastewater COD Characterization: biodegradability of Physico-Chemical Fractions. *Water Sci. Technol.* **2002**, *45*, 89–97. DOI: [10.2166/wst.2002.0096](https://doi.org/10.2166/wst.2002.0096).

[25] Koch, G.; Kühni, M.; Gujer, W.; Siegrist, H. Calibration and Validation of Activated Sludge Model No. 3 for Swiss Municipal Wastewater. *Water Res.* **2000**, *34*, 3580–3590. DOI: [10.1016/S0043-1354\(00\)00105-6](https://doi.org/10.1016/S0043-1354(00)00105-6).

[26] Jørgensen, P. E.; Eriksen, T.; Jensen, B. Estimation of Viable Biomass in Wastewater and Activated Sludge by Determination of ATP, Oxygen Uptake Rate and FDA Hydrolysis. *Water Res.* **1992**, *26*, 1495–1501. DOI: [10.1016/0043-1354\(92\)90069-G](https://doi.org/10.1016/0043-1354(92)90069-G).

[27] Jin, B.; Wilén, B. M.; Lant, P. A Comprehensive Insight into Floc Characteristics and Their Impact on Compressibility and Settleability of Activated Sludge. *Chem. Eng. J.* **2003**, *95*, 221–234. DOI: [10.1016/S1385-8947\(03\)00108-6](https://doi.org/10.1016/S1385-8947(03)00108-6).

[28] Liao, B.; Droppo, I.; Leppard, G.; Liss, S. Effect of Solids Retention Time on Structure and Characteristics of Sludge Flocs in Sequencing Batch Reactors. *Water Res.* **2006**, *40*, 2583–2591.

[29] Massé, A.; Spérandio, M.; Cabassud, C. Comparison of Sludge Characteristics and Performance of a Submerged Membrane Bioreactor and an Activated Sludge Process at High Solids

882
883
884
885
886
887
888
889
890
891
892
893
894
895
896
897
898
899
900
901
902
903
904
905
906
907
908
909
910
911
912
913
914
915
916
917
918
919
920
921
922
923
924
925
926
927
928
929
930
931
932
933
934
935
936
937
938
939
940

- Retention Time. *Water Res.* **2006**, *40*, 2405–2415. DOI: [10.1016/j.watres.2006.04.015](https://doi.org/10.1016/j.watres.2006.04.015).
- [30] Wilén, B. M.; Balmér, P. Short Term Effects of Dissolved Oxygen Concentration on the Turbidity of the Supernatant of Activated Sludge. *Water Sci. Technol.* **1998**, *38*, 25. DOI: [10.2166/wst.1998.0168](https://doi.org/10.2166/wst.1998.0168).
- [31] Luxmy, B.; Nakajima, F.; Yamamoto, K. Analysis of Bacterial Community in Membrane-Separation Bioreactors by Fluorescent in Situ Hybridization (FISH) and Denaturing Gradient Gel Electrophoresis (DGGE) Techniques. *Water Sci. Technol.* **2000**, *41*, 259–268. DOI: [10.2166/wst.2000.0657](https://doi.org/10.2166/wst.2000.0657).
- [32] Wanner, J. Activated Sludge Population Dynamics. *Water Sci. Technol.* **1994**, *30*, 159. DOI: [10.2166/wst.1994.0556](https://doi.org/10.2166/wst.1994.0556).
- [33] Govoreanu, R.; Seghers, D.; Nopens, I.; De Clercq, B.; Saveyn, H.; Capalozza, C.; Van der Meeren, P.; Verstraete, W.; Top, E.; Vanrolleghem, P. A. Linking Floc Structure and Settling Properties to Activated Sludge Population Dynamics in an SBR. *Water Sci. Technol.* **2003**, *47*, 9. DOI: [10.2166/wst.2003.0622](https://doi.org/10.2166/wst.2003.0622).
- [34] Shulan, X.; Hultman, B. Experiences in Wastewater Characterization and Model Calibration for the Activated Sludge Process. *Water Sci. Technol.* **1996**, *33*, 89. DOI: [10.2166/wst.1996.0310](https://doi.org/10.2166/wst.1996.0310).
- [35] Puig, S.; van Loosdrecht, M.; Flameling, A. G.; Colprim, J.; Meijer, S. The Effect of Primary Sedimentation on Full-Scale WWTP Nutrient Removal Performance. *Water Res.* **2010**, *44*, 3375–3384.
- [36] Clauss, F.; Helaine, D.; Balavoine, C.; Bidault, A. Improving Activated Sludge Floc Structure and Aggregation for Enhanced Settling and Thickening Performances. *Water Sci. Technol.* **1998**, *38*, 35. DOI: [10.2166/wst.1998.0788](https://doi.org/10.2166/wst.1998.0788).
- [37] Campos, C.; Guerrero, A.; Cardenas, M. Removal of Bacterial and Viral Faecal Indicator Organisms in a Waste Stabilization Pond System in Choconta, Cundinamarca (Colombia). *Water Sci. Technol.* **2002**, *45*, 61–66. DOI: [10.2166/wst.2002.0009](https://doi.org/10.2166/wst.2002.0009).
- [38] Henze, M. Characterization of Wastewater for Modelling of Activated Sludge Processes. *Water Sci. Technol.* **1992**, *25*, 1–15. DOI: [10.2166/wst.1992.0110](https://doi.org/10.2166/wst.1992.0110).
- [39] De la Sota, A.; Larrea, L.; Novak, L.; Grau, P.; Henze, M. Performance and Model Calibration of RDN Processes in Pilot Plant. *Water Sci. Technol.* **1994**, *30*, 355. DOI: [10.2166/wst.1994.0286](https://doi.org/10.2166/wst.1994.0286).
- [40] Wichern, M.; Obenaus, F.; Wulf, P.; Rosenwinkel, K. H. Modelling of Full-Scale Wastewater Treatment Plants with Different Treatment Processes Using the Activated Sludge Model No. 3. *Water Sci. Technol.* **2001**, *44*, 49–56. DOI: [10.2166/wst.2001.0012](https://doi.org/10.2166/wst.2001.0012).
- [41] Rieger, L.; Koch, G.; Kühni, M.; Gujer, W.; Siegrist, H. The Eawag Bio-p Module for Activated Sludge Model No. 3. *Water Res.* **2001**, *35*, 3887–3903. DOI: [10.1016/S0043-1354\(01\)00110-5](https://doi.org/10.1016/S0043-1354(01)00110-5).
- [42] Marquot, A.; Stricker, A. E.; Racault, Y. ASM1 Dynamic Calibration and Long-Term Validation for an Intermittently Aerated WWTP. *Water Sci. Technol.* **2006**, *53*, 247–256.
- [43] Pasztor, I.; Thury, P.; Pulai, J. Chemical Oxygen Demand Fractions of Municipal Wastewater for Modeling of Wastewater Treatment. *Int. J. Environ. Sci. Technol.* **2009**, *6*, 51–56. DOI: [10.1007/BF03326059](https://doi.org/10.1007/BF03326059).
- [44] Carrette, R.; Bixio, D.; Thoeye, C.; Ockier, P. Full-Scale Application of the IAWQ ASM No. 2d Model. *Water Sci. Technol.* **2001**, *44*, 17–24.
- [45] Yildiz, G.; Insel, G.; Cokgor, E. U.; Orhon, D. Biodegradation Kinetics of the Soluble Slowly Biodegradable Substrate in Polyamide Carpet Finishing Wastewater. *J. Chem. Technol. Biotechnol.* **2008**, *83*, 34–40. DOI: [10.1002/jctb.1773](https://doi.org/10.1002/jctb.1773).