

Mainstream short-cut N removal modelling: current status and perspectives

Gamze Kirim ^{a,b,*}, Kester McCullough ^{c,d}, Thiago Bressani-Ribeiro ^e, Carlos Domingo-Félez ^f, Haoran Duan ^g, Ahmed Al-Omari ^h, Haydee De Clippeleir ⁱ, Jose Jimenez ^h, Stephanie Klaus ^d, Mojolaoluwa Ladipo-Obasa ^{i,j}, Mohamad-Javad Mehrani ^{k,n}, Pusker Regmi ^h, Elena Torfs ^{l,m}, Eveline I. P. Volcke ^{e,l} and Peter A. Vanrolleghem ^{a,b}

^a modelEAU, Université Laval, 1065 avenue de la Médecine, Québec, QC G1 V 0A6, Canada

^b CentriEau, Quebec Water Research Centre, 1065 avenue de la Médecine, Québec, QC G1 V 0A6, Canada

^c School of Civil and Environmental Engineering, Cornell University, Ithaca, NY 14853, USA

^d Hampton Roads Sanitation District, 1434 Air Rail Ave., Virginia Beach, VA 23455, USA

^e BioCo Research Group, Department of Green Chemistry and Technology, Ghent University, Coupure Links 653, Gent 9000, Belgium

^f Department of Environmental Engineering, Technical University of Denmark, Kongens Lyngby 2800, Denmark

^g Australian Centre for Water and Environmental Biotechnology, The University of Queensland, Brisbane, QLD 4072, Australia

^h Brown and Caldwell, 1725 Duke St. Suite 250, Alexandria, VA 22314, USA

ⁱ DC Water and Sewer Authority, 5000 Overlook Ave., SW., Washington, DC 20032, USA

^j Department of Civil & Environmental Engineering, The George Washington University, 800 22nd Street NW, Washington, DC 20037, USA

^k Faculty of Civil and Environmental Engineering, Gdansk University of Technology, Ul. Narutowicza 11/12, Gdansk 80-233, Poland

^l Centre for Advanced Process Technology for Urban Resource recovery (CAPTURE), Frieda Saeystraat 1, Gent 9000, Belgium

^m BIOMATH, Faculty of Bioscience Engineering, Ghent University, Coupure Links 653, Gent 9000, Belgium

ⁿ Department of Urban Water and Waste Management, University of Duisburg-Essen, Universitätsstraße 15, 45141, Essen, Germany

*Corresponding author. E-mail: gamze.kirim.1@ulaval.ca

^{id} GK, 0000-0001-6964-4371; KM, 0000-0003-2637-8047; TB-R, 0000-0002-7363-7497; CD-F, 0000-0003-3677-8597; HD, 0000-0001-6679-3240; HD-C, 0000-0003-0541-8935; JJ, 0000-0003-3926-8779; SK, 0000-0003-4058-8104; ML, 0000-0001-6335-6897; M-JM, 0000-0003-2462-585X; ET, 0000-0002-5629-6950; EIPV, 0000-0002-7664-7033; PAV, 0000-0003-1695-1313

ABSTRACT


This work gives an overview of the state-of-the-art in modelling of short-cut processes for nitrogen removal in mainstream wastewater treatment and presents future perspectives for directing research efforts in line with the needs of practice. The modelling status for deammonification (i.e., anammox-based) and nitrite-shunt processes is presented with its challenges and limitations. The importance of mathematical models for considering N₂O emissions in the design and operation of short-cut nitrogen removal processes is considered as well. Modelling goals and potential benefits are presented and the needs for new and more advanced approaches are identified. Overall, this contribution presents how existing and future mathematical models can accelerate successful full-scale mainstream short-cut nitrogen removal applications.

Key words: anammox, deammonification, energy optimization, mathematical modelling, partial denitrification, partial nitrification, resource optimization

HIGHLIGHTS

- Models for mainstream short-cut N removal processes are reviewed by considering their current practice and limitations.
- Modelling goals and potential benefits are presented from a modeller perspective to facilitate successful applications.
- More advanced modelling approaches are presented to overcome the addressed challenges and limitations.

GRAPHICAL ABSTRACT

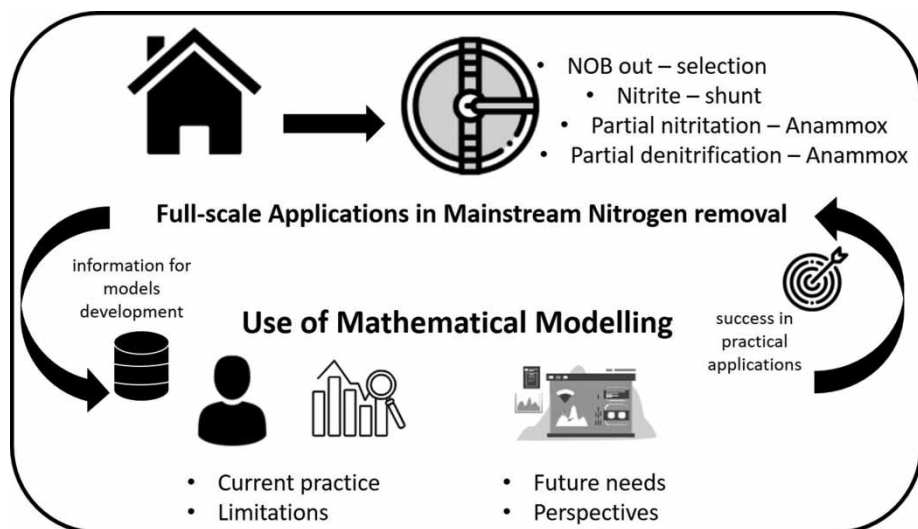

1. INTRODUCTION

Conventional nitrogen (N) removal by nitrification/denitrification is an energy and resource-intensive process: nitrification requires oxygen and alkalinity, and denitrification requires carbon as either influent carbon or supplemental carbon. Compared to nitrification-denitrification, the application of short-cut N removal processes in mainstream wastewater treatment has significant potential to save energy (oxygen demand), resources (carbon demand), and to pursue energy independence for water resource recovery facilities (WRRF). For that reason, short-cut N removal (deammonification and nitrite shunt) has received considerable attention over the last decade from both academia and practice.

Deammonification short-cuts the conventional N removal pathway by directly converting ammonium ($\text{NH}_4^+\text{-N}$) to nitrogen gas (N_2) via nitrite ($\text{NO}_2^-\text{-N}$). The process relies on preventing the oxidation of nitrite to nitrate ($\text{NO}_3^-\text{-N}$) and making nitrite available for anammox (Zhang *et al.* 2019). The availability of nitrite can be achieved through two pathways: partial nitritation-anammox (PNA) or partial denitrification-anammox (PdNA) (Figure 1). In practice, PNA and PdNA can be combined in full-scale applications for desired N removal performance.

The efficiency of deammonification has been proven for ammonium-rich wastewater such as treatment of side-streams resulting from dewatering of digested sludge, leachate, or industrial wastewaters (van Dongen *et al.* 2001; Wyffels *et al.* 2004; Volcke *et al.* 2005; Wett 2007; Ganigué *et al.* 2009; Lackner *et al.* 2014). Short-cut N removal can also be combined with a pretreatment process for carbon diversion in mainstream applications such as high-rate activated sludge (HRAS), chemically enhanced primary treatment and energy recovery in the side-stream, or even direct anaerobic sewage treatment (Kartal *et al.* 2010; Leal *et al.* 2016). This provides WRRFs with an excellent opportunity to move to energy-neutral or energy-positive operations (Jetten *et al.* 1997; Siegrist *et al.* 2008). However, full-scale applications are currently limited to side-stream treatment and only a few successful mainstream applications are reported so far (O'Shaughnessy 2016; Cao *et al.* 2017; Klaus *et al.* 2020).

PNA is a fully autotrophic process that consists of partial oxidation of $\text{NH}_4^+\text{-N}$ to $\text{NO}_2^-\text{-N}$ (nitritation) and the anammox process in which $\text{NH}_4^+\text{-N}$ is oxidized using $\text{NO}_2^-\text{-N}$ as an electron acceptor under anaerobic conditions without the need for carbon (Kartal *et al.* 2010) (Figure 1). Thus, the process requires the cooperation of ammonia-oxidizing bacteria (AOB) and anammox bacteria (AnAOB), and out-selection of nitrite-oxidizing bacteria (NOB). The successful application can reduce the required oxygen input by 60%, eliminate the carbon source demand and reduce the sludge production by 90% in comparison to conventional N-removal (Morales *et al.* 2015; Miao *et al.* 2016).

Partial nitritation-denitrification (nitrite-shunt) relies on partial nitritation of $\text{NH}_4^+\text{-N}$ into $\text{NO}_2^-\text{-N}$ as the first step, then denitrification of $\text{NO}_2^-\text{-N}$ into N_2 as the second step by heterotrophic bacteria (HB). Thus, it consumes 25% less oxygen than complete nitrification and reduces the organic carbon demand by 40% compared to the full denitrification (Daigger 2014).

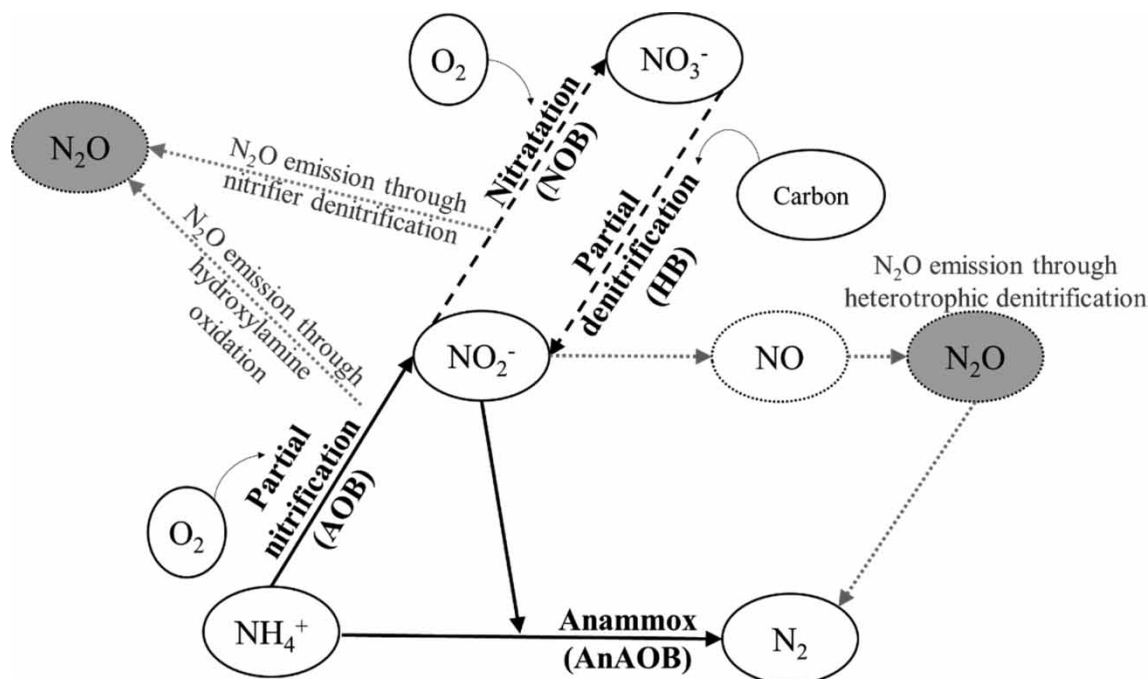


Figure 1 | Deammonification through partial nitrification-anammox and partial denitrification-anammox pathways including potential nitrous oxide emission pathways.

The process requires both out-selection of NOB and also carbon availability for denitrification. The nitrite-shunt process has been successfully implemented in side-stream treatment (e.g. SHARON process (Mulder *et al.* 2001)) and there is an interest to implement it in mainstream treatment in a single reactor (Jimenez *et al.* 2020). However, it is not commonly applied due to the lack of complete understanding of the underlying mechanisms for NOB out-selection and carbon availability for denitrification under these conditions.

During PdNA a portion of the influent $\text{NH}_4^+\text{-N}$ is aerobically oxidized to $\text{NO}_3^-\text{-N}$. The $\text{NO}_3^-\text{-N}$ is subsequently reduced to $\text{NO}_2^-\text{-N}$ via heterotrophic denitrification and the resulting mix of residual $\text{NH}_4^+\text{-N}$ and $\text{NO}_2^-\text{-N}$ serves as substrate for the anammox process (Le *et al.* 2019a; Lu *et al.* 2021b) (Figure 1). This process does not require NOB out-selection and needs a carbon donor to achieve partial denitrification (Zhang *et al.* 2019). The PdNA process consumes slightly more resources (energy for aeration and carbon) than the PNA route; however, the nitrite generating pathway is understood compared to the NOB out-selection pathway (B. Ma *et al.* 2017; Lu *et al.* 2021a). Theoretically, 50% of aeration needs and 80% of carbon demand can be saved and sludge production can be reduced by 60% compared to conventional N removal (Z. Zhang *et al.* 2020). To overcome the external carbon need, recent research efforts aim to take advantage of the slowly biodegradable organics in wastewater or to produce soluble microbial products through fermentation (Ji *et al.* 2020; Liu *et al.* 2022). Also, simultaneous nitrogen and phosphorus removal with lower carbon and oxygen demand can be accomplished by combining endogenous partial denitrification with denitrifying phosphorus removal (X. Wang *et al.* 2019).

Current mainstream deammonification implementations include a variety of processes in laboratory and pilot scales including suspended, attached growth, or hybrid systems in single-stage or 2-stage reactors (e.g. Hoekstra *et al.* 2018; Klaus 2019; Le *et al.* 2019a; Huang *et al.* 2020). Due to the slow growth rate of anammox bacteria (Valverde Pérez *et al.* 2016; Lotti *et al.* 2015), an anammox retention mechanism is required to allow for adequate solids retention time (SRT). In a single-stage process, all biokinetic reactions occur in one basin which decreases both the investment and the operational costs (Pérez *et al.* 2014). Biofilm processes (Lotti *et al.* 2015; Gustavsson *et al.* 2020) or hybrid systems that combine suspended sludge with the biofilm systems such as integrated fixed-film activated sludge system (IFAS) (Cao *et al.* 2017) are used in these single-stage systems (W.-J. Ma *et al.* 2020) to retain AnAOB. In 2-stage systems, partial nitrification or full-nitrification (aerobic environment) and the deammonification processes (anoxic environment) occur in separate basins. Suspended or biofilm processes can be used in the aerated basin and biofilm-based processes may be used in the anammox basin (Regmi *et al.* 2014; Pérez *et al.* 2015).

Despite all the efforts, the mainstream application is still facing challenges due to NOB out-selection, wastewater characteristics, temperature and meeting the strict effluent criteria under dynamic loads (Cao *et al.* 2017). The competition for substrates and growth space between the different functional species is another major application challenge. High influent C/N ratios in the raw wastewater promote the growth of HB in the system, thus hampering deammonification under limiting oxygen concentrations (Gao & Xiang 2021). Also, lower ammonium concentrations and temperature variations make the stable out-selection of NOB very difficult in the PNA systems and lead to competition over oxygen by AOB, NOB and HB (M. Zhang *et al.* 2020).

Strategies are being developed to accelerate successful deammonification process implementation. Microorganisms involved in the short-cut N-removal processes are sensitive to operational and environmental conditions such as pH, dissolved oxygen (DO) level, temperature, SRT and the presence of inhibitors. Several control strategies have been adopted such as low or high DO operation, aerobic SRT, real-time aeration or oxidation-reduction potential control to take advantage of the growth characteristics and the kinetics difference between the microorganisms (Liu *et al.* 2020; Gao & Xiang 2021). However, the shift and adaptation of microbial communities' growth characteristics to mainstream conditions remain a challenge (Agrawal *et al.* 2018; Gao & Xiang 2021). In addition, due to high nitrite accumulation and ammonia conversion rates, the short-cut processes inevitably generate nitrous oxide (N₂O) as a by-product which is one of the most significant greenhouse gases (Castro-Barros *et al.* 2016; Li *et al.* 2020) (Figure 1). Further research is needed under mainstream conditions to achieve long-term process stability (e.g. varying loads or temperatures) and to understand the role of influent characteristics, varying substrates, intrinsic kinetics of the microorganisms involved and competition between them.

Mathematical models and model-based control strategies are under development to overcome implementation challenges and to deal with the complexity of mainstream deammonification (Agrawal *et al.* 2018). Through modelling, it is possible to identify the proper conditions for microbial competition under different operational and environmental conditions and to optimize the processes and implement deammonification successfully (Pérez *et al.* 2014; Liu *et al.* 2017; Shourjeh *et al.* 2021). However, the mechanistic models that are currently being used for the modelling are not sufficiently accurate to model short-cut N removal processes and require specific attention. For example, while the models include the key microbial groups, they do not consider the individual species which are crucial to reflect the competition among them and predict a community shift (e.g. NOB community shift (Liu & Wang 2013)). Also, different process configurations such as biofilm systems require specific sub-models such as the mass transport between the bulk liquid and the microorganisms inside the biofilm (Arnaldos *et al.* 2015; Baeten *et al.* 2019). Thus, the pilot and full-scale applications reported provide invaluable information for models development and to overcome bottlenecks while modelling efforts accelerate the success of practical applications.

The main focus of this paper is pointing out future needs and perspectives to facilitate the technology transfer between the model applications in research studies and accelerate the successful application of mainstream deammonification. The objectives of the presented review article are: (i) to illustrate the current practice in modelling of short-cut N removal processes, (ii) to reveal the challenges in modelling applications with examples, and (iii) to determine the immediate needs and the potential of more advanced modelling approaches and perspectives in the near future.

2. CURRENTLY APPLIED MODELLING APPROACHES AND LIMITATIONS

Modelling plays an essential role in improving process understanding and determining the optimal operating conditions and control strategies for applying short-cut nitrogen removal processes. There has been a concerted effort by academics and practitioners to model mainstream short-cut nitrogen removal recently, but these efforts have not yet resulted in consensus on process models and model parameter values that are transferable to practice. The activated sludge models (ASMs) developed by the IWA task group (Henze *et al.* 2006) are generally being used as default mathematical models for carbon and nutrient removal in wastewater treatment and are available in commercial software packages. For modelling short-cut nitrogen removal processes, ASMs have been used as well with extensions and modifications such as 2-step nitrification, 4-step denitrification, N₂O emission pathways and inhibition mechanisms. Despite its limitations, modelling can serve as a useful tool to improve process knowledge, screen technologies, and develop preliminary designs in a short-cut process. In this section, the required model selection mechanisms and current modelling perspectives for mainstream short-cut N removal processes are given.

2.1. NOB out-selection

Out-selection of NOB is crucial, especially for PNA or nitrite-shunt systems, and is widely recognized as one of the major challenges to mainstream application. The out-selection of NOB has been proven to be quite effective in warm nitrogen-rich wastewater streams (Lackner *et al.* 2014); due to the effect of elevated temperatures on growth rates for AOB and NOB (Hellings *et al.* 1999), and also the high free ammonia (FA) and free nitrous acid (FNA) concentrations in side-stream liquors which inhibits the growth of NOB (Lackner & Agrawal 2015). However, FA inhibition is not possible in mainstream treatment due to the lower influent ammonium concentration (Cao *et al.* 2017). There are also reports of NOB out-selection achieved through side-stream generated FNA exposure (D. Wang *et al.* 2016) and alternating the sludge treatment strategy between FA and FNA can result in a stable nitrite-shunt with nitrite accumulation above 95% in the mainstream (Duan *et al.* 2019a).

The operating conditions to favour AOB and wash out NOB are thoroughly investigated in literature based on DO, pH, temperature and inhibitors. The intrinsic kinetics of these two groups of microorganisms including maximum growth rate and substrate half-saturations are crucial (Liu *et al.* 2020). DO affects the diversity and kinetics significantly, thus DO control to manipulate the competition for oxygen between AOB and NOB is one of the main strategies in mainstream conditions (Pérez *et al.* 2014; Jimenez *et al.* 2020). The oxygen half-saturation constant for AOB is generally accepted to be lower than for NOB which creates a disadvantage for NOB to compete for oxygen at low concentrations (Sin *et al.* 2008; Cao *et al.* 2017). On the other hand, the predominance of *Nitrobacter* or *Nitrospira*, which are the two main genera of NOB, affect the performance of NOB out-selection through DO control. The systems enriched with *Nitrospira* rather than *Nitrobacter* have a higher oxygen affinity, thus have lower oxygen half-saturation than AOBs and can be well adapted to low DO conditions (Regmi *et al.* 2014; Al-Omari *et al.* 2015). The use of transient anoxia is another approach by providing a lag-time for NOB to transition from anoxic to aerobic condition or nitrite limitation (Zekker *et al.* 2012; Gilbert *et al.* 2014). By consuming nitrite in anoxic conditions, heterotrophs restrict substrate availability for NOB in the aerobic phase (Regmi *et al.* 2014). Moreover, in mainstream treatment under limited DO, the AOB growth rate is higher than the NOB's at high temperatures (above 20°C) (Regmi *et al.* 2014; Yang *et al.* 2016). This allows operating the system at the SRT that is suitable for the growth of AOB and wash out the NOB (Blackburne *et al.* 2008). In addition, there are lab-scale works that support that NOB out-selection can be achieved at lower temperatures depending on the dominant NOB species in the system and the reactor configuration (De Clippeleir *et al.* 2013; Gilbert *et al.* 2015; Cao *et al.* 2017).

For modelling the short-cut processes, nitrite should be considered as an intermediary step in nitrification and denitrification. Modelling the two-step nitrification process is well established where NOB out-selection can be modelled through distinctly defined growth kinetics, substrate affinities, temperature and pH effect on AOB and NOB (Sin *et al.* 2008; Shourjeh *et al.* 2021). However, most simulation studies so far deal with side-stream conditions associated with high-strength nitrogenous wastewater where NOB out-selection can be achieved much more easily with direct pH and temperature effect on the NOB (Volcke *et al.* 2006, 2012; Van Hulle *et al.* 2007; Wett *et al.* 2010; Hubaux *et al.* 2015). For mainstream processes, community shifts and the changes in biokinetics become important which are not implemented in the ASM-based models yet. Favourable conditions to support the existence of AOB and facilitate NOB out-selection through different control systems could be demonstrated in the limited number of existing modelling works for mainstream treatment (Table 1). NOB out-selection is achievable in the models but there are still limitations to these models such as the calibrated half-saturation constants that can be a function of the environmental conditions, process configuration and operating conditions; thus, posing an issue of not being transferable to other systems.

2.2. Partial nitrification – denitrification

Partial nitrification-denitrification is an efficient biological pathway for N removal, but it has been challenged by the aforementioned difficulties (Section 2.1). The process can be applied as the first step of a 2-stage PNA process where nitrite-shunt is facilitated with controlled aerobic SRT. To improve effluent quality, the anammox process can be applied as a polishing step (Regmi *et al.* 2015a, 2015b; W. Zhang *et al.* 2020). Application of nitrite-shunt in mainstream treatment is desired through simultaneous nitrification denitrification because of the opportunity to enhance the utilization of the organic matter in the influent for denitrification. Note that the goal here is to maximize the use of the influent carbon through denitrification and not oxidation; hence, improving N removal while reducing energy consumption. However, it is not easy because the denitrification relies on utilizing the influent COD solely and thus the efficiency of the carbon pretreatment

Table 1 | Examples of modelling works for mainstream short-cut N removal processes

Modelled process	Reactor configuration	Modelling goal	Key findings	Limitations	Reference
Partial nitrification – denitrification	Lab-scale sequencing batch reactor (SBR)	Investigated the effect of aerobic duration on nitrification and NOB out-selection	AOB obtains more growth opportunity than the NOB which can occur only if the AOB reaction rate is higher than the NOB by considering the substrate concentrations	Simplified model excluding COD limitation, ammonification, assimilation of N	Blackburne <i>et al.</i> (2008)
	Lab-scale sequencing bench reactor (SBR)	Created an optimization framework and determined the optimal intermittent aeration profile to minimize energy consumption.	Rapid detection of the optimal aeration policies allowing an appropriate and prompt reaction to changes in the operation conditions in SBR processes	Comparing the results against previous publications due to the different conditions of the problem statement in each study	Bournazou <i>et al.</i> (2013)
	Pilot-scale activated sludge systems	Evaluated the performance of different process control strategies to achieve nitrite-shunt	The AvN strategy could improve the total nitrogen removal, sustain the NOB out-selection over the ABAC strategy and significant carbon savings could be achieved in comparison to conventional N-removal	Calibrating the model using dynamic input for pilot system due to the lack of a proper AVN controller in the model	Al-Omari <i>et al.</i> (2015)
	Biofilm system (pure modelling study)	Determine the influence of biofilm properties (e.g. water-biofilm interface thickness, substrate diffusivities) on NOB suppression	Increased biofilm thickness poses more resistance to diffusive transport of DO, thus limiting the NOB growth	Pure modelling study based on assumed influent characterization	Liu <i>et al.</i> (2020)
Partial nitrification – anammox	Granular sludge reactor (pure modelling study)	Investigated microbial community interactions at low temperatures and sensitive parameters leading to NOB repression.	The nitrite half-saturation coefficient of NOB and anammox bacteria proved non-influential on the model output. The maximum specific growth rate of anammox bacteria proved a sensitive process parameter.	Granule size distribution was not considered. Model excluded heterotrophic growth.	Pérez <i>et al.</i> (2014)
	Lab-scale SBR	Described the microbial interaction among ammonia-oxidizing archaea (AOA), AOB and anammox bacteria	AOA outcompete AOB under low ammonium concentration and low dissolved oxygen conditions, indicating a better partnership with anammox bacteria.	Oxygen inhibition coefficient for anammox derived from a marine species (1 g DO m^{-3}).	Pan <i>et al.</i> (2016)
	Granular sludge reactor (pure modelling study)	Evaluated control strategies to minimize the impact of influent disturbances, using dynamic model simulations.	Fixed or adaptive ammonium set point control strategy with DO limit enabled PNA.	Model assumed a homogeneous granule size.	Wu (2017)
	Lab-scale granular sludge reactor	Investigated the impacts of C/N ratio, DO concentration and granule size distribution on the process performance.	The granule size distribution should be incorporated in the model to accurately describe the granular anammox system.	External mass transfer boundary layer was not taken into account.	Liu <i>et al.</i> (2017)
	CSTR (PN)+ granular sludge reactor (anammox) (pure modelling study)	Investigated the effect of operational conditions on final effluent N concentration.	TN discharge standard of 10 gN m^{-3} is only met for temperatures above 25°C .	Model assumed a homogeneous granule size. Pure modelling study based on assumed influent characterization.	Bozileva <i>et al.</i> (2017)

(Continued.)

Table 1 | Continued

Modelled process	Reactor configuration	Modelling goal	Key findings	Limitations	Reference
Partial nitrification – anammox	MBBR and IFAS (pure modelling study)	Explored operating conditions in IFAS and MBBR systems.	IFAS can achieve higher nitrogen removal at lower airflow rate than MBBR. PN occurs mainly in the biofilm in MBBR and it is restricted to suspended solids in IFAS.	Pure modelling study based on assumed influent characterization. Steady-state simulations.	Tao & Hamouda (2019)
	Lab-scale SBR	Investigated how the composition of the flocs and the NOB concentration respond to changes in DO, fraction of flocs removed per cycle, and maximum volumetric anammox activity	Selective NOB wash out by controlling the DO-setpoint and/or the flocs removal allowed anammox bacteria to act as ‘NO ₂ -sink’ in the biofilm.	The oxygen inhibition of anammox bacteria was not explicitly modelled. The biofilm was modelled as zero-dimensional, and spatial gradients were neglected. Perfect biomass segregation between flocs and biofilm.	Laureni <i>et al.</i> (2019)
	HRAS-PNA (pure modelling study)	Assessed the feasibility and long-term stability of the granular sludge PNA reactor through dynamic modelling and simulation.	Anammox as a dominant process for N removal. The HRAS-PNA system was more sensitive to temperature compared to the conventional activated sludge system.	Model assumed a homogeneous granule size. Pure modelling study based on assumed influent characterization (BSM2).	Jia <i>et al.</i> (2020)
	MBBR and IFAS (pure modelling study)	Assessed the role of external boundary layer resistance with respect to bacterial competition and nitrogen removal capacity, focusing on low temperatures (10°C).	The external mass transfer resistance promoted the metabolic coupling between anammox and ammonia oxidizing bacteria. The effectiveness of the nitrite sink depended on the anammox bacteria sensitivity to oxygen.	Steady-state simulations. Pure modelling study based on assumed influent ammonium concentration (without COD).	Pérez <i>et al.</i> (2020)
	Lab-scale SBR	Used bifurcation analysis to assess the co-existence of AOB and NOB and the ideal scenario where NOB is completely removed from the reactor.	Good process performance shown even under sub-optimal conditions (i.e., NOB remain in the reactor).	Pure modelling study using a novel mathematical analysis, based on experimental results from Laureni <i>et al.</i> (2019).	Wade & Wolkowicz (2021)
	Granular sludge reactor (pure modelling study)	Evaluated the impact of feeding disturbances on the performance of a single-stage PNA granular reactor.	A cascade control strategy based on DO manipulation to derive the ammonium set-point value proved efficient under dynamic influent conditions.	Pure modelling study based on assumed influent characterization (BSM1).	M. Zhang <i>et al.</i> (2020)
	UCT-MBR system (pure modelling study)	Comparatively assessed the anammox process and conventional heterotrophic denitrification in an existing UCT-MBR system.	Anammox process weakens the system’s resilience to influent fluctuations.	Pure modelling study neglecting diffusion limitations on MBR systems.	Shao <i>et al.</i> (2021)
Partial denitrification-anammox	Pilot-scale MBBR, pilot-scale IFAS, & full-scale biological sand filter	Modify SUMO2 (based on ASM) to describe, parameterize, and calibrate partial denitrification for VFA and methanol substrates with and without the presence of AnAOB.	Nitrite preference needed to be removed from denitrification rates. Nitrate residual (via electron flow regulation) needed to be added to model, with additional parameters. Denitrification rate differentials and competition over nitrite with anammox were handled well by model kinetics.	New parameters in the model required batch-test calibration. New rate equations may not fully capture electron competition.	Al-Omari <i>et al.</i> (2021)

TN, total nitrogen; MBBR, moving bed biofilm reactor; PN, partial nitrification; UCT-MBR, University of Cape Town membrane bioreactor system; VFA, volatile fatty acids

process. In addition, the mechanisms for achieving controllable simultaneous nitrification denitrification are not well understood yet (Klaus 2019; Jimenez *et al.* 2020) and it is out of the scope of this paper.

Operational strategies for stable nitrite-shunt performance have not been demonstrated yet in large-scale systems (Xu *et al.* 2017; H. Wang *et al.* 2019). Modelling of nitrite-shunt requires a holistic approach by simultaneously monitoring the influent dynamics and using the data for controlling the operational conditions and considering their effect on competition for the different substrates. Recent research efforts mostly deal with the application of deammonification in full-scale mainstream as opposed to nitrite-shunt (Table 1).

2.3. Partial nitrification – anammox

For application of PNA processes for mainstream treatment, a further concern is the competition between HB and anammox bacteria for nitrite. Few modelling studies under mainstream conditions have dealt with the interaction between AnAOB, AOB, NOB and ordinary heterotrophs (e.g., Al-Omari *et al.* 2015). As for side-stream applications, simulations showed that the availability of some influent COD can lower the effluent nitrate concentration (produced by anammox) by heterotrophic denitrification and thus increase the total nitrogen removal efficiency of anammox reactors (Hao & van Loosdrecht 2004; Mozumder *et al.* 2014). In many anammox studies, the presence of HB was ignored, and the COD in the reactor was neither measured nor considered in mass balances (Schielke-Jenni *et al.* 2015). Nevertheless, heterotrophic denitrifiers have been widely found in anammox reactors and can account for up to 23% of the biomass in biofilm reactors even without organic matter in the influent because HB could grow both on soluble microbial products and decay released substrate (Ni *et al.* 2012).

When modelling the anammox stoichiometry, one should be careful because the experimentally determined yield for the overall metabolic reaction ($Y_{X/NH_4}^{Met'} = 0.172$ g COD/g NH_4^+ -N, Strous *et al.* (1998)) mistakenly has been used in many simulation studies (Hao *et al.* 2002; Volcke *et al.* 2010; Ni *et al.* 2012). Ammonium in the anammox process in ASMs is consumed in both catabolic and anabolic reactions, while the yield coefficient only accounts for the ammonium taken up in the catabolic path. Therefore, the experimentally determined yield cannot be directly implemented. To remedy this, Jia *et al.* (2018) proposed an alternative stoichiometric equation based on the biomass yield per amount of ammonium consumed in the overall metabolic reaction or recalculating the widely model yield (Y^{mod}) from the measured $Y_{X/NH_4}^{Met'}$ as follows;

$$Y^{mod} = 1/1/Y_{X/NH_4}^{Met'} - i_{NXB}$$

where i_{NXB} represents the nitrogen content of anammox bacteria (g N g COD⁻¹).

Modelling outputs of the mainstream PNA process also tend to be strongly affected by the oxygen inhibition coefficient of anammox bacteria, as demonstrated by Pérez *et al.* (2020) for MBBR and IFAS systems. The external mass transfer resistance plays a significant role in this case, as the biofilm can be exposed to lower DO concentrations under thicker boundary layers. Although low oxygen levels benefit anammox bacteria, AOB activity could be hampered too. In this case, ammonia-oxidizing archaea (AOA) could be better coupled to anammox bacteria, as the latter can thrive at lower DO levels compared to AOB (You *et al.* 2009). Nevertheless, few models consider the contribution of AOA to nitrogen conversions (Pan *et al.* 2016).

Steady-state simulations have been used to assess PNA systems (Bozileva *et al.* 2017), and only a few studies address dynamic simulations (Table 1). Under varying influent conditions, a higher sensitivity to temperature oscillation was found compared to steady-state simulations (Jia *et al.* 2020). Therefore, dynamic simulations are recommended to assess process feasibility and long-term stability.

2.4. Partial denitrification – anammox

An early indication of PdNA process in the literature was in a 2-stage pilot-scale PNA system (Regmi *et al.* 2015b). Eliminating the challenge of NOB out-selection has led to significant research interest in the PdNA process (Du *et al.* 2017; Cao *et al.* 2019; Du *et al.* 2019; X. Wang *et al.* 2019; B. Ma *et al.* 2020; You *et al.* 2020; Chen *et al.* 2021) and multiple successful pilot-scale and full-scale implementations (McCullough *et al.* 2021). As complete nitrification is already well established in process models, the primary challenge of modelling PdNA is understanding the reduction of nitrate to nitrite under various process configurations, substrate concentrations, redox conditions, and with/without the presence of anammox.

PdNA is typically implemented as a 2-stage system which can be an integrated process (Le *et al.* 2019a; Li *et al.* 2019) or a post-polishing (Campolongo *et al.* 2018). Controlling and maximizing denitrification over denitratation is key to PdNA start-up

and performance because full denitrification results in a loss of carbon efficiency and no ammonia removal. Multiple carbon sources have been demonstrated to be effective for partial denitrification such as acetate, glycerol, or methanol (Campolong *et al.* 2018; Le *et al.* 2019b; McCullough *et al.* 2021), ethanol (Du *et al.* 2017), fermentation products (Cao *et al.* 2013; Ali *et al.* 2020) and endogenously stored carbon (Ji *et al.* 2017; X. Wang *et al.* 2019). Beyond carbon source selection, numerous factors can affect the partial denitrification efficiency including influent C/N ratio, pH, sludge retention time and microbial population. Recent literature suggests that under mainstream conditions, the dominant factor impacting partial denitrification efficiency is in fact the nitrate concentration in the reactor (nitrate residual) (Le *et al.* 2019a). Nitrate residual has been demonstrated to be an effective method for controlling PdNA and partial denitrification efficiency during start-up (Schoepflin *et al.* Manuscript in preparation), pilot-scale (Le *et al.* 2019a), and full-scale (McCullough *et al.* 2021). Since it can be well correlated with partial denitrification efficiency and was used successfully for process control, the nitrate residual is found to be a key parameter in modelling PdNA as well (Al-Omari *et al.* 2021).

Modelling PdNA requires accurate description of partial denitrification in the model and the ability to address microbial competition over electron donors and acceptors. While denitrification is included in ASM 1, ASM 2-2d and ASM3 models as a single-step (Henze *et al.* 2006), at least two-step denitrification must be modelled for PdNA. Monod functions were used to model two-step denitrification by Hellinga *et al.* (1999), in ASM3 by Ni & Yu (2008) and for granular sludge by De Kreuk *et al.* (2007). Many multi-step denitrification models included terms to inhibit denitrification in favour of denitritation (referred to here as 'nitrite preference') based on experimental observations where nitrite accumulation was not observed or was impeded. Wett & Rauch (2003) proposed a model using the ASM structure in which the rate of denitrification is elevated and the rate of denitritation is hampered by an inhibition factor based on the ratio of nitrate to nitrite. Similar practices appeared to be common practice, as Hiatt & Grady (2008) state that denitrification models from Gujer and colleagues included a nitrite inhibition term for each step of nitrogen reduction, e.g. Wild *et al.* (1995). Their four-step activated sludge model for nitrogen (ASMN) includes a nitric oxide inhibition factor for denitrification as well as separate anoxic reduction factors for each denitrification rate. More advanced three-step or four-step denitrification models introduce additional complexity and parameters, but do not appear to be necessary to successfully model PdNA. These models are discussed in more detail in Section 4.4.

The nitrite preference applied to all electron donor sources used for denitrification hindered the ability to induce partial denitrification in existing models. Al-Omari *et al.* (2021) introduced a partial denitrification switch based on bench-scale and pilot-scale observations where partial denitrification was observed in batch tests and was controlled in continuously fed systems by maintaining nitrate residual. This was observed when using specific carbon sources such as acetate and glycerol but not methanol. The 'nitrite preference' was eliminated in this case for the nitrate reduction reactions using the volatile fatty acids (VFA) substrate state variable.

2.5. N₂O emissions in short-cut N removal processes

N₂O is produced mainly from three microbial pathways: the NH₂OH oxidation and nitrifier denitrification pathways carried out by AOB, and the heterotrophic denitrification pathway carried out by HB (Duan *et al.* 2017) (Figure 1). N₂O is a potent greenhouse gas with a large global warming potential of 265 times that of CO₂, as well as the single most significant ozone-depleting substance (Edenhofer *et al.* 2014). Accurate assessment, modelling, and mitigation of N₂O emissions is critical due to the large contribution of N₂O to the WRRF carbon footprint (Vasilaki *et al.* 2019). Peng *et al.* (2020) analysed the carbon footprint of the mainstream PNA process, including electricity consumption, N₂O emissions, and reduction in carbon emissions through energy recovery. Based on this study, the N₂O emission factor for mainstream PNA should not exceed 0.78% to achieve a carbon-neutral operation. However, the N₂O emissions from the PNA process could be staggeringly high, with up to 10% of the nitrogen removed emitted as N₂O (Domingo-Félez *et al.* 2014; Staunton & Aitken 2015).

The capability to simulate N₂O emissions by mathematical models allows the consideration of N₂O emissions in the design and operation of short-cut nitrogen removal processes. N₂O models have evolved from simple one-pathway models (from AOB or from 3rd or 4th steps of heterotrophic denitrification) (Hiatt & Grady 2008; Mampaey *et al.* 2013; Pan *et al.* 2013) to two-pathway AOB models (Ni *et al.* 2014; Pocquet *et al.* 2016) that involve both N₂O production pathways from AOB. Thereafter, integrated pathway models were developed that consider both AOB and heterotrophic N₂O generations (Guo & Vanrolleghem 2014; Domingo-Félez & Smets 2016; Spérandio *et al.* 2016), and indicating that N₂O can also be further removed but only by HB (Guo & Vanrolleghem 2014). These integrated pathway models have been applied in conventional systems as a powerful tool to evaluate N₂O mitigation strategies (Chen *et al.* 2019; Duan *et al.* 2020, 2021).

With essentially the same principles of N_2O generation, models developed in nitrification and denitrification systems can be directly applied to the short-cut nitrogen removal processes. For example, Wan *et al.* (2019) integrated the two pathway N_2O model by Pocquet *et al.* (2016), with the heterotrophic N_2O production model by Hiatt & Grady (2008) to describe N_2O emissions in a single-stage PNA reactor. The established N_2O model was used to evaluate the effects of operational conditions on N_2O emissions from the PNA system and identified the potential operational conditions to reduce emissions.

Challenges and uncertainties are present in the modelling of N_2O emissions in mainstream short-cut nitrogen removal systems. The largest uncertainty results from the lack of datasets. N_2O emission data from full-scale mainstream short-cut nitrogen removal systems are limited. On the other hand, the data obtained from lab-scale applications show high emission ratios ($5.2 \pm 4.5\%$ of total inorganic N removed) (Roots *et al.* 2020). In addition, many short-cut nitrogen removal evaluations lack N_2O data. Therefore, adequate nitrogen species profiling data becomes crucial to establish nitrogen mass balances. Another challenge is that N_2O process models tend to overparameterize the description of biological pathways and this impacts the N_2O model calibration (Domingo-Félez & Smets 2020).

3. HOW MODELLING CAN ACCELERATE THE FULL-SCALE MAINSTREAM APPLICATIONS

In the mainstream application of short-cut N removal processes, mathematical models are being mostly used to simulate the behaviour of biological processes under different operating scenarios and cost-effectiveness (Shourjeh *et al.* 2021). Although currently experimental work in laboratory and pilot-scale systems prevails over mechanistic model analysis for short-cut processes (M. Zhang *et al.* 2019; Z. Zhang *et al.* 2020), modelling efforts can help to accelerate mainstream full-scale applications. In this section, several modelling goals and potential benefits are presented from a modeller perspective to reveal how modelling could be useful to achieve successful applications (Figure 2).

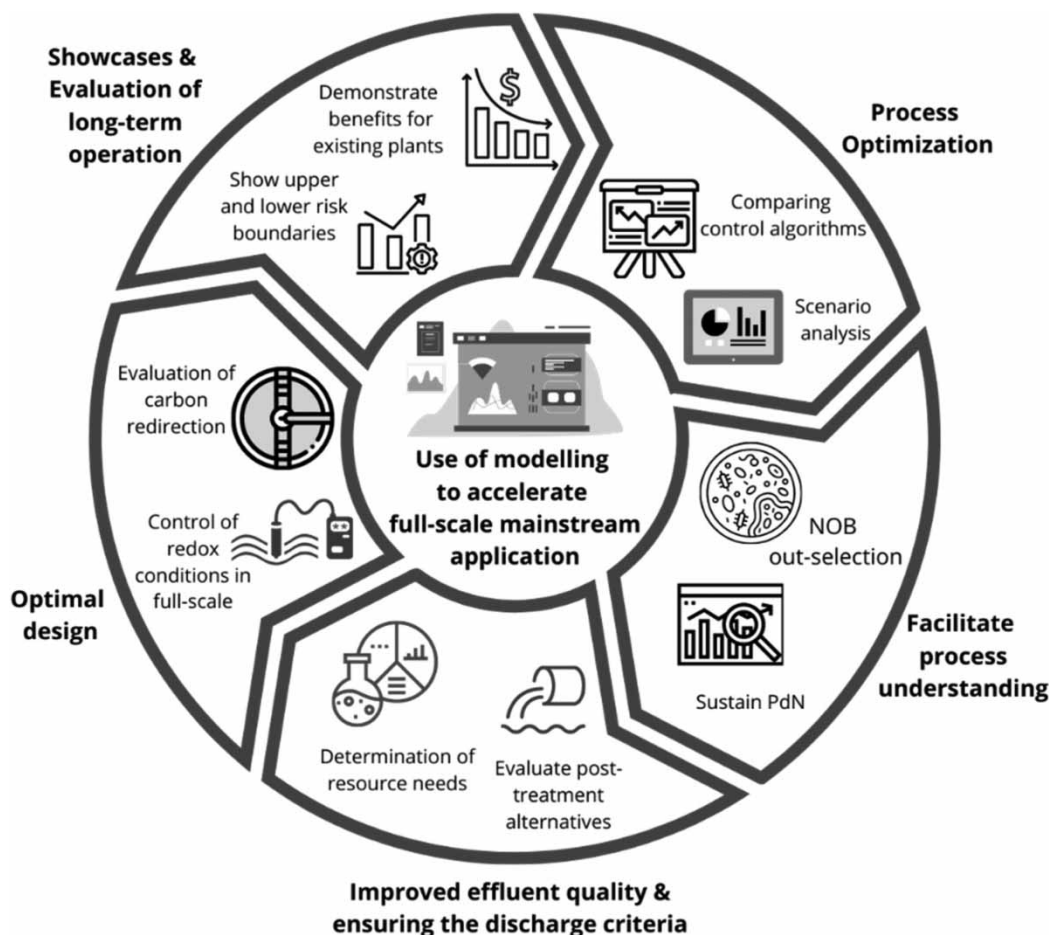


Figure 2 | How to benefit from modelling to accelerate full-scale mainstream application.

3.1. Facilitate process understanding

As presented in Section 2, models are mainly being used to facilitate the process understanding and improve process efficiency through improved operation and process control. Existing models can improve mainstream NOB out-selection applications for PNA processes since it allows assessment of the impacts of stable and dynamic influent conditions, biofilm characteristics and aeration control strategies (Al-Omari *et al.* 2015; Rosenthal *et al.* 2018). With the ability to simulate varying influent conditions such as low or high COD/N ratios, modellers can examine the hydrolysis of biodegradable substrates and impacts on processes (Tao & Hamouda 2019). In addition, models permit the exploration of how different biofilm systems (MBBR, granular sludge, IFAS and filters) would work for mainstream applications (Boltz *et al.* 2011; Rosenthal *et al.* 2018).

Similar to NOB out-selection, existing models can be used to improve the efficiency and nitrogen removal contribution via PdNA pathway by evaluating the impact of feedstock carbon characteristics, biofilm characteristics, process configuration, aeration controls and operational conditions.

3.2. Process optimization and control

Pilot and full-scale applications of different control algorithms are increasing rapidly to provide the operational and environmental conditions to sustain short-cut N removal in mainstream treatment. Modelling can be used to design control strategies to improve the operation of existing plants and serves as a time and cost-saving tool for the evaluation of different control algorithms (Salem *et al.* 2002; Gernaey *et al.* 2004). To fulfil the effluent quality standards, reduce carbon footprint and keep the operational costs at a low level, it is imperative to use control strategies to optimize resource consumption (Ostace *et al.* 2011; Revollar *et al.* 2020).

To achieve mainstream deammonification, several real-time aeration control strategies have been developed and applied such as continuously low DO operation, AvN ($\text{NH}_4^+\text{-N}$ vs $\text{NO}_x^-\text{-N}$) with intermittent aeration, ammonia-based aeration control (ABAC) (Regmi *et al.* 2014; Sadowski *et al.* 2015; Poot *et al.* 2016). Together with the real-time aeration control, the application of short aerobic SRT is a robust control strategy that relies on adjusting the wasting rate, aerobic volume and DO setpoints to suppress NOB in PNA systems (Regmi *et al.* 2014; Han *et al.* 2016). Nitrate-based COD dosing control is needed in PdNA systems to ensure nitrite availability for anammox (Le *et al.* 2019a). Finally, yet importantly, dynamic feed-forward control of the AvN setpoint to respond to changes in the influent ammonia can be implemented to maximize the PdNA efficiency with savings in carbon dosage (Le *et al.* 2019c). By using the information and experience obtained from lab and pilot-scale studies, modelling can be used to compare features of different process control strategies, provide a proof of concept, and develop the control algorithms (e.g. feedforward control based on the influent dynamics or multi-objective control).

3.3. Evaluation of post-treatment requirement

Depending on the short-cut nitrogen removal process efficiency and the effluent requirements, the post-treatment might be needed for the removal of nitrate, nitrite or residual ammonia. Often in the short-cut N process, nitrate may still be present in the effluent, especially when NOB out-selection efficiency is compromised (Gustavsson *et al.* 2020; Muñoz 2020). This requires post-treatment such as heterotrophic denitrification with external carbon dosage. Effluent ammonia can be an issue at high loading rates and a reaeration zone might be needed. Models can be used to design and test the required post-treatment alternatives coupled with control strategies, determine the reactor volume needed, air consumption or the applicable type of chemical dosage. It can be helpful to ensure the effluent limits and analyse the overall resource consumption in long-term operation.

3.4. Demonstration of the potential benefits of technology add-ons for existing processes under real conditions

Modifying a conventional N removal process with short-cut N removal processes can reduce overall energy and resource consumption of a WRRF. To demonstrate and quantify the gains of such modifications, models can be used for the capacity analysis of a WRRF by identifying the SRT, volume necessity, chemical consumption and stoichiometric needs for the processes (Shao *et al.* 2021). For example, Al-Omari *et al.* (2015) used a calibrated model for a hypothetical scenario and demonstrated the potential of 60% external carbon savings by converting the conventional nitrification denitrification system to mainstream deammonification with the Blue Plains WRRF case study. Moreover, such evaluations provide an assessment of the potential performance to meet the total inorganic nitrogen effluent limits and associated risk in long-

term operations. Demonstration of the benefits of technology for existing plants can be achieved when transferable validated process models are available, and the model parameter values are obtained.

Furthermore, from a plant-wide modelling perspective, mainstream short-cut N removal processes are interacting with other biochemical and chemical processes in the WRRF which would be important to capture both the dynamics of the plant and the potential environmental impacts (Arnell *et al.* 2017). For example, through plant-wide modelling, the influence of carbon redirection process on the downstream short-cut N removal process performance and the microbial species could be predicted; including the greenhouse gas emissions, carbon and energy footprint of the WRRF (Mannina *et al.* 2019). Simulating the whole plant would allow determining if the side-stream processes can be used to support the mainstream processes through seeding the bacteria (AOB or Anammox, e.g. Wett *et al.* 2015) or providing FNA or FN exposure (e.g. D. Wang *et al.* 2016; Duan *et al.* 2019a). In addition, combined biological P and short-cut N removal potential can be investigated. Thus, adopting the plant-wide modelling approach can be useful to demonstrate the gains in terms of process performance and stability in full-scale implementations.

4. THE NEED FOR NOVEL MODELLING APPROACHES

Despite its limitations, modelling is proven to be useful to help achieve full-scale mainstream N removal processes (Section 2&3). The applications at different scales provide invaluable information to support and improve the models while the modelling efforts can help to accelerate successful practical application and foresee challenges. Within this section, the needs and future perspectives on model applications are presented. Based on the discussion outputs of the *Workshop of the 7th IWA/ WEF Water Resource Recovery Modelling Seminar Mainstream Short-cut Nitrogen Removal Modelling: From research to full-scale implementation, do we have what we need?*, a feasibility versus importance chart is given in Figure 3 for the future

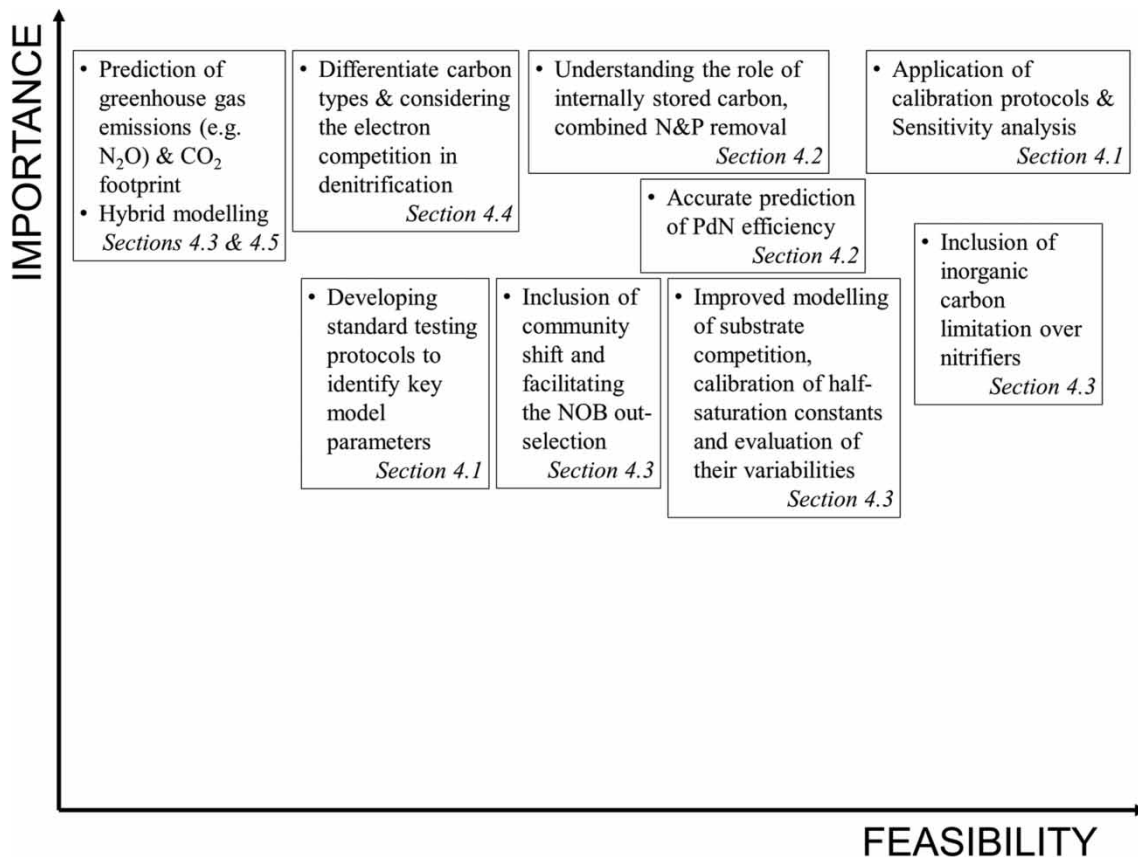


Figure 3 | Importance vs feasibility chart for the future works needed to improve short-cut N removal modelling.

works that are urgently needed (the discussion points with less importance are not included). The main subjects are discussed in detail below.

4.1. Parameter estimation methodology

For the modelling of short-cut processes, robust calibration methodologies and model developments are needed to find the optimal range of influential model parameters and improve process understanding and stability. Existing process models for short-cut nitrogen removal are commonly used for scenario analysis to evaluate process performance under varying operating conditions (e.g. Mozumder *et al.* 2014; Pérez *et al.* 2014). The models are mostly goal-oriented (i.e. applied for a specific purpose and case), but are seldom followed by experimental validation. For example, the degree of stratification of AOB and NOB in nitrifying granules (Soler-Jofra *et al.* 2019), or the postulated pH-driven inhibition of NOB in a PNA system (Y. Ma *et al.* 2017) are later confirmed by pH microprofiles which is related to the NOB out-selection in biofilm systems (Ma *et al.* 2021).

Based on the analysis of the reported modelling studies in literature, it appears that the applied calibration methodologies are seldom following good modelling practice which makes the comparison between modelling studies difficult. This is probably due to the complexity and change of the microbial communities studied with lab-scale systems when they are applied to full-scale (Rieger *et al.* 2012). Selection of the parameters is typically based on expert knowledge following the parsimonious principle (i.e. keep the number of parameters to be estimated as small as possible), and the calibration methodology itself mostly is not well described (Al-Omari *et al.* 2015; Trojanowicz *et al.* 2019; Drewnowski *et al.* 2020; Roots *et al.* 2020). One should be aware that this type of model calibration may lead to unrealistic model outputs when the model is run without boundary conditions and is extrapolated for process optimization. Moreover, the model parameter values estimated in this way may not be transferable to other systems. Proper model validation can protect from such unrealistic extrapolation as it would indicate to what extent extrapolation is feasible.

The application of robust sensitivity analysis and the use of more rigorous calibration methodologies would make the comparison between model structures possible and the simulated model outputs would become reproducible and transferable. Importantly, it also enables the modeller to identify the main model factors to pay attention to in terms of model algorithms and the data (Mannina *et al.* 2010; Vangsgaard *et al.* 2013). This identification can reveal which data is more informative for model calibration, thus can guide the experimental efforts (e.g. the higher sensitivity of growth rates regarding performance within the biofilm vs bulk recommends *in situ* microprofiling data is more informative for calibration than the bulk measurements (Y. Ma *et al.* 2017)). This issue may be minimized if long-term consistent data sets can be obtained which is typically the weakest link in modelling of short-cut processes currently.

Sensitivity analysis is the basic method to identify the most appropriate parameter subsets to be calibrated. In short-cut process models, calibration coupled with the use of more advanced approaches has been presented but has remained limited (e.g. normalized sensitivity function (Baek & Kim 2013; Y. Ma *et al.* 2017)). Sensitivity analysis can be done in a simple way through local sensitivity analysis (LSA), for which the number of model simulations that need to be run is low, typically $2*N+1$ runs (N : number of parameters) (De Pauw & Vanrolleghem 2006a). However, the LSA approach does not allow identifying interacting factors, thus may miss some of the influential model parameters and limit the use of the calibrated model. On the other hand, global sensitivity analysis (GSA) provides information on how the model outputs are influenced by the variation on the model inputs and parameters over a wide range of possible parameter values (Cosenza *et al.* 2013). Thus, GSA provides an overall view of the sensitivity and determines the important model parameters much more reliably. In addition, GSA covers interacting parameters much better (Lackner & Smets 2012). Its computational demand is higher than the one of LSA, but it can be optimized by using an appropriate sampling method, e.g. Latin Hypercube Sampling (Vanrolleghem *et al.* 2015).

Sensitivity analysis will further guide the identification of the most influential model inputs and allow for the design of future monitoring campaigns for full-scale applications with the aid of model-based optimal experimental designs (OED) (Ledergerber *et al.* 2019). OED can help design the experimental studies that are highly informative and meaningful for calibration and validation of the models and thus will make models that reliably predict the model outputs (De Pauw & Vanrolleghem 2006b). Finally, standard testing methods/protocols for the measurement of key model parameters would ensure good initial estimates of their values can be assigned since such estimates allow reducing the calibration efforts and making different case studies comparable. Examples of such standard tests are activity tests for nitrification rates and measurements of half-saturation coefficients.

4.2. Role of complex carbon types and their effects on partial denitrification

While the PdNA model from *Al-Omari et al. (2021)* has been calibrated to a range of data from pilot-scale systems and started to be applied to full-scale processes, many questions remain that may require more advanced models (Section 2.4). The developed model can simulate partial denitrification only with methanol and VFA (glycerol or acetate) substrates but have not yet been tested for more complex carbon types. Other electron donors need to be better understood to model PdNA systems that rely on complex influent COD or fermentation products. Fermentation products have been shown to be useful for partial denitrification at pilot-scale (*Ji & Chen 2010*) and PdNA (*Ali et al. 2020*). Influent COD has also been used to drive partial denitrification, although this may require in-line fermentation (*Shi et al. 2019; Ji et al. 2020; Liu et al. 2022*) or pH elevation above 9.0 (*Qian et al. 2019; Shi et al. 2019*).

Additional work needs to be done to better understand intracellular carbon storage and its impact on PdNA. Simple carbon sources like glycerol and acetate can be stored by heterotrophs (*Le et al. 2019b*), and the resulting denitrification dynamics of storage versus immediate use is not well understood in these systems. Studies have shown that internally stored carbon from influent wastewater is a promising alternative for partial denitrification (*Ji et al. 2017, 2018*). Denitrifying glycogen-accumulating organisms present (dGAO) in enhanced biological phosphorus removal (EBPR) systems may also preferentially perform denitrification (*Rubio-Rincón et al. 2017; H. Wang et al. 2019*), leading to a potential synergy between next generation EBPR and PdNA systems.

4.3. Microbial competition modelling

Estimation of half-saturation constants: An efficient deammonification system must ensure both the activity of AOB and AnAOB while the growth of NOB is inhibited (especially in PNA systems). Also, the growth of HB should be controlled since it may shift the process from deammonification to conventional nitrification and denitrification (*Cao et al. 2019; Gao & Xiang 2021*). In low substrate availability conditions such as short-cut N removal processes, microbial competition for substrate becomes important for both application and modelling. The substrate competition might be between AOB and AnAOB for ammonium as electron donor; AOB, NOB and HB competition for oxygen as electron acceptor; and AOB and NOB competition for inorganic carbon (*Shourjeh et al. 2021*). Microorganism growth kinetics and substrate affinities provide a useful tool to understand and model the substrate competition and population shift. Expanding the previous models by accommodating for the competition between main species, we will have to revisit and further study the wide range of kinetic parameters for AOB, NOB, and AnAOB (*Cao et al. 2017*).

Impacts of influent load fluctuation, environmental and operational conditions on model accuracy becomes more important and perhaps more challenging for addressing competition more accurately in the model. On the other hand, strategies and operational conditions are being tested mainly in lab-scale and modelling efforts are often lacking consistent long-term experimental data (*Table 1*). For example, related to the successful NOB out-selection, the models are mostly applied for the data out of a short-term monitoring period and only reflects the operational conditions that favour the AOB or AnAOB activities while NOB is inhibited (*Blackburne et al. 2008; Cui et al. 2017; Laurení et al. 2019; Al-Hazmi et al. 2022*). Thus, not including the challenging operational conditions that promote NOB growth may lead to an inadequate calibration of NOB activity and their out-selection. Most of the models are calibrated to reflect the periods for stable operation; hence, the half-saturation values would not change drastically except the acclimation and adaptation conditions. Using long-term, where organisms are well adapted to the operational conditions, and consistent performance data for dynamic simulation with robust calibration methodologies could be useful to overcome the calibration challenges related to competing species in the short-cut process (e.g. *Vangsgaard et al. 2013*).

The growth kinetics of microorganisms is substrate-limited based on Monod's formulation used in the ASMs which states a fixed relation between growth rate and bulk substrate concentration (*Henze et al. 2006*). Thus, the substrate half-saturation constant (or affinity constant) is crucial. It represents the substrate concentration corresponding to a half-maximal rate of growth (*Riet & Lans 2011*). The lack of understanding and proper characterization of half-saturation constant variability between different systems leads to the need for frequent calibration of half-saturation constants. However, calibration may lump the effects of different phenomena in the system (such as mixing, advection and biofilm diffusion limitations) and that may lead to a variation on the apparent values of the half-saturation constants, thus affecting the prediction power of the calibrated model (*Arnaldos et al. 2015*). For example, the current practice for oxygen mass transfer modelling is to apply overly simplified models. These models require multiple assumptions that are not valid for most applications and are highly uncertain (e.g. α -factor). Thus, the calibration of DO half-saturation constants is affected especially in short-cut

processes where small deviations in the simulated DO concentration have already a significant impact on the biological conversion processes (Amaral *et al.* 2019). In addition, transport of oxygen within the floc is driven by diffusion where temperature and DO gradient become important factors (Manser *et al.* 2005; Arnaldos *et al.* 2015). A high variation of such factors may require implementing the half-saturation constant as a model variable and calculating its value during the simulation (e.g. K_{NO_3} dependence on biomass growth rates, thus the temperature by Shaw *et al.* 2013). Furthermore, the different species of the same genera of microorganisms may have different affinities to the same substrate. For example, *Nitrobacter* or *Nitrospira* are the two main genera of NOB and their predominance in the system is affected by nitrite concentration (Nogueira & Melo 2006). For these reasons, estimation of the half-saturation constants should be handled very carefully by considering the transport phenomena and the effect of biological limitations to model the substrate competition properly. Advanced modelling tools in combination with the biokinetic models such as computational fluid dynamics and population balance models could be useful in full-scale systems (Arnaldos *et al.* 2015). The inclusion of different species in the same genera with their substrate affinities might be considered especially to model NOB suppression (see below: Inclusion of community shift). Also, when the kinetics are under dual limitation, both substrates should be taken into account in the model (Al-Omari *et al.* 2015).

Alternatively, hybrid models are an interesting avenue to pursue in this domain. Hybrid models combine mechanistic models with data-driven techniques and as such leverage both process knowledge and the power of data analytics. As a result, hybrid models can have good extrapolation properties while being less laborious to develop than strictly mechanistic models. Hybrid models can be used in many different configurations and with many different combinations of data-driven tools. However, they have been described to be specifically powerful in situations where the overall process model structure is quite well defined but specific knowledge on variability of subprocesses is missing (von Stosch *et al.* 2014). In these situations, adding a data-driven component to the well-described mechanistic model structure can specifically learn the missing dynamics and compensate for the uncertainties in the mechanistic model which can be much more efficient than going through extensive laboratory experiments to develop in-depth understanding of all the factors contributing to the variability in some subprocesses. The modelling of kinetics in short-cut N removal processes falls exactly within this definition with a lot of process knowledge and corresponding process knowledge available but a lack of mechanistic description of all factors influencing the kinetics (e.g. mixing, biofilm diffusion limitations).

Inclusion of community shift (interspecies competition): It is well-known that at low oxygen concentrations, NOBs are outcompeted because of their relatively low affinity for oxygen. Experimental evidence is available suggesting different reactor operating conditions and control strategies favour the presence of different nitrifying species, which could be different ammonium oxidizers (Bougard *et al.* 2006) and/or different nitrite oxidizers (Dytczak *et al.* 2008). Considering the oxygen concentration as the key variable governing the population shift, Volcke *et al.* (2008) modelled the shift in AOB species in a biofilm reactor. But also NOB could adapt to control strategies by community shifts, resulting in failed NOB control and subsequently disrupting the PNA or nitrite-shunt process. With the low DO (between 0.16 and 0.37 mg O₂/L) NOB control strategy, NOB gradually developed competitive edges over AOB for oxygen uptake by shifting the NOB community to be dominated by *Nitrospira* (Liu & Wang 2013). Similarly, the NOB community could adapt to inactivation from free ammonia (FA) or free nitrous acid (FNA), by shifting to *Nitrobacter*, or *Nitrospira* respectively (Duan *et al.* 2019a, 2019b).

The adaptation of NOB by community shift poses a challenge to the modelling of mainstream PNA or nitrite-shunt processes. The current ASMs with 2-step nitrification could predict the out-selection of NOB under low DO conditions given the commonly higher oxygen affinity constant of NOB than that of AOB. However, as the NOB community adapted to the low DO condition by shifting the dominant NOB genus from *Nitrobacter* to *Nitrospira*, NOB exhibited an increasingly higher affinity to oxygen (lower half-saturation constant). Modelling such NOB activities in the mainstream PNA or nitrite pathway is not feasible with one set of parameters. The inclusion of detailed microbial diversity (interspecies competition) in models for process design and operation may be warranted in cases where it affects the macroscopic reactor performance (e.g. nitrite accumulation). Taking the low DO control scenario as an example, if the model included kinetics parameters/processes for both *Nitrospira* (lower oxygen half-saturation constant) and *Nitrobacter* (higher oxygen half-saturation constant), the model may be able to predict the community shift, and the adaptation of the NOB community to the low DO conditions under long-term operation. The inclusion of the community shift in the model may allow predicting a more reliable NOB control performance, and thus a more stable mainstream PNA or nitrite-shunt process. Note that if the model includes the kinetics parameters/processes for competing interspecies, a complete washout of one the species can be predicted at certain conditions and it would never reappear even if the conditions later shift towards more favourable conditions. However, in

reality, this might happen seldom and the two species may always coexist, only switching their predominance depending on the conditions. The reason might be the seeding of NOB from the influent wastewater. It has been reported that different NOB species may be present in raw wastewater reaching the WRRFs (Jauffur *et al.* 2014; Yu *et al.* 2016). This could potentially facilitate the development of the NOB community, which may result in unstable NOB suppression in the mainstream (Duan *et al.* 2019b). To reflect this situation in the model, these interspecies must be included in the input of the model.

Inorganic carbon limitation of AOB: Inorganic carbon can be a crucial factor influencing conversions, as demonstrated by Bressani-Ribeiro *et al.* (2021) for the treatment of anaerobic effluents. Dynamics of AOB have been reported to change significantly under inorganic carbon limitation while the NOB activity remains stable (Guisasola *et al.* 2007; Ma *et al.* 2015; Zhang *et al.* 2016). Biesterfeld *et al.* (2003) showed that nitrification rates are affected by an inorganic carbon shortage (below 45 mg CaCO₃ L⁻¹) independently of pH. Instead of inorganic carbon, alkalinity (expressed as bicarbonate) is typically introduced in models to predict possible pH changes and close charge balances (Rieger *et al.* 2012). The ASMs follow that approach, in which alkalinity limitation on (single-step) nitrification is described with Monod kinetics (Henze *et al.* 2006).

The alkalinity limitation considered in these models focuses on unfavourable pH conditions rather than inorganic carbon limitation. Nevertheless, modelling approaches considering inorganic carbon limitation effects on autotrophs have been proposed, described with Monod or sigmoidal kinetics (Wett & Rauch 2003; Guisasola *et al.* 2007; Al-Omari *et al.* 2015; Seuntjens *et al.* 2018). From a fundamental standpoint, NOB is likely less limited by inorganic carbon than AOB, as the latter can up-regulate its anabolism mixotrophically using traces of organic matter (Bock 1976). However, the different behaviour of AOB and NOB under inorganic carbon depleted conditions is typically neglected in models. Moreover, mainstream process models typically assume that influent inorganic carbon content is sufficiently high, meaning hardly any limitation (Sin *et al.* 2008). Bicarbonate as a state variable should be explicitly used to quantify inorganic carbon limitation rather than to simply indicate pH changes. In this case, sigmoidal kinetics are recommended. Furthermore, a higher inorganic carbon limitation for AOB than NOB is essential for modelling nitrogen conversions in trickling filters following direct anaerobic sewage treatment (Bressani-Ribeiro *et al.* 2021).

4.4. Denitrification intermediates (electron acceptors) and electron donors

Denitrification refers to the 4-steps reduction of NO₃⁻-N to N₂ via NO₂⁻-N, NO, and N₂O. While formerly considered in denitrification models as a 1-step process, heterotrophic denitrifiers and some phosphate accumulating organisms possess a highly modular microbiome with a diverse distribution of the nar, nir, nor, and nosZ genes (Ekama & Wentzel 1999; Graf *et al.* 2014). External carbon sources such as acetate, ethanol or methanol are being added to enhance denitrification rates (Mokhayeri *et al.* 2009). The metabolic pathways to oxidize each carbon source are different: the tricarboxylic acid cycle for acetate, specific enzymes to convert ethanol to acetate, and two other pathways requiring specific enzymes for methanol degradation (Ribera-Guardia *et al.* 2014). Hence, the chemical composition of the electron donor pool will shape the microbial community yielding significantly different denitrification rates and yields (Hallin *et al.* 2006; Lu *et al.* 2014). In an enriched denitrifying community the individual addition of excess acetate, ethanol, and methanol showed distinctive NO₃⁻-N reduction rates, and more importantly, different accumulation of the intermediates NO₂⁻-N and N₂O (Ribera-Guardia *et al.* 2014). Consequently, the oxidation rate of each carbon source can be the limiting step to the overall denitrification rate even at non-limiting organic carbon concentrations (Gao *et al.* 2020).

The distinct reduction and accumulation of denitrification intermediates depending on the carbon source is crucial especially for the PdNA systems since the partial denitrification rate is the key factor for the process performance. Two-step denitrification models fit the purpose of modelling short-cut N removal processes, but the ASMN extended to 4-steps to incorporate NO and N₂O reduction based on Von Schulthess *et al.* (1995). The current structures based on ASMN assume that carbon oxidation supplies all the electrons necessary for the four denitrification steps, leading to include individual maximum denitrification rates, substrate affinity and inhibition constants (e.g. NO, DO). Hence, the complexity of 4-step denitrification models increases significantly while datasets for the intermediates NO and N₂O remain scarce. Thus assumptions need to be made on substrate affinity kinetics for NO and N₂O reduction (Hiatt & Grady 2008). The specific maximum reduction rates for NO₃⁻-N and NO₂⁻-N vary substantially depending on the carbon source, and are typically modified during model calibrations to fit denitrification rates (Q. Wang *et al.* 2016; Domingo-Félez & Smets 2020). However, the approach of additive kinetics in ASMN fails to properly describe the electron competition (Pan *et al.* 2015). To overcome this challenge, the ASM-ICE (indirect coupling of electrons) was introduced to explicitly calculate the concentration of internal electron carriers of a methanol-enriched denitrifying community uncoupling the denitrification and carbon oxidation processes over one

branch at a cost of higher model complexity (Pan *et al.* 2013). Based on Almeida *et al.* (1997) the ASM–EC (electron competition) calculates denitrification rates and carbon oxidation as an analogy to current intensity flowing through a parallel set of resistors in electric circuits. The ASM–EC was validated with data from batch experiments with four different carbon sources including acetate, ethanol, methanol, and their ternary mixture with fewer parameters than the ASM-ICE (Domingo-Félez & Smets 2020).

4.5. Inclusion of N₂O emission

N₂O models have been developed in biological nitrogen removal systems and reached maturity to facilitate process optimization of conventional N removal systems (Section 2.4). However, they have not been widely applied in modelling short-cut processes. The lack of datasets is one of the major challenges to applying N₂O models and particularly the datasets from large-scale demonstrations. For that reason, monitoring the N₂O emissions is essential in pilot and full-scale applications to improve the applicability of N₂O models in mainstream short-cut processes. Hybrid models can also be adopted for short-term laboratory or pilot-scale studies with data scarcity where mechanistic models can be used to simulate the biological process and the data generated can be used in a data-driven model that acts as input to a N₂O prediction algorithm (Mehrani *et al.* 2022).

N₂O modelling in mainstream short-cut N removal systems shares similar challenges as in conventional nitrification and 2-step denitrification systems. For example, since N₂O is an intermediate in the nitrogen transformation pathways, N₂O models require a laborious calibration process under varying operational conditions (Hwangbo *et al.* 2021). Also, microbial communities involved in N₂O production are more complex than conventional systems (e.g. NO is an intermediate of the anammox metabolism and the precursor of N₂O for AOB and heterotrophic denitrifiers). This leads to overparameterized N₂O process models for the description of biological pathways. For example, the aforementioned preferential uptake of carbon sources leads to different patterns of NO₂⁻ accumulation during denitrification (Ribera-Guardia *et al.* 2014; Zhao *et al.* 2018) and impacts N₂O model calibration (Domingo-Félez & Smets 2020). Thus, while it is important to include the N₂O models for modelling of short-cut processes, model complexity and ease-of-use should be prioritized based on the modelling goals.

5. CONCLUSION AND PERSPECTIVES

A review was presented on models for short-cut N removal processes, in view of mainstream applications, considering the current practice, limitations, future needs and perspectives. Mathematical models are under development to overcome implementation challenges and to deal with the complexity of mainstream deammonification. The pilot and full-scale applications reported provide invaluable information for models development while modelling efforts can accelerate the success of practical applications.

- NOB out-selection is still a major issue for mainstream application. Its dynamics can be captured in individual models but there are still limitations such as the model parameter values that may vary depending on the process configuration and operating conditions. Thus, they may not be transferable to another system.
- Recent modelling efforts mostly deal with the application of mainstream deammonification in full-scale and there appears to be less focus on nitrite-shunt.
- To correctly model the N mass balance and anammox process performance, models should consider incorporation of heterotrophic denitrifiers and anammox bacteria and the yield for the overall anammox metabolic reaction based on ammonium take up.
- While steady-state simulations have been used to model the overall feasibility and performance of short-cut N removal systems, dynamic simulations are especially needed to address issues with capacity evaluations, control strategies for sustained performance, and assessing the risk for meeting effluent limits.
- The application of robust sensitivity analysis is urgently needed and more rigorous calibration methodologies should be adopted to allow the comparison between model structures. The simulated model outputs would become much more reproducible and transferable.
- Modelling PdNA requires accurate modelling of partial denitrification and the ability to address microbial competition among the electron acceptors for various carbon sources. The existing PdNA models were only tested thus far to simulate partial denitrification with simple carbon sources. Other electron donors need to be better characterized and evaluated

using the models to simulate PdNA systems that rely on complex influent COD, fermentation products or internally stored carbon.

- Competition over different substrates and estimation of half-saturation constants should be handled carefully by considering system properties such as mixing, diffusion processes and substrate limitations such as by nitrite and inorganic carbon availability to properly model the substrate competition and out-selection. Hybrid models can be adopted by adding a data-driven component to the well-described mechanistic model structure to model substrate competition properly and compensate the lack of mechanistic description of subprocesses influencing the kinetics of short-cut processes.
- The inclusion of interspecies competition in models by implementing different genera of the same functional group (with different kinetic properties) may be warranted in cases where it affects the macroscopic reactor performance in order to predict a more reliable NOB control performance, and thus find conditions for a more successful process start-up and stable mainstream short-cut process.
- The denitrification intermediate steps are crucial especially for partial denitrification efficiency and N₂O emissions. In model development, 2-step denitrification fits the purpose of modelling short-cut process efficiency while more detailed 4-step models should be adopted if the modelling goal is to predict both process efficiency and N₂O emissions.

ACKNOWLEDGEMENTS

This work is an outcome of discussions at the ‘Mainstream Short-cut Nitrogen Removal Modelling: From research to full-scale implementation, do we have what we need?’ Workshop of the 7th IWA/WEF Water Resource Recovery Modelling Seminar. It is a collective effort by the practitioners and academics of the wastewater industry who are keen to implement the deammonification process sustainably on mainstream treatment.

DECLARATION OF COMPETING INTEREST

The authors declare that they have no known competing financial interests or personal relationships that could influence the work reported in this paper.

DATA AVAILABILITY STATEMENT

All relevant data are included in the paper or its Supplementary Information.

REFERENCES

- Agrawal, S., Seuntjens, D., Cocker, P. D., Lackner, S. & Vlaeminck, S. E. 2018 [Success of mainstream partial nitrification/anammox demands integration of engineering, microbiome and modeling insights](#). *Current Opinion in Biotechnology* **50**, 214–221. doi:10.1016/j.copbio.2018.01.013.
- Al-Hazmi, H. E., Yin, Z., Grubba, D., Majtacz, J. B. & Makinia, J. 2022 [Comparison of the efficiency of deammonification under different DO concentrations in a laboratory-scale sequencing batch reactor](#). *Water* **14** (3), 368. doi:10.3390/w14030368.
- Ali, P., Zalivina, N., Le, T., Riffat, R., Ergas, S., Wett, B., Murthy, S., Al-Omari, A., deBarbadillo, C., Bott, C. & De Clippeleir, H. 2020 [Primary sludge fermentate as carbon source for mainstream partial denitrification – anammox \(PdNA\)](#). *Water Environment Research* **93** (7), 1044–1059. doi:10.1002/wer.1492.
- Almeida, J. S., Reis, M. A. M. & Carrondo, M. J. T. 1997 [A unifying kinetic model of denitrification](#). *Journal of Theoretical Biology* **186** (2), 241–249. doi:10.1006/jtbi.1996.0352.
- Al-Omari, A., Wett, B., Nopens, I., De Clippeleir, D., Han, M., Regmi, P., Bott, C. & Murthy, S. 2015 [Model-based evaluation of mechanisms and benefits of mainstream shortcut nitrogen removal processes](#). *Water Science and Technology* **71** (6), 840–847. doi:10.2166/wst.2015.022.
- Al-Omari, A., De Clippeleir, H., Ladipo-Obasa, M., Klaus, S., Bott, C. B., McCullough, K., Fofana, R., Wadhawan, T., Murthy, S., Fevig, S., Jimenez, J., Wett, B. & Nopens, I. 2021 [Modelling partial heterotrophic denitrification in mainstream nitrogen removal processes – model development and evaluation](#). In: *Proceedings of 7th IWA Water Resource Recovery Modelling Seminar*. International Water Association, pp. 67–71.
- Amaral, A., Gillot, S., Garrido-Baserba, M., Filali, A., Karpinska, A. M., Plósz, B. G., De Groot, C., Bellandi, G., Nopens, I., Takács, I., Lizarralde, I., Jimenez, J. A., Fiat, J., Rieger, L., Arnell, M., Andersen, M., Jeppsson, U., Rehman, U., Fayolle, Y., Amerlinck, Y. & Rosso, R. 2019 [Modelling gas–liquid mass transfer in wastewater treatment: when current knowledge needs to encounter engineering practice and vice versa](#). *Water Science and Technology* **80** (4), 607–619. doi:10.2166/wst.2019.253.
- Arnaldos, M., Amerlinck, Y., Rehman, U., Maere, T., Van Hoey, S., Naessens, W. & Nopens, I. 2015 [From the affinity constant to the half-saturation index: understanding conventional modeling concepts in novel wastewater treatment processes](#). *Water Research* **70**, 458–470. doi:10.1016/j.watres.2014.11.046.

- Arnell, M., Rahmberg, M., Oliveira, F. & Jeppsson, U. 2017 Multi-objective performance assessment of wastewater treatment plants combining plant-wide process models and life cycle assessment. *Journal of Water and Climate Change* **8** (4), 715–729. doi:10.2166/wcc.2017.179.
- Baek, S. H. & Kim, H. J. 2013 Mathematical model for simultaneous nitrification and denitrification (SND) in membrane bioreactor (MBR) under low dissolved oxygen (DO) concentrations. *Biotechnology and Bioprocess Engineering* **18**, 104–110. doi:10.1007/s12257-011-0419-6.
- Baeten, J. E., Batstone, D. J., Schraa, O. J., van Loosdrecht, M. C. M. & Volcke, E. I. P. 2019 Modelling anaerobic, aerobic and partial nitrification-anammox granular sludge reactors – a review. *Water Research* **149**, 322–341. doi:10.1016/j.watres.2018.11.026.
- Biesterfeld, S., Farmer, G., Russel, P. & Figueroa, L. 2003 Effect of alkalinity type and concentration on nitrifying biofilm activity. *Water Environment Research* **75** (3), 196–204. Available from: <https://www.jstor.org/stable/25045684>
- Blackburne, R., Yuan, Z. & Keller, J. 2008 Demonstration of nitrogen removal via nitrite in a sequencing batch reactor treating domestic wastewater. *Water Research* **42**, 2166–2176. doi:10.1016/j.watres.2007.11.029.
- Bock, E. 1976 Growth of *Nitrobacter* in the presence of organic matter. *Archives of Microbiology* **108** (3), 305–312. doi: 10.1007/BF00454857.
- Boltz, J. P., Morgenroth, E., Brockmann, D., Bott, C., Gellner, W. J. & Vanrolleghem, P. A. 2011 Systematic evaluation of biofilm models for engineering practice: components and critical assumptions. *Water Science and Technology* **64** (4), 930–944. doi:10.2166/wst.2011.709.
- Bougard, D., Bernet, N., Dabert, P., Delgenes, J. P. & Steyer, J. P. 2006 Influence of closed loop control on microbial diversity in a nitrification process. *Water Science and Technology* **53** (4–5), 85–93. doi:10.2166/wst.2006.113.
- Bournazou, M. C., Hooshar, K., Arellano-Garcia, H., Wozny, G. & Lyberatos, G. 2013 Model based optimization of the intermittent aeration profile for SBRs under partial nitrification. *Water Research* **47** (10), 3399–3410. doi:10.1016/j.watres.2013.03.044.
- Bozileva, E., Khiewwijit, R., Temmink, H., Rijnaarts, H. & Keesman, K. 2017 Exploring the feasibility of a novel municipal wastewater treatment system via dynamic plant-wide simulation. In: *Frontiers in Wastewater Treatment and Modelling. FICWTM 2017. Lecture Notes in Civil Engineering*, vol. 4 (Mannina, G., ed.). Springer, Cham, pp. 575–582. doi:10.1007/978-3-319-58421-8_90.
- Bressani-Ribeiro, T., Almeida, P. G. S., Chernicharo, C. A. L. & Volcke, E. I. P. 2021 Inorganic carbon limitation during nitrogen conversions in sponge-bed trickling filters for mainstream treatment of anaerobic effluent. *Water Research* **201**, 117337. doi:10.1016/j.watres.2021.117337.
- Campolong, C., Klaus, S., Ferguson, L., Wilson, C., Wett, B., Murthy, S. & Bott, C. B. 2018 Optimizing carbon addition to a polishing partial denitrification/anammox MBBR using online control. In: *Proceedings of the Water Environment Federation*. Water Environment Federation, pp. 164–168. doi:10.2175/193864718824940565.
- Cao, S., Wang, S., Peng, Y., Wu, C., Du, R., Gong, L. & Ma, B. 2013 Achieving partial denitrification with sludge fermentation liquid as carbon source: the effect of seeding sludge. *Bioresource Technology* **149**, 570–574. doi:10.1016/j.biortech.2013.09.072.
- Cao, S., Oehmen, A. & Zhou, Y. 2019 Denitrifiers in mainstream anammox processes: competitors or supporters? *Environmental Science and Technology* **53** (9), 11063–11065. doi:10.1021/acs.est.9b05013.
- Cao, Y., van Loosdrecht, M. C. M. & Daigger, G. T. 2017 Mainstream partial nitrification-anammox in municipal wastewater treatment: status, bottlenecks, and further studies. *Applied Microbiology and Biotechnology* **101** (4), 1365–1383. doi:10.1007/s00253-016-8058-7.
- Castro-Barros, C. M., Rodríguez-Caballero, A., Volcke, E. I. P. & Pijuan, M. 2016 Effect of nitrite on the N₂O and NO production on the nitrification of low-strength ammonium wastewater. *Chemical Engineering Journal* **287**, 269–276. <https://doi.org/10.1016/j.cej.2015.10.121>.
- Chen, H., Tu, Z., Wu, S., Yu, G., Du, C., Wang, H., Yang, E., Zhou, L., Deng, B., Wang, D. & Li, H. 2021 Recent advances in partial denitrification-anaerobic ammonium oxidation process for mainstream municipal wastewater treatment. *Chemosphere* **278**, 30436. doi:10.1016/j.chemosphere.2021.130436.
- Chen, X., Mielczarek, A. T., Habicht, K., Andersen, M. H., Thornberg, D. & Sin, G. 2019 Assessment of full-scale N₂O emission characteristics and testing of control concepts in an activated sludge wastewater treatment plant with alternating aerobic and anoxic phases. *Environmental Science and Technology* **53** (21), 12485–12494. doi:10.1021/acs.est.9b04889.
- Cosenza, A., Mannina, G., Vanrolleghem, P. A. & Neumann, M. B. 2013 Global sensitivity analysis in wastewater applications: a comprehensive comparison of different methods. *Environmental Modelling & Software* **49**, 40–52. <https://doi.org/10.1016/j.envsoft.2013.07.009>.
- Cui, F., Park, S., Mo, K., Lee, W., Lee, H. & Kim, M. 2017 Experimentation and mathematical models for partial nitrification in aerobic granular sludge process. *KSCE Journal of Civil Engineering* **21**, 127–133. doi:10.1007/s12205-016-0506-5.
- Daigger, G. T. 2014 Oxygen and carbon requirements for biological nitrogen removal processes accomplishing nitrification, nitritation, and anammox. *Water Environment Research* **86** (3), 204–209. doi:10.2175/106143013(13807328849459).
- De Clippeleir, H., Vlaeminck, S. E., De Wilde, F., Daeninck, K., Mosquera, M., Boeckx, P., Verstraete, W. & Boon, N. 2015 One-stage partial nitritation/anammox at 15 °C on pretreated sewage: feasibility demonstration at lab-scale. *Applied Microbiology and Biotechnology* **97** (23), 10199–10210. doi:10.1007/s00253-013-4744-x.
- De Kreuk, M. K., Picioreanu, C., Hosseini, M., Xavier, J. B. & van Loosdrecht, M. C. M. 2007 Kinetic model of a granular sludge SBR: influences on nutrient removal. *Biotechnology and Bioengineering* **97** (4), 801–815. doi:10.1002/bit.21196.
- De Pauw, D. J. & Vanrolleghem, P. A. 2006a Practical aspects of sensitivity function approximation for dynamic models. *Mathematical and Computer Modelling of Dynamical Systems* **12** (5), 395–414. doi:10.1080/13873950600723301.
- De Pauw, D. J. & Vanrolleghem, P. A. 2006b Designing and performing experiments for model calibration using an automated iterative procedure. *Water Science and Technology* **53** (1), 117–127. <https://doi.org/10.2166/wst.2006.014>.
- Domingo-Félez, C. & Smets, B. F. 2016 A consilience model to describe N₂O production during biological N removal. *Environmental Science: Water Research & Technology* **2** (6), 923–930. doi:10.1039/C6EW00179C.

- Domingo-Félez, C. & Smets, B. F. 2020 Modeling denitrification as an electric circuit accurately captures electron competition between individual reductive steps: the activated sludge model–electron competition model. *Environmental Science & Technology* **54** (12), 7330–7338. doi:10.1021/acs.est.0c01095.
- Domingo-Félez, C., Mutlu, A. G., Jensen, M. M. & Smets, B. F. 2014 Aeration strategies to mitigate nitrous oxide emissions from single-stage nitrification/Anammox reactors. *Environmental Science and Technology* **48** (15), 8679–8687. doi:10.1021/es501819n.
- Drewnowski, J., Shourjeh, M. S., Kowal, P. & Cel, W. 2020 Modelling AOB-NOB competition in shortcut nitrification compared with conventional nitrification-denitrification process. In: *Journal of Physics: Conference Series, Volume 1736, V International Conference of Computational Methods in Engineering Science – CMES'20*, Lublin, Poland – Lviv, Ukraine.
- Du, R., Cao, S., Li, B., Niu, M., Wang, S. & Peng, Y. 2017 Performance and microbial community analysis of a novel DEAMOX based on partial-denitrification and anammox treating ammonia and nitrate wastewaters. *Water Research* **108**, 46–65. doi:10.1016/j.watres.2016.10.051.
- Du, R., Peng, Y., Ji, J., Shi, L., Gao, R. & Li, X. 2019 Partial denitrification providing nitrite: opportunities of extending application for anammox. *Environment International* **131**, 105001. doi:10.1016/j.envint.2019.105001.
- Duan, H., Ye, L., Erler, D., Ni, B. J. & Yuan, Z. 2017 Quantifying nitrous oxide production pathways in wastewater treatment systems using isotope technology – a critical review. *Water Research* **122**, 96–113. doi:10.1016/j.watres.2017.05.054.
- Duan, H., Ye, L., Lu, X. & Yuan, Z. 2019a Overcoming nitrite oxidizing bacteria adaptation through alternating sludge treatment with free nitrous acid and free ammonia. *Environmental Science and Technology* **53** (4), 1937–1946. doi:10.1021/acs.est.8b06148.
- Duan, H., Ye, L., Wang, Q., Zheng, M., Lu, X., Wang, Z. & Yuan, Z. 2019b Nitrite oxidizing bacteria (NOB) contained in influent deteriorate mainstream NOB suppression by sidestream inactivation. *Water Research* **162**, 331–338. doi:10.1016/j.watres.2019.07.002.
- Duan, H., van den Akker, B., Thwaites, B. J., Peng, L., Herman, C., Pan, Y., Ni, B.-J., Watt, S., Yuan, Z. & Ye, L. 2020 Mitigating nitrous oxide emissions at a full-scale wastewater treatment plant. *Water Research* **185**, 116196. doi:10.1016/j.watres.2020.116196.
- Duan, H., Zhao, Y., Koch, K., Wells, G. F., Zheng, M., Yuan, Z. & Ye, L. 2021 Insights into nitrous oxide mitigation strategies in wastewater treatment and challenges for wider implementation. *Environmental Science and Technology* **55** (11), 7208–7224. doi:10.1021/acs.est.1c00840.
- Dytczak, M. A., Londry, K. L. & Oleszkiewicz, J. A. 2008 Activated sludge operational regime has significant impact on the type of nitrifying community and its nitrification rates. *Water Research* **42** (8–9), 2320–2328. doi:10.1016/j.watres.2007.12.018.
- Edenhofer, O., Pichs-Madruga, R., Sokona, Y., Minx, J. C., Farahani, E., Kadner, S., Seyboth, K., Adler, A., Baum, I., Brunner, S., Eickemeier, P., Kriemann, B., Savolainen, J., Schlömer, S., von Stechow, C. & Zwickel, T. 2014 IPCC, 2014: Climate Change 2014: Mitigation of Climate Change. In: *Contribution of Working Group III to the Fifth Assessment Report of the Intergovernmental Panel on Climate Change*. Cambridge University Press, Cambridge, United Kingdom and New York, USA. <https://www.ipcc.ch/report/ar5/wg3/>.
- Ekama, G. A. & Wentzel, C. 1999 Denitrification kinetics in biological N and P removal activated sludge systems treating municipal wastewaters. *Water Science and Technology* **39** (6), 69–77. doi:10.1016/S0273-1223(99)00124-9.
- Ganigué, R., Gabarró, J., Sánchez-Melsió, A., Rusalleda, M., López, H., Vila, X., Colprim, J. & Dolors Balaguer, M. 2009 Long-term operation of a partial nitrification pilot plant treating leachate with extremely high ammonium concentration prior to an anammox process. *Bioresource Technology* **100** (23), 5624–5632. doi:10.1016/j.biortech.2009.06.023.
- Gao, D. & Xiang, T. 2021 Deammonification process in municipal wastewater treatment: challenges and perspectives. *Bioresource Technology* **320**, 124420. doi:10.1016/j.biortech.2020.124420.
- Gao, H., Zhao, X., Zhou, L., Sabba, F. & Wells, G. F. 2020 Differential kinetics of nitrogen oxides reduction leads to elevated nitrous oxide production by a nitrite fed granular denitrifying EBPR bioreactor. *Environmental Science: Water Research & Technology* **6** (4), 1028–1043. doi:10.1039/C9EW00881K.
- Gernaey, K., van Loosdrecht, M. C. M., Lind, M. & Jørgensen, S. B. 2004 Activated sludge wastewater treatment plant modelling and simulation: state of the art. *Environmental Modelling & Software* **19** (9), 763–783. doi:10.1016/j.envsoft.2003.03.005.
- Gilbert, E. M., Agrawal, S., Brunner, F., Schwartz, T., Horn, H. & Lackner, S. 2014 Response of different *Nitrospira* species to anoxic periods. *Environmental Science and Technology* **48** (5), 2934–2941. doi:10.1021/es404992g.
- Gilbert, E. M., Agrawal, S., Schwartz, T., Horn, H. & Lackner, S. 2015 Comparing different reactor configurations for partial nitrification/anammox at low temperatures. *Water Research* **81**, 92–100. doi:10.1016/j.watres.2015.05.022.
- Graf, D. R., Jones, C. M. & Hallin, S. 2014 Intergenomic comparisons highlight modularity of the denitrification pathway and underpin the importance of community structure for N₂O emissions. *PLoS One* **9** (12), e114118. eCollection 2014. doi:10.1371/journal.pone.0114118.
- Guisasola, A., Petzet, S., Baeza, J., Carrera, J. & Lafuente, J. 2007 Inorganic carbon limitations on nitrification: experimental assessment and modelling. *Water Research* **41** (2), 277–286. doi:10.1016/j.watres.2006.10.030.
- Guo, L. & Vanrolleghem, P. 2014 Calibration and validation of an activated sludge model for greenhouse gases no. 1 (ASMG1): prediction of temperature-dependent N₂O emission dynamics. *Bioprocess and Biosystem Engineering* **37** (2), 151–163. doi:10.1007/s00449-013-0978-3.
- Gustavsson, D. J., Suarez, C., Wilén, B. M., Hermansson, M. & Persson, F. 2020 Long-term stability of partial nitrification-anammox for treatment of municipal wastewater in a moving bed biofilm reactor pilot system. *Science of Total Environment* **714**, 136342. doi:10.1016/j.scitotenv.2019.136342.
- Hallin, S., Throbäck, I. N., Dicksved, J. & Pell, M. 2006 Metabolic profiles and genetic diversity of denitrifying communities in activated sludge after addition of methanol or ethanol. *Applied and Environmental Microbiology* **72** (8), 5445–5452. doi:10.1128/AEM.00809-06.

- Han, M., Clippeleir, H. D., Al-Omari, A., Wett, B., Vlaeminck, S., Bott, C. & Murthy, S. 2016 Impact of carbon to nitrogen ratio and aeration regime on mainstream deammonification. *Water Science and Technology* **74** (2), 375–384. doi:10.2166/wst.2016.202.
- Hao, X. D. & van Loosdrecht, M. C. M. 2004 Model-based evaluation of COD influence on a partial nitrification-Anammox biofilm (CANON) process. *Water Science and Technology* **49** (11–12), 83–90. <https://doi.org/10.2166/wst.2004.0810>.
- Hao, X., Heijnen, J. J. & van Loosdrecht, M. C. M. 2002 Sensitivity analysis of a biofilm model describing a one-stage completely autotrophic nitrogen removal (CANON) process. *Biotechnology and Bioengineering* **77** (3), 266–277. doi:10.1002/bit.10105.
- Hellinga, C., van Loosdrecht, M. C. M. & Heijnen, J. J. 1999 Model based design of a novel process for nitrogen removal from concentrated flows. *Mathematical and Computer Modelling of Dynamical Systems* **5** (4), 351–371. doi:10.1076/mcmd.5.4.351.3678.
- Henze, M., Gujer, W., Mino, T. & van Loosdrecht, M. C. M. 2006 *Activated Sludge Models ASM1, ASM2, ASM2d and ASM3*. IWA Publishing, Cornwall, UK. doi:10.2166/9781780402369.
- Hiatt, W. & Grady, C. 2008 An updated process model for carbon oxidation, nitrification, and denitrification. *Water Environment Research* **80** (11), 2145–2156. doi:10.2175/106143008(304776).
- Hoekstra, M., Geilvoet, S., Hendrickx, T., Erp Taalman Kip, C. V., Kleerebezem, R. & van Loosdrecht, M. C. M. 2018 Towards mainstream anammox: lessons learned from pilot-scale research at WWTP Dokhaven. *Environmental Technology* **40** (13), 1721–1733. doi:10.1080/09593330.2018.1470204.
- Huang, X., Mi, W., Hong, N., Ito, H. & Kawagoshi, Y. 2020 Efficient transition from partial nitrification to partial nitrification/Anammox in a membrane bioreactor with activated sludge as the sole seed source. *Chemosphere* **253**, 126719. doi:10.1016/j.chemosphere.2020.126719.
- Hubaux, N., Wells, G. & Morgenroth, E. 2015 Impact of coexistence of flocs and biofilm on performance of combined nitrification-anammox granular sludge reactors. *Water Research* **68**, 127–139. doi:10.1016/j.watres.2014.09.036.
- Hwangbo, S., Al, R., Chen, X. & Sin, G. 2021 Integrated model for understanding N₂O emissions from wastewater treatment plants: a deep learning approach. *Environmental Science and Technology* **55** (3), 2143–2151. doi:10.1021/acs.est.0c05231.
- Jauffur, S., Isazadeh, S. & Frigon, D. 2014 Should activated sludge models consider influent seeding of nitrifiers? Field characterization of nitrifying bacteria. *Water Science and Technology* **70** (9), 1526–1532. doi:10.2166/wst.2014.407.
- Jetten, M. S., Horn, S. J. & van Loosdrecht, M. C. M. 1997 Towards a more sustainable municipal wastewater treatment system. *Water Science and Technology* **35** (9), 171–180. doi:10.1016/S0273-1223(97)00195-9.
- Ji, J., Peng, Y., Wang, B. & Wang, S. 2017 Achievement of high nitrite accumulation via endogenous partial denitrification (EPD). *Bioresource Technology* **224**, 140–146. doi:10.1016/j.biortech.2016.11.070.
- Ji, J., Peng, Y., Mai, W., He, J., Wang, B., Li, X. & Zhang, Q. 2018 Achieving advanced nitrogen removal from low C/N wastewater by combining endogenous partial denitrification with anammox in mainstream treatment. *Bioresource Technology* **270**, 570–579. doi:10.1016/j.biortech.2018.08.124.
- Ji, J., Peng, Y., Wang, B., Li, X. & Zhang, Q. 2020 Synergistic partial-denitrification, anammox, and in-situ fermentation (SPDAF) process for advanced nitrogen removal from domestic and nitrate-containing wastewater. *Environmental Science & Technology* **54** (6), 3702–3713. doi:10.1021/acs.est.9b07928.
- Ji, Z. & Chen, Y. 2010 Using sludge fermentation liquid to improve wastewater short-cut nitrification-denitrification and denitrifying phosphorus removal via nitrite. *Environmental Science and Technology* **44** (23), 8957–8963. doi:10.1021/es102547n.
- Jia, M., Castro-Barros, C. M., Winkler, M. K. H. & Volcke, E. I. P. 2018 Effect of organic matter on the performance and N₂O emission of a granular sludge anammox reactor. *Environmental Science: Water Research and Technology* **4**, 1035–1046. doi:10.1039/C8EW00125A.
- Jia, M., Solon, K., Vandeplassche, D., Venugopal, H. & Volcke, E. I. P. 2020 Model-based evaluation of an integrated high-rate activated sludge and mainstream anammox system. *Chemical Engineering Journal* **382**, 122878. doi:10.1016/j.cej.2019.122878.
- Jimenez, J., Wise, G., Regmi, P., Burger, G., Conidi, D., Du, W. & Dold, P. 2020 Nitrite-shunt and biological phosphorus removal at low dissolved oxygen in a full-scale high-rate system at warm temperatures. *Water Environment Research* **92** (8), 1111–1122. doi:10.1002/wer.1304.
- Kartal, B., Kuenen, J. G. & Loosdrecht, M. C. M. 2010 Sewage treatment with anammox. *Science* **328** (5979), 702–703. doi:10.1126/science.1185941.
- Klaus, S. A. 2019 *Intensification of Biological Nutrient Removal Processes*. PhD Dissertation, Virginia Polytechnic Institute and State University, Virginia, USA.
- Klaus, S., Parsons, M. & Bott, C. 2020 Mainstream partial denitrification/anammox: results from operation in a full-scale deep-bed filter. In: *Proceedings of IWA Nutrient Removal and Recovery Conference 2020*, Helsinki, Finland.
- Lackner, S. & Agrawal, S. 2015 Process fundamentals – microbiology, stoichiometry, kinetics, and inhibition. In: *Shortcut Nitrogen Removal – Nitrite Shunt and Deammonification*. Water Environment Federation. <https://www.accesswater.org/?id=323517>.
- Lackner, S. & Smets, B. F. 2012 Effect of the kinetics of ammonium and nitrite oxidation on nitrification success or failure for different biofilm reactor geometries. *Biochemical Engineering Journal* **69**, 123–129. doi:10.1016/j.bej.2012.09.006.
- Lackner, S., Gilbert, E., Vlaeminck, S., Joss, A., Horn, H. & van Loosdrecht, M. C. M. 2014 Full-scale partial nitrification/anammox experiences – an application survey. *Water Research* **55**, 292–303. doi:10.1016/j.watres.2014.02.032.
- Laureni, M., Weissbrodt, D., Villez, K., Robin, O., de Jonge, N., Rosenthal, A., Wells, G., Nielsen, J. N., Morgenroth, E. & Joss, A. 2019 Biomass segregation between biofilm and flocs improves the control of nitrite-oxidizing bacteria in mainstream partial nitrification and anammox processes. *Water Research* **154**, 104–116. doi:10.1016/j.watres.2018.12.051.

- Le, T., Peng, B., Su, C., Massoudieh, A., Torrents, A., Al-Omari, A., Murthy, S., Wett, B., Chandran, K., deBarbadillo, C., Bott, C. & De Clippeleir, H. 2019a Nitrate residual as a key parameter to efficiently control partial denitrification coupling with anammox. *Water Environment Research* **91**, 1455–1465. doi:10.1002/wer.1140.
- Le, T., Peng, B., Su, C., Massoudieh, A., Torrents, A., Al-Omari, A., Murthy, S., Wett, B., Chandran, K., deBarbadillo, C., Bott, C. & De Clippeleir, H. 2019b Impact of carbon source and COD/N on the concurrent operation of partial denitrification and anammox. *Water Environment Research* **91** (3), 185–197.
- Le, T., Fofana, R., Massoudieh, A., Al-Omari, A., Murthy, S., Wett, B., Chandran, K., deBarbadillo, C., Bott, C. & De Clippeleir, H. 2019c A novel online dynamic control coupling AvN and PdN-AnAOB to achieve stringent effluent limits in mainstream during wet weather. In: *Proceedings of the Water Environment Federation, WEFTEC 2019*. Water Environment Federation, pp. 1562–1573.
- Leal, C. D., Pereira, A. D., Nunes, F. T., Ferreira, L. O., Coelho, A. C., Bicalho, S. K., Abreu Mac Conell, E. F., Bressani Ribeiro, T., de Lemos Chernicharo, C. A. & de Araújo, J. C. 2016 Anammox for nitrogen removal from anaerobically pre-treated municipal wastewater: effect of COD/N ratios on process performance and bacterial community structure. *Bioresource Technology* **211**, 257–266. doi:10.1016/j.biortech.2016.03.107.
- Ledergerber, J. M., Maruéjols, T. & Vanrolleghem, P. A. 2019 Optimal experimental design for calibration of a new sewer water quality model. *Journal of Hydrology* **574**, 1020–1028. doi:10.1016/j.jhydrol.2019.05.004.
- Li, J., Peng, Y., Zhang, L., Liu, J., Wang, X., Gao, R., Pang, L. & Zhou, Y. 2019 Quantify the contribution of anammox for enhanced nitrogen removal through metagenomic analysis and mass balance in an anoxic moving bed biofilm reactor. *Water Research* **160**, 178–187. doi:10.1016/j.watres.2019.05.070.
- Li, L., Ling, Y., Wang, H., Chu, Z., Yan, G., Li, Z. & Wu, T. 2020 N₂O emission in partial nitrification-anammox process. *Chinese Chemical Letters* **31** (1), 28–38. doi:10.1016/j.ccl.2019.06.035.
- Liu, G. & Wang, J. 2013 Long-Term low DO enriches and shifts nitrifier community in activated sludge. *Environmental Science & Technology* **47** (10), 5109–5117. doi:10.1021/es304647y.
- Liu, T., Ma, B., Chen, X., Ni, B.-J., Peng, Y. & Guo, J. 2017 Evaluation of mainstream nitrogen removal by simultaneous partial nitrification, anammox and denitrification (SNAD) process in a granule-based reactor. *Chemical Engineering Journal* **327**, 973–981. doi:10.1016/j.cej.2017.06.173.
- Liu, X., Kim, M., Nakhla, G., Andalib, M. & Fang, Y. 2020 Partial nitrification-reactor configurations, and operational conditions: performance analysis. *Journal of Environmental Chemical Engineering* **8** (4), 103984. doi:10.1016/j.jece.2020.103984.
- Liu, W., Hao, S., Ma, B., Zhang, S. & Li, J. 2022 In-situ fermentation coupling with partial-denitrification/anammox process for enhanced nitrogen removal in an integrated three-stage anoxic/oxic (A/O) biofilm reactor treating low COD/N real wastewater. *Bioresource Technology* **344**, 126267. doi:10.1016/j.biortech.2021.126267.
- Lotti, T., Kleerebezem, R., Hu, Z., Kartal, B., Kreuk, M. K., van Erp Taalman Kip, C., Kruit, J., Hendrickx, T. L. G. & van Loosdrecht, M. C. M. 2015 Pilot-scale evaluation of anammox-based mainstream nitrogen removal from municipal wastewater. *Environmental Technology* **36** (9), 1167–1177. doi:10.1080/09593330.2014.982722.
- Lu, H., Chandran, K. & Stensel, D. 2014 Microbial ecology of denitrification in biological wastewater treatment. *Water Research* **64**, 237–254. doi:10.1016/j.watres.2014.06.042.
- Lu, W., Bin, M., Wang, Q., Wei, Y. & Su, Z. 2021a Feasibility of achieving advanced nitrogen removal via endogenous denitrification/anammox. *Bioresource Technology* **325**, 124666. doi:10.1016/j.biortech.2021.124666.
- Lu, W., Zhang, Y., Wang, Q., Wei, Y., Bu, Y. & Ma, B. 2021b Achieving advanced nitrogen removal in a novel partial denitrification/anammox-nitrifying (PDA-N) biofilter process treating low C/N ratio municipal wastewater. *Bioresource Technology* **340**, 125661. doi:10.1016/j.biortech.2021.125661.
- Ma, B., Qian, W., Yuan, C., Yuan, Z. & Peng, Y. 2017 Achieving mainstream nitrogen removal through coupling anammox with denitrification. *Environmental Science and Technology* **51** (15), 8405–8413. doi:10.1021/acs.est.7b01866.
- Ma, B., Xu, X., Wei, Y., Ge, C. & Peng, Y. 2020 Recent advances in controlling denitrification for achieving denitrification/anammox in mainstream wastewater treatment plants. *Bioresource Technology* **299**, 122697. doi:10.1016/j.biortech.2019.122697.
- Ma, W.-J., Li, G.-F., Huang, B.-C. & Jin, R.-C. 2020 Advances and challenges of mainstream nitrogen removal from municipal wastewater with anammox-based processes. *Water Environment Research* **92** (11), 1899–1909. doi:10.1002/wer.1342.
- Ma, Y., Domingo-Félez, C., Plósz, B. G. & Smets, B. F. 2017 Intermittent aeration suppresses nitrite-oxidizing bacteria in membrane-aerated biofilms: a model-based explanation. *Environmental Science and Technology* **51** (11), 6146–6155. doi:10.1021/acs.est.7b00463.
- Ma, Y., Pisccedda, A., Veras, A. D., Domingo-Félez, C. & Smets, B. F. 2021 Intermittent aeration to regulate microbial activities in membrane-aerated biofilm reactors: energy-efficient nitrogen removal and low nitrous oxide emission. *Chemical Engineering Journal* 133630. (In Press). doi:10.1016/j.cej.2021.133630.
- Ma, Y., Sundar, S., Park, H. & Chandran, K. 2015 The effect of inorganic carbon on microbial interactions in a biofilm nitrification–anammox process. *Water Research* **70**, 246–254. doi:10.1016/j.watres.2014.12.006.
- Mampaey, K. E., Beuckels, B., Kampschreur, M. J., Kleerebezem, R., van Loosdrecht, M. C. M. & Volcke, E. I. P. 2013 Modelling nitrous and nitric oxide emissions by autotrophic ammonia-oxidizing bacteria. *Environmental Technology* **34** (9–12), 1555–1566. doi:10.1080/09593330.2012.758666.
- Mannina, G., Bella, G. D. & Viviani, G. 2010 Uncertainty assessment of a membrane bioreactor model using the GLUE methodology. *Biochemical Engineering Journal* **52** (2–3), 263–275. doi:10.1016/j.bej.2010.09.001.

- Mannina, G., Ferreira Rebouças, T., Cosenza, A. & Chandran, K. 2019 A plant-wide wastewater treatment plant model for carbon and energy footprint: model application and scenario analysis. *Journal of Cleaner Production* **217**, 244–256. doi:10.1016/j.jclepro.2019.01.255.
- Manser, R., Gujer, W. & Siegrist, H. 2005 Consequences of mass transfer effects on the kinetics of nitrifiers. *Water Research* **39** (19), 4633–4642. doi:10.1016/j.watres.2005.09.020.
- McCullough, K., Klaus, S., Parsons, M. & Bott, C. 2021 The theoretical benefits of mainstream shortcut nitrogen removal revisited and validated by full-scale implementation of partial denitrification-anammox. In: *Proceedings of WEF Innovations in Process Engineering 2021 Virtual Event*. Water Environment Federation.
- Mehrani, M. J., Bagherzadeh, F., Zheng, M., Kowal, P., Sobotka, D. & Makinia, J. 2022 Application of a hybrid mechanistic/machine learning model for prediction of nitrous oxide (N₂O) production in a nitrifying sequencing batch reactor. *Process Safety and Environmental Protection* (Accepted for publication).
- Miao, Y., Zhang, L., Yang, Y., Peng, Y., Li, B., Wang, S. & Zhang, Q. 2016 Start-up of single-stage partial nitrification-anammox process treating low-strength sewage and its restoration from nitrate accumulation. *Bioresource Technology* **218**, 771–779. doi:10.1016/j.biortech.2016.06.125.
- Mokhayeri, Y., Riffat, R., Murthy, S., Bailey, W., Takacs, I. & Bott, C. 2009 Balancing yield, kinetics and cost for three external carbon sources used for suspended growth post-denitrification. *Water Science and Technology* **60** (10), 2485–2491. doi:10.2166/wst.2009.623.
- Morales, N., Río, Á. V., Vázquez-Padín, J. R., Méndez, R., Mosquera-Corral, A. & Campos, J. L. 2015 Integration of the anammox process to the rejection water and main stream lines of WWTPs. *Chemosphere* **140**, 99–105. doi:10.1016/j.chemosphere.2015.03.058.
- Mozumder, M. S., Picioreanu, C., van Loosdrecht, M. C. M. & Volcke, E. I. P. 2014 Effect of heterotrophic growth on autotrophic nitrogen removal in a granular sludge reactor. *Environmental Technology* **35** (5–8), 1027–1037. doi:10.1080/09593330.2013.859711.
- Mulder, J. W., van Loosdrecht, M. C. M., Hellinga, C. & van Kempen, R. 2001 Full-scale application of the SHARON process for treatment of rejection water of digested sludge dewatering. *Water Science and Technology* **43** (11), 127–134. <https://doi.org/10.2166/wst.2001.0675>.
- Muñoz, A. C. 2020 *Mainstream Deammonification Process Monitoring by Bacterial Activity Tests*. Dissertation, KTH Royal Institute of Technology, Stockholm, Sweden. Available from: <http://urn.kb.se/resolve?urn=urn:nbn:se:kth:diva-281698>
- Ni, B. J. & Yu, H. Q. 2008 An approach for modeling two-step denitrification in activated sludge systems. *Chemical Engineering Science* **63** (3), 1449–1459. doi:10.1016/j.ces.2007.12.003.
- Ni, B.-J., Rusalleda, M. & Smeths, B. 2012 Evaluation on the microbial interactions of anaerobic ammonium oxidizers and heterotrophs in anammox biofilm. *Water Research* **46** (15), 4645–4652. doi:10.1016/j.watres.2012.06.016.
- Ni, B.-J., Peng, L., Law, Y., Guo, J. & Yuan, Z. 2014 Modeling of nitrous oxide production by autotrophic ammonia-oxidizing bacteria with multiple production pathways. *Environmental Science and Technology* **48** (7), 3916–3924. doi:10.1021/es405592h.
- Nogueira, R. & Melo, L. F. 2006 Competition between *Nitrospira* spp. and *Nitrobacter* spp. in nitrite-oxidizing bioreactors. *Biotechnology and Bioengineering* **95** (1), 169–175. doi:10.1002/bit.21004.
- O'Shaughnessy, M. 2016 *Mainstream Deammonification*. Water Environment Federation, IWA Publishing. <https://iwaponline.com/ebooks/book/301/Mainstream-Deammonification?redirectedFrom=PDF>.
- Ostace, S. G., Cristea, V. M. & Agachi, P. Ş. 2011 Extension of activated sludge model no 1 with two-step nitrification and denitrification processes for operation improvement. *Environmental Engineering and Management Journal* **10** (10), 1529–1544. doi:10.30638/eemj.2011.214.
- Pan, Y., Ni, B.-J. & Yuan, Z. 2013 Modeling electron competition among nitrogen oxides reduction and N₂O accumulation in denitrification. *Environmental Science & Technology* **47** (19), 11083–11091. doi:10.1021/es402348n.
- Pan, Y., Ni, B.-J., Lu, H., Chandran, K., Richardson, D. J. & Yuan, Z. 2015 Evaluating two concepts for the modelling of intermediates accumulation during biological denitrification in wastewater treatment. *Water Research* **71**, 21–31. doi:10.1016/j.watres.2014.12.029.
- Pan, Y., Ni, B.-J., Liu, Y. & Guo, J. 2016 Modeling of the interaction among aerobic ammonium-oxidizing archaea/bacteria and anaerobic ammonium-oxidizing bacteria. *Chemical Engineering Science* **150**, 35–40. doi:10.1016/j.ces.2016.05.002.
- Peng, L., Xie, Y., van Beeck, W., Zhu, W., van Tendeloo, M., Tytgat, T., Lebeer, S. & Vlaeminck, S. E. 2020 Return-sludge treatment with endogenous free nitrous acid limits nitrate production and N₂O emission for mainstream partial nitrification/Anammox. *Environmental Science and Technology* **54** (9), 5822–5831. doi:10.1021/acs.est.9b06404.
- Pérez, J., Lotti, T., Kleerebezem, R., Picioreanu, C. & van Loosdrecht, M. C. M. 2014 Outcompeting nitrite-oxidizing bacteria in single-stage nitrogen removal in sewage treatment plants: a model-based study. *Water Research* **66**, 208–218. doi:10.1016/j.watres.2014.08.028.
- Pérez, J., Isanta, E. & Carrera, J. 2015 Would a two-stage N-removal be a suitable technology to implement at full scale the use of anammox for sewage treatment? *Water Science and Technology* **72** (6), 858–865. doi:10.2166/wst.2015.281.
- Pérez, J., Laurenzi, M., van Loosdrecht, M. C. M., Persson, F. & Gustavsson, D. J. I. 2020 The role of the external mass transfer resistance in nitrite oxidizing bacteria repression in biofilm-based partial nitrification/anammox reactors. *Water Research* **186**, 116348. doi:10.1016/j.watres.2020.116348.
- Pocquet, M., Wu, Z., Queinnec, I. & Spérandio, M. 2016 A two pathway model for N₂O emissions by ammonium oxidizing bacteria supported by the NO/N₂O variation. *Water Resource* **88**, 948–959. doi:10.1016/j.watres.2015.11.029.
- Poot, V., Hoekstra, M., Geleijnse, M. A., van Loosdrecht, M. C. M. & Pérez, J. 2016 Effects of the residual ammonium concentration on NOB repression during partial nitrification with granular sludge. *Water Research* **106**, 518–530. doi:10.1016/j.watres.2016.10.028.
- Qian, W., Ma, B., Li, X., Zhang, Q. & Peng, Y. 2019 Long-term effect of pH on denitrification: high pH benefits achieving partial-denitrification. *Bioresource Technology* **278**, 444–449. doi:10.1016/j.biortech.2019.01.105.

- Regmi, P., Miller, M. W., Holgate, B., Bunce, R., Park, H., Chandran, K., Wett, B., Murthy, S. & Bott, C. B. 2014 Control of aeration, aerobic SRT and COD input for mainstream nitrification/denitrification. *Water Research* **57** (15), 162–171. doi:10.1016/j.watres.2014.03.035.
- Regmi, P., Holgate, B., Fredericks, D., Miller, M. W., Wett, B., Murthy, S. & Bott, C. B. 2015a Optimization of a mainstream nitrification-denitrification process and anammox polishing. *Water Science and Technology* **72** (4), 632–642. doi:10.2166/wst.2015.261.
- Regmi, P., Holgate, B., Miller, M. W., Park, H., Chandran, K., Wett, B., Murthy, S. & Bott, C. B. 2015b Nitrogen polishing in a fully anoxic anammox MBBR treating mainstream nitrification-denitrification effluent. *Biotechnology and Bioengineering* **113** (3), 635–642. doi:10.1002/bit.25826.
- Revollar, S., Vilanova, R., Vega, P., Francisco, M. & Meneses, M. 2020 Wastewater treatment plant operation: simple control schemes with a holistic perspective. *Sustainability* **12** (3), 768–796. doi:10.3390/su12030768.
- Ribera-Guardia, A., Kassotaki, E., Gutierrez, O. & Pijuan, M. 2014 Effect of carbon source and competition for electrons on nitrous oxide reduction in a mixed denitrifying microbial community. *Process Biochemistry* **49** (12), 2228–2234. doi:10.1016/j.procbio.2014.09.020.
- Rieger, L., Gillot, S., Langergraber, G., Ohtsuki, T., Shaw, A., Takacs, I. & Winkler, S. 2012 *Guidelines for Using Activated Sludge Models*. IWA Publishing, London, UK. eISBN:9781780401164.
- Riet, K. V. & Lans, R. V. 2011 2.07 - Mixing in Bioreactor Vessels. In: *Comprehensive Biotechnology*, 2nd edn. Academic Press, pp. 63–80. doi:10.1016/B978-0-08-088504-9.00083-0.
- Roots, P., Sabba, F., Rosenthal, A. F., Wang, Y., Yuan, Q., Rieger, L., Yang, F., Kozak, J. A., Zhang, H. & Wells, G. F. 2020 Integrated shortcut nitrogen and biological phosphorus removal from mainstream wastewater: process operation and modeling. *Environmental Science: Water Research & Technology* **6** (3), 566–580. doi:10.1039/C9EW00550A.
- Rosenthal, A., Schraa, O., Rieger, L., Zhang, H., Kozak, J., Yang, F., Roots, F. & Wells, G. F. 2018 Simulation of dissolved oxygen-and ammonia-based aeration control strategies in a mainstream deammonification biofilm process. In: *Proceedings of the Water Environment Federation*. Water Environment Federation, pp. 5238–5247. doi:10.2175/193864718825138501.
- Rubio-Rincón, F. J., Lopez-Vazquez, C. M., Welles, L., van Loosdrecht, M. C. M. & Brdjanovic, D. 2017 Cooperation between *Candidatus Competibacter* and *Candidatus Accumulibacter* clade I, in denitrification and phosphate removal processes. *Water Research* **120**, 156–164. doi:10.1016/j.watres.2017.05.001.
- Sadowski, M., Regmi, P., Wett, B., Murthy, S. & Bott, C. B. 2015 Comparison of aeration strategies for optimization of nitrogen removal in an A/B process: DO, ABAC, and AvN control. In *Proceedings of the Water Environment Federation, WEFTEC 2015*. Water Environment Federation, pp. 4905–4916. doi:10.2175/193864715819538633.
- Salem, S., Berends, D., Heijnen, J. & van Loosdrecht, M. C. M. 2002 Model-based evaluation of a new upgrading concept for N-removal. *Water Science and Technology* **45** (6), 169–176. PMID: 11989870.
- Schielke-Jenni, S., Villez, K., Morgenroth, E. & Udert, K. 2015 Observability of anammox activity in single-stage nitrification/anammox reactors using mass balances. *Environmental Science: Water Research & Technology* **1** (4), 523–534. https://doi.org/10.1039/C5EW00045A.
- Schoepflin, S., Macmanus, J., Chengua, L., McCullough, K., Klaus, S., De Clippeleir, H. & Wilson, C. Manuscript in preparation *Startup Strategies for Mainstream Anammox Polishing in Moving Bed Biofilm Reactors (MBBRs)*.
- Seuntjens, D., Han, M., Kerckhof, F.-M., Boon, N., Al-Omari, A., Takacs, I., Meerburg, F., De Mulder, C., Wett, B., Bott, C., Murthy, S., Arroyo, J. M. C., De Clippeleir, H. & Vlaeminck, S. E. 2018 Pinpointing wastewater and process parameters controlling the AOB to NOB activity ratio in sewage treatment plants. *Water Research* **138**, 37–46. doi:10.1016/j.watres.2017.11.044.
- Shao, Q., Wan, F., Du, W. & He, J. 2021 Enhancing biological nitrogen removal for a retrofit project using wastewater with a low C/N ratio – a model-based study. *Environmental Science and Pollution Research* **28**, 53074–53086. doi:10.1007/s11356-021-14396-2.
- Shaw, A., Takács, I., Pagilla, K. R. & Murthy, S. 2013 A new approach to assess the dependency of extant half-saturation coefficients on maximum process rates and estimate intrinsic coefficients. *Water Research* **47** (16), 5986–5994. doi:10.1016/j.watres.2013.07.003.
- Shi, L., Du, R. & Peng, Y. 2019 Achieving partial denitrification using carbon sources in domestic wastewater with waste-activated sludge as inoculum. *Bioresour. Technol.* **283**, 18–27. doi:10.1016/j.biortech.2019.03.063.
- Shourjeh, M., Kowal, P., Lu, X., Xie, L. & Drewnowski, J. 2021 Development of strategies for AOB and NOB competition supported by mathematical modeling in terms of successful deammonification implementation for energy-efficient WWTPs. *Processes* **9** (3), 562–587. doi:10.3390/pr9030562.
- Siegrist, H., Salzgeber, D., Eugster, J. & Joss, A. 2008 Anammox brings WWTP closer to energy autarky due to increased biogas production and reduced aeration energy for N-removal. *Water Science and Technology* **57** (3), 383–388. doi:10.2166/wst.2008.048.
- Sin, G., Kaelin, D., Kampschreur, M. J., Takács, I., Wett, B., Gernaey, K. V., Reiger, L., Siegrist, H. & van Loosdrecht, M. C. M. 2008 Modelling nitrite in wastewater treatment systems: a discussion of different modelling concepts. *Water Science and Technology* **58** (6), 1155–1171. doi:10.2166/wst.2008.485.
- Soler-Jofra, A., Wang, R., Kleerebezem, R., van Loosdrecht, M. C. M. & Pérez, J. 2019 Stratification of nitrifier guilds in granular sludge in relation to nitrification. *Water Research* **148**, 479–491. doi:10.1016/j.watres.2018.10.064.
- Spérandio, M., Pocque, M., Guo, L., Ni, B.-J., Vanrolleghem, P. A. & Yuan, Z. 2016 Evaluation of different nitrous oxide production models with four continuous long-term wastewater treatment process data series. *Bioprocess and Biosystem Engineering* **39** (3), 493–510. doi:10.1007/s00449-015-1532-2.
- Staunton, E. T. & Aitken, M. D. 2015 Coupling nitrogen removal and anaerobic digestion for energy recovery from swine waste: 2 nitrification/Anammox. *Environmental Engineering Science* **32** (9), 750–760. doi:10.1089/ees.2015.0063.

- Strous, M., Heijnen, J., Kuenen, J. & Jetten, M. 1998 The sequencing batch reactor as a powerful tool for the study of slowly growing anaerobic ammonium-oxidizing microorganisms. *Applied Microbiology and Biotechnology* **50**, 589–596. doi:10.1007/s002530051340.
- Tao, C. & Hamouda, M. A. 2019 Steady-state modeling and evaluation of partial nitrification-anammox (PNA) for moving bed biofilm reactor and integrated fixed-film activated sludge processes treating municipal wastewater. *Journal of Water Process Engineering* **31**, 100854. doi:10.1016/j.jwpe.2019.100854.
- Trojanowicz, K., Plaza, E. & Trela, J. 2019 Model extension, calibration and validation of partial nitrification-anammox process in moving bed biofilm reactor (MBBR) for reject and mainstream wastewater. *Environmental Technology* **40** (4), 1079–1100. doi:10.1080/09593330.2017.1397765.
- Valverde Pérez, B., Mauricio Iglesias, M. & Sin, G. 2016 Systematic design of an optimal control system for the SHARON-Anammox process. *Journal of Process Control*. **39** (1), pp. 1–10. doi: 10.1016/j.jprocont.2015.12.009.
- Van Dongen, U., Jetten, M. S. M. & van Loosdrecht, M. C. M. 2001 The SHARON[®]-Anammox[®] process for treatment of ammonium rich wastewater. *Water Science and Technology* **44** (1), 153–160.
- Van Hulle, S. W. H., Volcke, E. I. P., López Teruel, J., Donckels, B., van Loosdrecht, M. C. M. & Vanrolleghem, P. A. 2007 Influence of temperature and pH on the kinetics of the Sharon nitritation process. *Journal of Chemical Technology and Biotechnology* **82** (5), 471–480. doi:10.1002/jctb.1692.
- Vangsgaard, A. K., Mutlu, A. G., Gernaey, K. V., Smets, B. F. & Sin, G. 2013 Calibration and validation of a model describing complete autotrophic nitrogen removal in a granular SBR system. *Journal of Chemical Technology and Biotechnology* **88**, 2007–2015. doi:10.1002/jctb.4060.
- Vanrolleghem, P. A., Mannina, G., Cosenza, A. & Neumann, M. B. 2015 Global sensitivity analysis for urban water quality modelling: terminology, convergence and comparison of different methods. *Journal of Hydrology* **522**, 339–352. doi:10.1016/j.jhydrol.2014.12.056.
- Vasilaki, V., Massara, T. M., Stanchev, P., Fatone, F. & Katsou, E. 2019 A decade of nitrous oxide (N₂O) monitoring in full-scale wastewater treatment processes: a critical review. *Water Research* **161**, 392–412. doi:10.1016/j.watres.2019.04.022.
- Volcke, E. I. P., Van Hulle, S. W. H., Donckels, B. M. R., van Loosdrecht, M. C. M. & Vanrolleghem, P. A. 2005 Coupling the SHARON process with anammox: model-based scenario analysis with focus on operating costs. *Water Science and Technology* **52** (4), 107–115. doi:10.2166/wst.2005.0093.
- Volcke, E. I. P., Gernaey, K. V., Vrecko, D., Jeppsson, U., van Loosdrecht, M. C. M. & Vanrolleghem, P. A. 2006 Plant-wide (BSM2) evaluation of reject water treatment with a SHARON-Anammox process. *Water Science and Technology* **54** (8), 93–100. doi:10.2166/wst.2006.822.
- Volcke, E. I. P., Sanchez, O., Steyer, J. P., Dabert, P. & Bernert, N. 2008 Microbial population dynamics in nitrifying reactors: experimental evidence explained by a simple model including interspecies competition. *Process Biochemistry* **43** (2), 1398–1406. doi:10.1016/j.procbio.2008.08.013.
- Volcke, E. I. P., Picioreanu, C., De Baets, B. & van Loosdrecht, M. C. M. 2010 Effect of granule size on autotrophic nitrogen removal in a granular sludge reactor. *Environmental Technology* **31** (11), 1271–1280. doi:10.1080/09593331003702746.
- Volcke, E. I. P., Picioreanu, C., De Baets, B. & van Loosdrecht, M. C. M. 2012 The granule size distribution in an anammox-based granular sludge reactor affects the conversion – implications for modeling. *Biotechnology and Bioengineering* **109** (7), 1629–1636. doi:10.1002/bit.24443.
- Von Schulthess, R., Kühni, M. & Gujer, W. 1995 Release of nitric and nitrous oxides from denitrifying activated sludge. *Water Research* **29** (1), 215–226. doi:10.1016/0043-1354(94)E0108-I.
- Von Stosch, M., Oliveira, R., Peres, J. & de Azevedo, S. F. 2014 Hybrid semi-parametric modeling in process systems engineering: past, present and future. *Computers and Chemical Engineering* **60**, 86–101. doi:10.1016/j.compchemeng.2013.08.008.
- Wade, M. J. & Wolkowicz, G. S. K. 2021 Bifurcation analysis of an impulsive system describing partial nitritation and anammox in a hybrid reactor. *Environmental Science & Technology* **55** (3), 2099–2109. doi:10.1021/acs.est.0c06275.
- Wan, X., Baeten, J. E. & Volcke, E. I. P. 2019 Effect of operating conditions on N₂O emissions from one-stage partial nitritation-anammox reactors. *Biochemical Engineering Journal* **143**, 24–33. doi:10.1016/j.bej.2018.12.004.
- Wang, D., Wang, Q., Laloo, A., Xu, Y., Bond, P. L. & Yuan, Z. 2016 Achieving stable nitritation for mainstream deammonification by combining free nitrous acid-based sludge treatment and oxygen limitation. *Scientific Reports* **6**, 25547. doi:10.1038/srep25547.
- Wang, H., Xu, G., Qiu, Z., Zhou, Y. & Liu, Y. 2019 NOB suppression in pilot-scale mainstream nitritation-denitrification system coupled with MBR for municipal wastewater treatment. *Chemosphere* **216**, 633–639. doi:10.1016/j.chemosphere.2018.10.187.
- Wang, Q., Ni, B.-J., Lemaire, R., Hao, X. & Yuan, Z. 2016 Modeling of nitrous oxide production from nitritation reactors treating real anaerobic digestion liquor. *Scientific Reports* **6**, 25336. doi:10.1038/srep25336.
- Wang, X., Zhao, J., Yu, D., Du, S., Yuan, M. & Zhen, J. 2019 Evaluating the potential for sustaining mainstream anammox by endogenous partial denitrification and phosphorus removal for energy-efficient wastewater treatment. *Bioresour Technol* **284**, 302–314. doi:10.1016/j.biortech.2019.03.127.
- Wett, B. 2007 Development and implementation of a robust deammonification process. *Water Science and Technology* **56** (7), 81–88. doi:10.2166/wst.2007.611.
- Wett, B. & Rauch, W. 2003 The role of inorganic carbon limitation in biological nitrogen removal of extremely ammonia concentrated wastewater. *Water Research* **37** (5), 1100–1110. doi:10.1016/s0043-1354(02)00440-2.

- Wett, B., Nyhuis, G., Takács, I. & Murthy, S. 2010 Development of enhanced deammonification selector. In *Proceedings of the Water Environment Federation, WEFTEC 2010*. Water Environment Federation, pp. 5917–5926. doi:10.2175/193864710798194139.
- Wett, B., Podmirseg, S. M., Gómez-Brandón, M., Hell, M., Nyhuis, G., Bott, C. & Murthy, S. 2015 Expanding DEMON sidestream deammonification technology towards mainstream application. *Water Environment Research* **87** (12), 2084–2089. doi:10.2175/106143015X14362865227319.
- Wild, D., Von Schulthess, R. & Gujer, W. 1995 Structured modelling of denitrification intermediates. *Water Science and Technology* **31** (2), 45–54. doi:10.2166/wst.1995.0070.
- Wu, J. 2017 Comparison of control strategies for single-stage partial nitrification-anammox granular sludge reactor for mainstream sewage treatment – a model-based evaluation. *Environmental Science and Pollution Research* **24**, 25839–25848. doi:10.1007/s11356-017-0230-9.
- Wyffels, S., Van Hulle, S. W. H., Boeckx, P., Volcke, E. I. P., Van Cleemput, O., Vanrolleghem, P. A. & Verstraete, W. 2004 Modeling and simulation of oxygen-limited partial nitrification in a membrane-assisted bioreactor (MBR). *Biotechnology and Bioengineering* **86** (5), 531–542. doi:10.1002/bit.20008.
- Xu, G., Wang, H., Gu, J., Shen, N., Qiu, Z., Zhou, Y. & Liu, Y. 2017 A novel A-B process for enhanced biological nutrient removal in municipal wastewater reclamation. *Chemosphere* **189**, 39–45. doi:10.1016/j.chemosphere.2017.09.049.
- Yang, Q., Shen, N., Lee, Z. M.-P., Xu, G., Cao, Y., Kwok, B., Lay, W., Liu, Y. & Zhou, Y. 2016 Simultaneous nitrification, denitrification and phosphorus removal (SNDPR) in a full-scale water reclamation plant located in warm climate. *Water Science and Technology* **74** (2), 448–456. doi:10.2166/wst.2016.214.
- You, J., Das, A., Dolan, E. & Hu, Z. 2009 Ammonia-oxidizing archaea involved in nitrogen removal. *Water Research* **43** (7), 1801–1809. doi:10.1016/j.watres.2009.01.016.
- You, Q. G., Wang, J. H., Qi, G. X., Zhou, Y. M., Guo, Z. W., Shen, Y. & Gao, X. 2020 Anammox and partial denitrification coupling: a review. *RSC Advances* **10** (21), 12554–12572. doi:10.1039/D0RA00001A.
- Yu, L.-F., Du, Q.-Q., Fu, X.-T., Zhang, R., Li, W.-J. & Peng, D.-C. 2016 Community structure and activity analysis of the nitrifiers in raw sewage of wastewater treatment plants. *Huan Jing Ke Xue* **37** (11), 4366–4371. doi:10.13227/j.hj.kx.201605026.
- Zekker, I., Rikmann, E., Tenno, T., Saluste, A., Tomingas, M., Menert, A., Loorits, L., Lemmiksoo, V. & Tenno, T. 2012 Achieving nitrification and anammox enrichment in a single moving-bed biofilm reactor treating reject water. *Environmental Technology* **33** (4–6), 703–710. doi:10.1080/09593330.2011.588962.
- Zhang, M., Wang, S., Ji, B. & Liu, Y. 2019 Towards mainstream deammonification of municipal wastewater: partial nitrification-anammox versus partial denitrification-anammox. *Science of the Total Environment* **692**, 394–400. doi:10.1016/j.scitotenv.2019.07.293.
- Zhang, M., Li, N., Chen, W. & Wu, J. 2020 Steady-state and dynamic analysis of the single-stage anammox granular sludge reactor show that bulk ammonium concentration is a critical control variable to mitigate feeding disturbances. *Chemosphere* **251**, 126361. doi:10.1016/j.chemosphere.2020.126361.
- Zhang, W., Peng, Y., Zhang, L., Li, X. & Zhang, Q. 2020 Simultaneous partial nitrification and denitrification coupled with polished anammox for advanced nitrogen removal from low C/N domestic wastewater at low dissolved oxygen conditions. *Bioresour. Technology* **305**, 123045. doi:10.1016/j.biortech.2020.123045.
- Zhang, Z., Zhang, Y. & Chen, Y. 2020 Recent advances in partial denitrification in biological nitrogen removal: from enrichment to application. *Bioresour. Technology* **298**. doi:10.1016/j.biortech.2019.122444.
- Zhang, X., Yu, B., Zhang, N., Zhang, H., Wang, C. & Zhang, H. 2016 Effect of inorganic carbon on nitrogen removal and microbial communities of CANON process in a membrane bioreactor. *Bioresour. Technology* **202**, 113–118. doi:10.1016/j.biortech.2015.11.083.
- Zhao, Y., Miao, J., Ren, X. & Wu, G. 2018 Effect of organic carbon on the production of biofuel nitrous oxide during the denitrification process. *International Journal of Environmental Science and Technology* **15**, 461–470. doi:10.1007/s13762-017-1397-9.

First received 14 January 2022; accepted in revised form 7 April 2022. Available online 20 April 2022