

# A COMBINED TOPSIS AND FA BASED STRATEGIC ANALYSIS OF TECHNICAL CONDITION OF HIGH POWER TRANSFORMERS

Mikolaj BARTLOMIEJCZYK<sup>1,2</sup>, Miroslav GUTTEN<sup>3</sup>, Stefan HAMACEK<sup>1</sup>

<sup>1</sup>Department of Electrical Engineering, Faculty of Electrical Engineering and Computer Science, VSB–Technical University of Ostrava, 17. listopadu 15, 708 33 Ostrava-Poruba, Czech Republic

<sup>2</sup>Department of Electrical Transport Engineering, Faculty of Electrical and Control Engineering, Gdansk University of Technology, Sobieskiego 7, 802 16 Gdansk, Poland

<sup>3</sup>Department of Measurement and Applied Electrical Engineering, Faculty of Electrical Engineering, University of Zilina, Univerzitna 8215/1, 010 26 Zilina, Slovak Republic

mbartlom@ely.pg.gda.pl, gutten@fel.uniza.sk, stefan.hamacek@vsb.cz

**Abstract.** *The paper presents mathematical model – TOPSIS method, which was utilized on insulating state of distribution transformer to analyze and sensibility of individual measurements methods mutual comparison. We can uniquely determine the importance of these measurements methods with this mathematical apparatus in these measurements methods in insulating state of transformers.*

## Keywords

*Assigning indicators, high power transformers, TOPSIS method.*

## 1. Introduction

With regard to the development of the world and national economies, also control, maintenance and its analysis by mathematic calculations becomes an important subject [1], [2], [4], [19], [20], [21], [22], [26]. This sphere also includes power transformers, where their proper function has a positive impact on the trouble-free supply of electricity and heat for industries and households. It is therefore necessary, in the absence of scientific and research potential in distribution utilities, to achieve the objectives of the proposed activities, i.e. in-depth analysis of undesirable impacts on devices condition, design of measurements and their verification, and design of new diagnostic procedures for improving reliability of power transformers.

In case we want to determine the real insulating state of a transformer and then lifetime of insulation, is

necessary to analyze some measurements in individual types of assays and then determine their exactness and reliability with mathematical models. We can exactly prove the importance of these assays by mathematical and statistical models in the field of analysis of the insulating state of transformers [23], [24].

For mathematical analyzing these assays measurements we chose within the frame of comparison of the degree of sensitivity in single methods of the insulating state of distribution transformers 110/22 kV:

- insulation resistance and polarizing index  $R_{60}/R_{15}$ ,
- dissipation factor and capacity:  $\tan\delta$  and  $C$ ,
- relative change of short-circuit voltage  $dU_k$ .

## 2. Description of Chosen Measurements

The oldest and easiest method of inspecting the state of insulators is by means of insulation resistance measuring. The main disadvantage of this method is that insulation resistance does not only depend on the state of insulation but also on its type and dimensions. Insulation resistance method can be used to evaluate the state of insulation of electric device only on the basis of previous experience with the same insulation on the same devices.

The method is based on the following principle: change in insulator state causes a change in time dependence of a current flowing through the insulator by DC voltage [8]. A current flowing through an insulator

consists of a time-decreasing absorption element and stabilized element. The more water content there is in the insulation, more apparent increase of the stabilized element of a current is the observed comparing to the absorption element. The absorption element of a current has a low effect on the characteristics of time dependency in relation to the current as well as the resistance, and flattens with increasing humidity (Fig. 1).

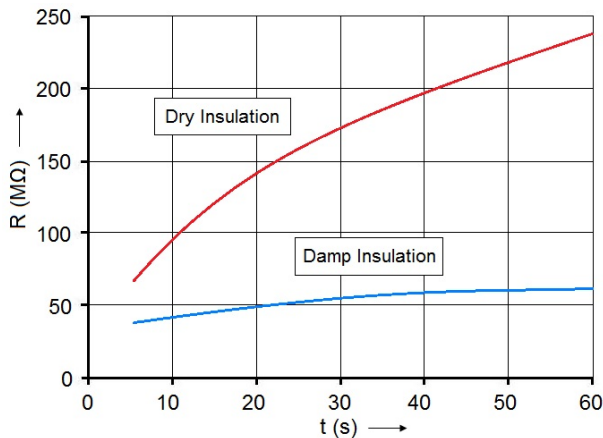


Fig. 1: Time dependence of the insulation resistance.

Utilizing this knowledge for evaluation of the insulation state does not require determining the full time dependence of a current. It is enough to determine the value of a current (resistance) in two different moments from the time of connection to DC voltage. The ratio of these two values defines the state of insulation and is called the polarizing index. Since it is a non-dimensional parameter, it does not depend on the dimension of insulation. Polarizing index is measured after 1 and 10 min or after 15 and 60 s.

So for the better illustrate the change in values of the polarizing index, it needs to be expressed by both elements of a current - absorption element  $i_a$  and stabilized element  $i_\infty$ :

$$p_i = \frac{R_{60}}{R_{15}} = \frac{i_{a15} + i_\infty}{i_{a60} + i_\infty}. \quad (1)$$

The humid and contaminated insulation is determined by  $i_\infty$ , therefore numerator and denominator are very close values and their ration tends towards 1. On the other hand, the dry and clean insulation which is in good condition has a very low stabilized current and the time dependent element  $i_a$  is dominant. Thus, the fraction value is noticeably higher than 1. The polarizing index of new transformers before usage in operation should reach at least 1,3.

The measurements of the dissipation factor ( $\tan \delta$ ) and the capacities of transformer windings are used for additional determination of the insulation quality as whole or only of some parts of the transformer. The

value of  $\tan \delta$  indicates the presence of polar and ion compounds in oil and it also determinates the aging of oil. The degree of oil humidity can be measured by temperature dependence of  $\tan \delta$  [8].

Changes in the state of short-circuit voltage  $dU_k$  (impedance) express geometrical winding movements and their construction changes in transformers. This technical condition depends on the thermal and mechanical effects of short-circuit currents.

By means of measurement of short-circuit voltage we can identify the mechanical and insulating deformation of the winding of a transformer.

Absolute value of short-circuit voltages usually are not sufficient to qualify the condition of winding without knowledge of their evolution in time, so the analysis is based on comparison of values for a specified time of operation of a transformer.

### 3. Composite Indicator and TOPSIS Method

A composite indicator (CI) is a mathematical aggregation of a set of individual indicators that measure a multi-dimensional concept [25]. There are  $m$  compared alternatives, each alternative consists of  $n$  sub-indicators  $x_{ij}$ . For each alternative is evaluated CI. CI is used for the performance measurements, benchmarking, via providing an aggregated performance index in various fields such as Human Development Index, Road Safety Index [2], [3], [16], [17], [18], [27].

The graphical representation of CI construction is illustrated on Eq. (2). There are  $m$  compared alternatives, each alternative consist  $n$  sub-indicators  $x_{ij}$ . For the each alternative is evaluated CI. Sub-indicators usually have no common measurable units.

The TOPSIS method is used to analyze a multi-criteria decision making problem with  $m$  alternatives with  $n$  criteria. In the TOPSIS method, the best alternative should have the shortest Euclidean distance from the positive ideal solution (PIS) and the longest distance from the negative ideal solution (NIS). The PIS is a hypothetical solution which maximum values from the database of all alternatives, and the NIS is a hypothetical solution which minimum values from the database of all alternatives. TOPSIS defines an index called relative closeness to the PIS and remoteness from the NIS [7]. This index can be used as a CI of alternatives.

Generally, the structure of CI can by expressed by the Eq. (3):

$$\begin{array}{l}
 \text{alternative 1} \\
 \text{alternative 2} \\
 \vdots \\
 \text{alternative } m
 \end{array}
 \begin{bmatrix}
 x_{11} & x_{12} & \cdots & x_{1n} \\
 x_{21} & x_{22} & \cdots & x_{2n} \\
 \vdots & \vdots & \ddots & \vdots \\
 x_{m1} & x_{m2} & \cdots & x_{mn}
 \end{bmatrix}
 \rightarrow
 \begin{bmatrix}
 CI_1 \\
 CI_2 \\
 \vdots \\
 CI_m
 \end{bmatrix}.
 \tag{2}$$

$$CI = \sum_{i=1}^n w_i I_i,
 \tag{3}$$

where  $w_i$  means weight assigned to indicator  $i$ .

The main procedure of the TOPSIS method is described in the following steps:

**Step 1: Define a decision matrix:**

The decision matrix **D** of  $m \times n$  dimension consists of values of  $n$  sub-indicators for  $m$  alternatives.

**Step 2: Normalize the decision matrix:**

The values of sub-indicators are normalized to a scale 0–1. In case of "benefit type" indicators, what means a higher value is better, as is used in the formula:

$$x'_{ij} = \frac{x_{ij} - \min_i \{x_{ij}\}}{\max_i \{x_{ij}\} - \min_i \{x_{ij}\}}.
 \tag{4}$$

With "cost type" sub-indicators, what means the lower value is better. They are normalized in the following way:

$$x'_{ij} = \frac{\max_i \{x_{ij}\} - x_{ij}}{\max_i \{x_{ij}\} - \min_i \{x_{ij}\}}.
 \tag{5}$$

As a result is obtained the normalized decision matrix **D'**.

**Step 3: Compute the weighted normalized decision matrix:**

Elements of the normalized decision matrix **D'** are multiplied by weight vector **W**, which consist of  $n$  weight factors  $w$ . These factors express the relatively importance of criteria. The elements of weighted normalized decision matrix **V** are expressed as:

$$v_{ij} = w_j x'_{ij}.
 \tag{6}$$

**Step 4: Identify the PIS and NIS:**

The positive ideal solution  $A^+$  and the negative ideal solution  $A^-$  can be expressed as:

$$A^+ = (\max_i \{v_{i,1}\}, \dots, \max_i \{v_{i,n}\}) = (v_1^+, \dots, v_n^+),
 \tag{7}$$

$$A^- = (\min_i \{v_{i,1}\}, \dots, \max_i \{v_{i,n}\}) = (v_1^-, \dots, v_n^-).
 \tag{8}$$

**Step 5: Calculate the distance to PIS and NIS:**

For each alternative  $i$  the Euclidean distance  $d_i^+$  to the positive ideal solution and distance  $d_i^-$  to the negative ideal solution is defined [7].

**Step 6: Compute the relative closeness data to CI:**

Values  $d_i^+$  and  $d_i^-$  are combined to relative closeness index  $C_i$ :

$$C_i = \frac{d_i^-}{d_i^+ + d_i^-}.
 \tag{9}$$

The  $C_i$  is a composed indicator CI of alternative  $i$ .

## 4. Composite Indicator and TOPSIS Method

To express the subjectiveness and imprecision of the evaluation process, the sub-indicators and weights are represented by a triangular fuzzy number [7]. A triangular fuzzy number  $\tilde{n}$  can be define by a triplet (a, b, c) shown in Fig. 2. The membership function  $\mu_{\tilde{n}}$  is defined as:

$$\mu_{\tilde{n}}(x) = \begin{cases} \frac{x-a}{b-a}, & a \leq x \leq b \\ \frac{c-x}{c-b}, & b \leq x \leq c \\ 0, & \text{otherwise} \end{cases},
 \tag{10}$$

where  $a < b < c$ . The  $b$  is the most possible value of a fuzzy number.

Let two triangular positive triangular numbers  $\tilde{n}_1 = (a_1, b_1, c_1)$ ,  $\tilde{n}_2 = (a_2, b_2, c_2)$  and a positive real number  $r$ . Similarly as in the case of real numbers, the operations of positive fuzzy numbers can be defined as follows [7]:

$$\tilde{n}_1(+) \tilde{n}_2 = (a_1 + a_2, b_1 + b_2, c_1 + c_2), \quad (11)$$

$$\tilde{n}_1(\times) \tilde{n}_2 = (a_1 a_2, b_1 b_2, c_1 c_2), \quad (12)$$

$$\tilde{n}_1(/) \tilde{n}_2 = (a_1/a_2, b_1/b_2, c_1/c_2), \quad (13)$$

$$1/\tilde{n}_1 = (1/c_1, 1/b_1, 1/a_1), \quad (14)$$

$$r * \tilde{n}_1 = (ra_1, rb_1, rc_1). \quad (15)$$

The distance between fuzzy numbers can be defined:

$$D(\tilde{n}_1, \tilde{n}_2) = \sqrt{\frac{1}{3} [(a_2 - a_1)^2 + (b_2 - b_1)^2 + (c_2 - c_1)^2]}. \quad (16)$$

Used fuzzy-TOPSIS model is similar to classic TOPSIS method. In step 1 decision matrix is generated, in step 2 this matrix is normalized. After normalization, the real values in the decision matrix and weight values are converted into fuzzy numbers. The 7-level scale of fuzzy numbers expressed in linguistic terms that are used (Tab. 1).

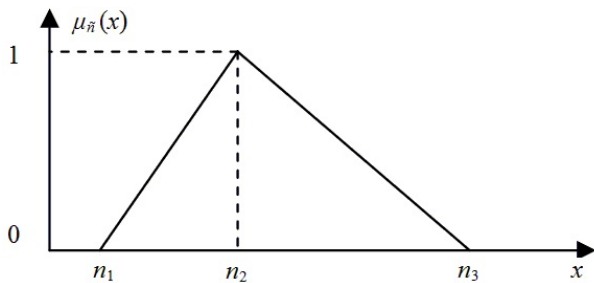


Fig. 2: Triangular fuzzy number  $\tilde{N}$ .

Tab. 1: Table of conversion real values into the fuzzy values.

Real value $x$	Linguistic value	Fuzzy value $\tilde{n}$
$0 \leq x \leq 1/7$	Very Low	$(0, 0, 1/6)$
$1/7 \leq x \leq 2/7$	Low	$(0, 1/6, 2/6)$
$2/7 \leq x \leq 3/7$	Medium Low	$(1/6, 2/6, 3/6)$
$3/7 \leq x \leq 4/7$	Medium	$(2/6, 3/6, 4/6)$
$4/7 \leq x \leq 5/7$	Medium High	$(3/6, 4/6, 5/6)$
$5/7 \leq x \leq 6/7$	High	$(4/6, 5/6, 1)$
$6/7 \leq x \leq 7/7$	Very High	$(5/6, 1, 1)$

The calculations in step 3 are proceeding with the fuzzy values. In step 4, the fuzzy values of PIS and NIS are defined as:

$$A_j^+ = (\max_i \tilde{n}_{ij}^1, \max_i \tilde{n}_{ij}^2, \max_i \tilde{n}_{ij}^3), \quad (17)$$

$$A_j^- = (\min_i \tilde{n}_{ij}^1, \min_i \tilde{n}_{ij}^2, \min_i \tilde{n}_{ij}^3), \quad (18)$$

where  $\tilde{n}_{ij}^1, \tilde{n}_{ij}^2, \tilde{n}_{ij}^3$  are fuzzy values of fuzzy normalized decision matrix. In step 5 is calculated the distance to PIS and NIS by formula Eq. (18), in step 6 the relative closeness in the estimate by Eq. (11).

## 5. Assigning Indicators Weights by Factor Analysis

The values of the weights will be assigned by factor analysis. Factor analysis method is based on a reducing the dimensions of the problem, where the  $n$  dimensions are transformed into a  $p$  smaller number unobserved variables called factors. The idea of factor analysis can be described by the formula:

$$X = FY + E, \quad (19)$$

where  $\mathbf{X}$  – matrix of the input data,  $\mathbf{Y}$  – matrix of uncorrelated common factors,  $\mathbf{F}$  – matrix of factor loadings,  $\mathbf{E}$  – matrix of the specific factors.

The dimensionality of matrix  $\mathbf{F}$  depends on the selected number of factors. Each factor explains a part of the variance of the input data.

The approach to the calculations of weight factors suggested in [2] consist the following steps:

### Step 1: Define a number of factors:

Chosen factors should explain 70–80 % of the variance of the input data. Usually there are 2 or 3 factors.

### Step 2: Define squared factor loadings:

Squared factor loadings can be described by the formula:

$$u_{ij} = \frac{a_{ij}^2}{\sum_{k=1}^m a_{kj}^2}, \quad (20)$$

where  $m$  – the numbers of the factors.

### Step 3: Calculate preliminary weights:

The preliminary values of the weights can be expressed as:

$$w'_j = \frac{\max_k u_{kj}}{e'_k}, \quad (21)$$

where  $e'_k$  is the relative variation explained in the data sheet:

$$e'_k = \frac{e_k}{e}, \tag{22}$$

where  $e$  is total variation explained by chosen  $m$  number of the factors,  $e_k$  is variation explained by the  $k$  factor.

**Step 4: Rescaling of the weights:**

The final values of the weights are described by the formula:

$$w_j = \frac{w'_j}{\sum_{i=1}^m w_j}. \tag{23}$$

## 6. Results of the Calculation

Assigning of the weights of the criteria by factor analysis was the first step of the calculation. Two factors in factor analysis were chosen: factor 1 represents the parameters  $R_{60}/R_{15}$  and  $C$ , and explains 38 % of the total variance; factor 2 represents the parameters  $dU_k$  and tangent delta, and explains 34 % of the variance. The values of weights are presented in Tab. 2.

**Tab. 2:** Calculated values of the weights.

Parameter	Weight
$R_{60}/R_{15}$	0,24
$dU_k$	0,36
tangent delta	0,17
$C$	0,22


Assigned weights of the criteria were applied to fuzzy TOPSIS model. Tab. 3 presents the results of the calculations as well as the data for four sub-indicators.

To investigate the impact of criteria weights was realized the sensitivity analysis – were calculated values of CI for different sets of weights. The 11 experiments were conducted, the sets of weights are presented in Tab. 4, the results of the sensitivity analysis is showed in Fig. 3. There is shown range of standard deviation of CI calculated for 11 sets of weights and CI calculated in the previous part of the paper.


It is noticeable, that the assigned values of CI are placed in the range of the standard deviation, what confirm the reliability of the fuzzy TOPSIS method. In Fig. 4 is presented sensitivity analysis regarding the final outcome ranking – the technical condition of each transformer referred to the other transformers.

Better position in ranking means better technical condition – higher CI. The average position in sensitivity analysis in every case is located closely to position based on the previous assigned value of CI. In some cases is visible significant between the maximal and the minimal position – columns T8, T10, T12. It can be explained by the disproportion between several technical parameters of transformer. That fact indicates a prerequisite of ill natured technical condition of transformer and can be used to identify a failure.

To investigate the accuracy of presented fuzzy TOPSIS method was realized the cluster analysis. Cluster analysis is a multivariate technique which informs about the similarity in the data set. Clustering is a task of assigning objects into groups – cluster. The objects in the same cluster are more similar to each other than to those in other clusters.

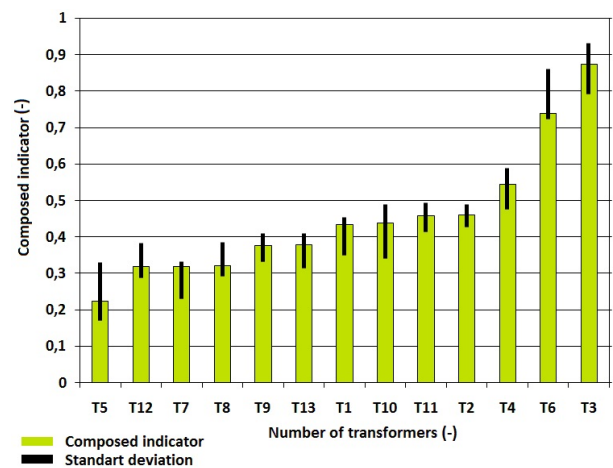

**Fig. 3:** The results of the sensitivity analysis - values of CI and standard deviation.

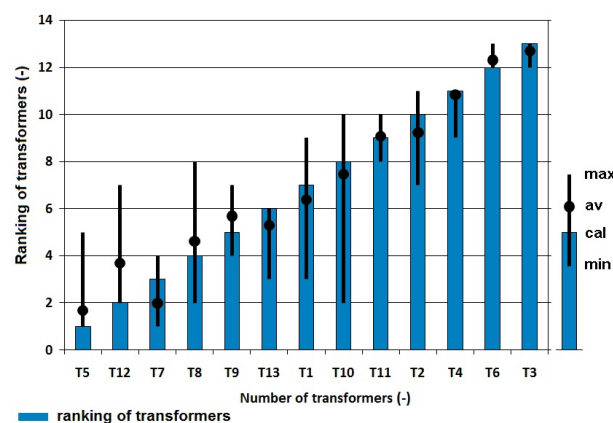

**Fig. 4:** The results of the sensitivity analysis - ranking of transformers, max, min, av - the highest, lowest, average ranking position obtained in sensitivity test, cal - position corresponding with CI value, better position means better CI valu.

The classification aims to reduce the dimensionality of a data set by finding the similarities between classes

**Tab. 3:** Four sub-indicators and CI values for the 13 transformers.

TR	Sub-indicators				Results of the calculations		
	$R_{60}/R_{15}$	$dU_k$ [%]	$\tan \delta$	C [pF]	$d^+$	$d^-$	CI
T1	1,36	0,47	0,0217	2881,4	0,53	0,41	0,43
T2	1,37	8	0,0186	4746,7	0,51	0,44	0,46
T3	1,58	4,5	0,0123	2996,5	0,12	0,81	0,87
T4	1,44	7,9	0,0075	2731,5	0,41	0,49	0,54
T5	1,31	42,7	0,0046	1957,5	0,74	0,21	0,22
T6	1,55	32,4	0,0135	3815,5	0,27	0,76	0,74
T7	1,25	0	0,0424	3940,0	0,75	0,35	0,32
T8	1,31	21,4	0,0177	4882,0	0,66	0,31	0,32
T9	1,30	8,95	0,0160	4235,3	0,64	0,39	0,38
T10	1,39	2,41	0,0122	2236,0	0,54	0,43	0,44
T11	1,38	8,93	0,0153	3825,2	0,51	0,43	0,46
T12	1,32	20,4	0,0126	4030,7	0,66	0,31	0,32
T13	1,31	3,64	0,0187	3775,0	0,64	0,39	0,38

**Tab. 4:** Set of weights for sensitivity analysis.

Parameter	$R_{60}/R_{15}$	$dU_k$ [%]	$\tan$	C [pF]
Set 1	0,25	0,25	0,25	0,25
Set 2	0,5	0,167	0,167	0,0167
Set 3	0,167	0,5	0,167	0,167
Set 4	0,167	0,167	0,5	0,167
Set 5	0,167	0,167	0,167	0,5
Set 6	0,4	0,4	0,1	0,1
Set 7	0,1	0,4	0,4	0,1
Set 8	0,1	0,1	0,4	0,4
Set 9	0,4	0,1	0,1	0,4
Set 10	0,1	0,4	0,4	0,1
Set 11	0,1	0,4	0,4	0,1
Set 12	0,1	0,4	0,4	0,1
Set 13	0,24	30,36	0,017	0,22

[2], [5], [6]. A dendrogram is the result of method and illustrates the relationships between objects. On Fig. 5 is shown dendrogram obtained by the clustering.

It is seen, that the location of the transformers on dendrogram corresponds with the values of CI. Transformers with the similar value of CI are located near on the dendrogram, e.g. T8 and T12, T9 and T13. The most “separately” located are cases T3, T6, T5 and T7. It may be explained by CI values: T3 and T6 got the best rating, T5 and T7 one of the worst. Thus, the position of points can be used as an indicator of transformer insulation condition.

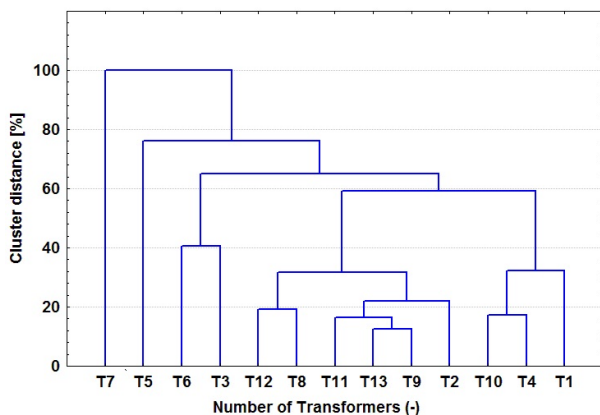


Fig. 5: Dendrogram based on hierarchical clustering.

## 7. Conclusion

On the basis of summary results of the mathematical CI model, there can be set optimized modern techniques for the diagnosis of insulation state chosen oil transformers, thereby a higher quality of trouble-free distribution of heat and electricity will be achieved.

A composed indicator has been accepted as a useful tool in many non-technical areas, such economy, society, and environment [9], [10], [11], [12], [13], [14],[15]. In this paper is presented the application of CI in the field of technical sciences. Beside this, other presented methods of MCDA (e.g. hierarchical clustering) can be used for evaluation the technical condition of electrical equipment.

## Acknowledgment

This paper has been elaborated in the framework of the project Opportunity for young researchers, reg. no. CZ.1.07/2.3.00/30.0016, supported by Operational Programme Education for Competitiveness and co-financed by the European Social Fund and the state budget of the Czech Republic, project SP2013/47 and

project MSMT KONTAKT II: LH11125 - Investigation of the ground current fields around the electrified lines.

## References

- [1] ZHOU, P., B.W. ANG and K.L. POH. A mathematical programming approach to constructing composite indicators. *Ecological Economics*. 2007, vol. 62, iss. 2, pp. 291–297. ISSN 0921-8009. DOI: 10.1016/j.ecolecon.2006.12.020.
- [2] NARDO, M., M. SAISANA, A. SALTELLI, S. TARANTOLA, A. HOFFMAN and E. GIOVANNINI. Handbook on constructing composite indicators: Methodology and user guide. *OECD Statistics Working Paper*. 2005, vol. 3. pp. 1–109. ISSN 1815-2031. DOI 10.1787/533411815016.
- [3] HERMANS, E. *A methodology for developing a composite road safety performance index for cross-country comparison*. Universiteit Hasselt, 2009. Ph.D. thesis. Universiteit Hasselt.
- [4] PANEK, Tomasz. *Statystyczne metody wielowymiarowej analizy porównawczej*. Warszawa: Szkoła Główna Handlowa - Oficyna Wydawnicza, 2010. ISBN 978-837-3784-253.
- [5] HOSSAIN, M. B., A. PATRAS, C. BARRY-RYAN, A. B. MARTIN-DIANA and N. P. BRUNTON. Application of principal component and hierarchical cluster analysis to classify different spices based on in vitro antioxidant activity and individual polyphenolic antioxidant compounds. *Journal of Functional Foods*. 2011, vol. 3, iss. 3, pp. 179–189. ISSN 1756-4646. DOI: 10.1016/j.jff.2011.03.010.
- [6] KOZERA, A. and C. KOZERA. The standard of living of the population and its diversity in the European Union Poziom zycia ludnosci i jego zroznicowanie w krajach Unii Europejskiej. *Journal of Agribusiness and Rural Development*. 2011, vol. 4, iss. 22, pp. 123–133. ISSN 1899-5241.
- [7] ALPHONCE, C. B. Application of the analytic hierarchy process in agriculture in developing countries. *Agricultural Systems*. 1997, vol. 53, iss. 1, pp. 97–112. ISSN 0308-521X. DOI: 10.1016/S0308-521X(96)00035-2.
- [8] JURCIK, J. Analysis of Insulating State on Transformer Model Using PDC Method. In: *Proceedings of 9th International Conference 2012 ELEKTRO*. Zilina: IEEE, 2012, pp. 423–426. ISBN 978-1-4673-1180-9. DOI: 10.1109/ELEKTRO.2012.6225657.

- [9] KORENCIAK, D. Application of LONWORKS Technology in Intelligent Buildings, In: *Proceedings of 9th International Conference 2012 ELEKTRO*. Zilina: IEEE, 2012, pp. 423–426. ISBN 978-1-4673-1180-9. DOI: 10.1109/ELEKTRO.2012.6225657.
- [10] MUMMOLA, G. An analytic hierarchy process model for landfill site selection. *Journal of Environmental Systems*. 1996, vol. 24, no. 4. pp. 445–465. ISSN 1541-3802. DOI: 10.2190/7ABE-KMFE-HU1H-VGPC.
- [11] SAATY, T. L. The analytic hierarchy process, New York: Mc-Graw Hill, 1980. ISBN 0-07-054371-2.
- [12] SAATY, T. L. Highlights and critical points in the theory and application of the analytic hierarchy process. *European Journal of Operational Research*. 1994, vol. 74, iss. 3, pp. 426–447. ISSN 0377-2217. DOI: 10.1016/0377-2217(94)90222-4.
- [13] CHUL-OH, S., Y. SEONG-HOON and K. SEUNG-JUN. Applying the analytic hierarchy process to evaluation of the national nuclear R&D projects: The case of Korea. *Progress in Nuclear Energy*. 2007, vol. 49, iss. 5, pp. 375–384. ISSN 0149-1970. DOI: 10.1016/j.pnucene.2007.03.001.
- [14] HAMALAINEN, P. and O. SEPPALAINEN. The analytic network process in energy policy planning. *Socio-Economic Planning Sciences*. 1986, vol. 20, iss. 6, pp. 399–405. ISSN 0038-0121. DOI: 10.1016/0038-0121(86)90054-6.
- [15] RAMANATHAN, R. A note on the use of the analytic hierarchy process for environmental impact assessment. *Journal of Environmental Management*. 2001, vol. 63, iss. 1, pp. 27–35. ISSN 0301-4797. DOI: 10.1006/jema.2001.0455.
- [16] KAHRAMAN, C. *Fuzzy Multi-Criteria Decision Making-Theory and Applications with Recent Developments*. New York: Springer, 2008. ISBN 978-038-7768-120.
- [17] HWANG, C and K. YOON. *Multiple attribute decision making: methods and applications: a state-of-the-art survey*. New York: Springer-Verlag, 1981. ISBN 03-871-0558-1.
- [18] HATEFI, S. M. and S. A. TORABI. A common weight MCDA-DEA approach to construct composite indicators. *Ecological Economics*. 2010, vol. 70, iss. 1, pp. 114–120. ISSN 0921-8009. DOI: 10.1016/j.ecolecon.2010.08.014
- [19] ŁAZARZ, B., H. MADEJ, A. WILK, T. FIGLUS and G. WOJNAR. *Diagnostowanie złożonych przypadków uszkodzeń przekładni zębatych*. Katowice: Wydawnictwo Instytutu Technologii Eksploatacji - Państwowego Instytutu Badawczego, 2006. ISBN 978-837-2045-744.
- [20] WILK, A., H. MADEJ and T. FIGLUS. Analysis of the possibility to reduce vibroactivity of the gearbox housing. *Maintenance and Reliability*. 2011, vol. 50, iss. 2, pp. 42–49. ISSN 1507-2711.
- [21] KORENCIAK, D. and M. GUTTEN. Opportunities for integration of modern systems into control processes in intelligent buildings. *Przegląd Elektrotechniczny*. 2012, vol. 88, iss. 2, pp. 226–229. ISSN 0033-2097.
- [22] SEBOK, M., M. GUTTEN and M.KUCERA. Diagnostics of electric equipments by means of thermovision. *Przegląd Elektrotechniczny*. 2011, vol. 87, iss. 10. pp. 313–317. ISSN 0033-2097.
- [23] BARTŁOMIEJCZYK, M. Vypocet napajeni trolejbusovych system metodu Monte Carlo. In: *XLII. Sesit Katedry Elektrotechniky*. Ostrava: VSB–Technical University of Ostrava, 2010, pp. 35–40. ISBN 978-80-248-2177-1.
- [24] BARTŁOMIEJCZYK, M. Analiza efektywnosti rekuperace trolejbusove dopravy metodu Monte Carlo. In: *XLIII. Sesit Katedry Elektrotechniky*. Ostrava: VSB–Technical University of Ostrava, 2010, pp. 41–46. ISBN: 978-80-248-2240-2.
- [25] ZIELINSKI, R. *Metody Monte Carlo*. Wydawnictwa Naukowo - Techniczne in Warszawa, 1970.
- [26] JUDEK, S. and J. SKIBICKI. Wyznaczanie parametrow elektrycznych trakcyjnego ukladu zasilania dla złożonych warunkow ruchu przy wykorzystaniu programu pspice. *Przegląd Elektrotechniczny*. 2009, vol. 85, iss. 12, pp. 270–273. ISSN 0033-2097.
- [27] LEE, Grace K. L. and Edwin H. W. CHAN. The Analytic Hierarchy Process (AHP) Approach for Assessment of Urban Renewal Proposals. *Social Indicators Research*. 2008, vol. 89, iss. 1, pp. 155–168. ISSN 0303-8300. DOI: 10.1007/s11205-007-9228-x.

## About Authors

**Mikołaj BARTŁOMIEJCZYK** borned in 1983 in Gdansk, in 2007 graduated Faculty of Electrical and Control Engineering of Technical University of Gdansk, in 2011 reached Ph.D. degree in the same



faculty. His area of research is electrical traction, especially supply systems of tramways and trolleybuses. Beside research activities works in The Trolleybus Transport Company of Gdynia from 2003 year.

**Miroslav GUTTEN** was born in Zilina. He graduated at University of Zilina. He acts on Department of Measurement and Applied Electrical Engineering at University of Zilina.

**Stefan HAMACEK** was born in Cadca. He graduated SOUS Cadca in 2004.

In 2008 he graduated VSB–Technical University of Ostrava, Faculty of Electrical Engineering and Computer Science. Today he is scientific researcher in the Department of Electrical Engineering, VSB–Technical University of Ostrava and he applies himself to the issue of medium-voltage lines with covered conductors and problems associated with faults detection of covered conductors. It also deals with the problems of traction catenary and research dissemination of stray currents in the area of traction.